




Synchronized Reserve Event Performance Summer 2011

Brad Gordon
Operating Committee Update
September 2011




Total MW Response

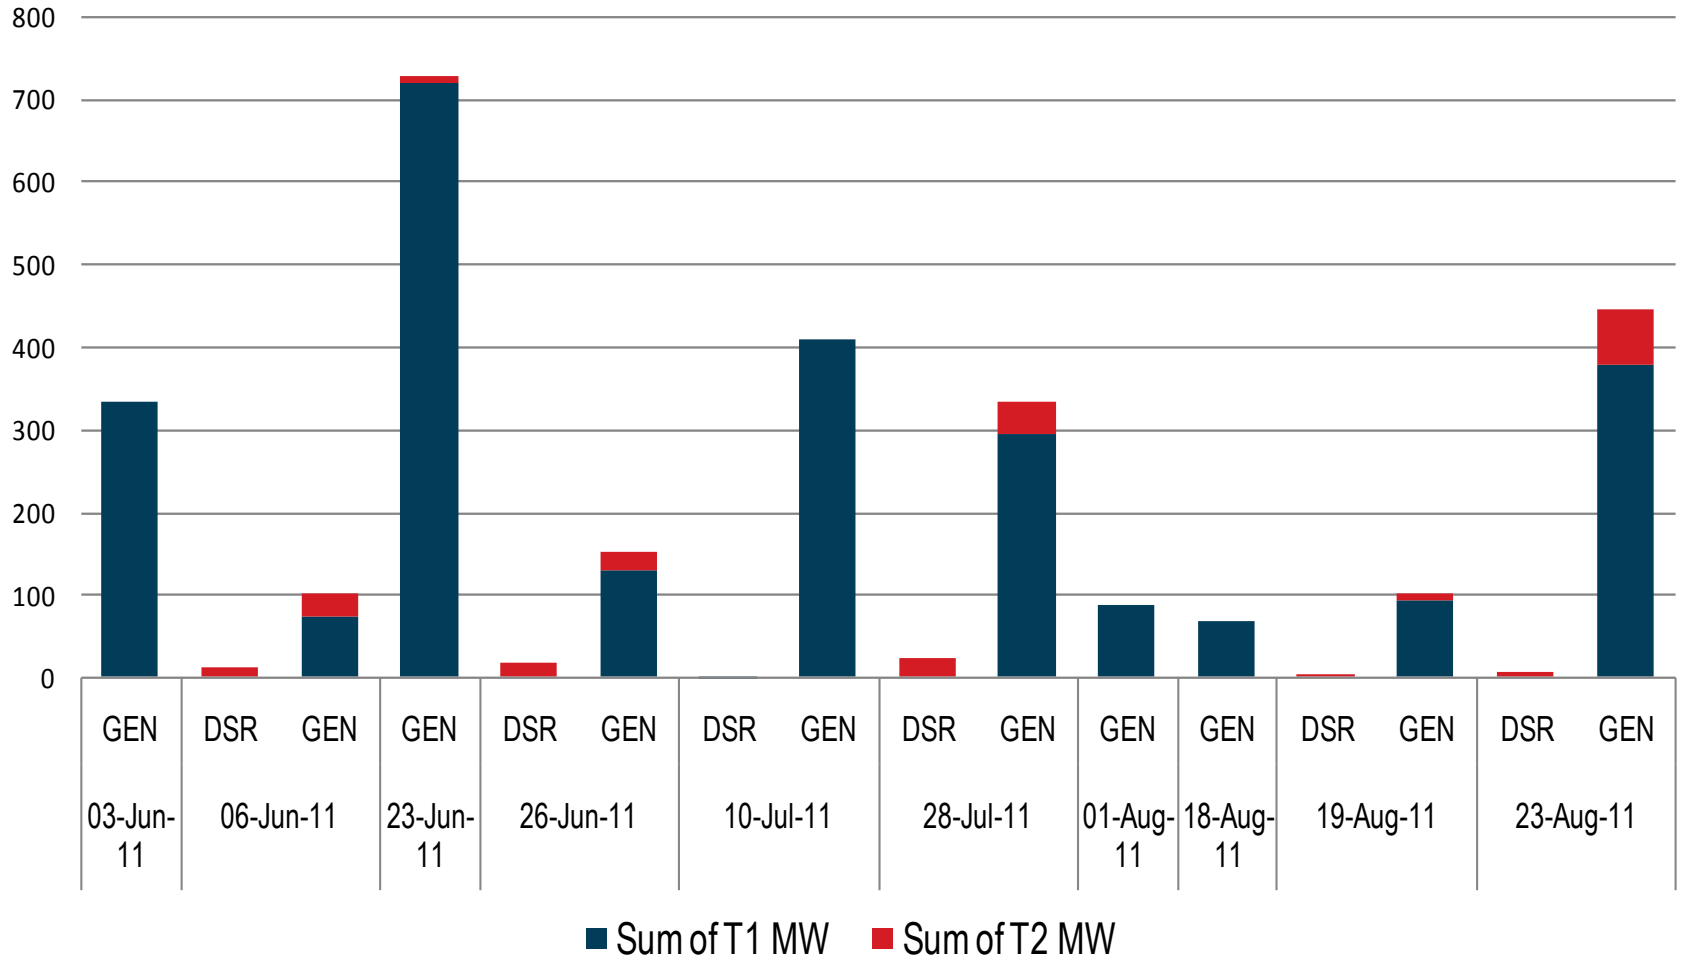




Tier 2 Average Synchronized Response - Summer 2011

Average Participant Response Events ≥ 10 minutes

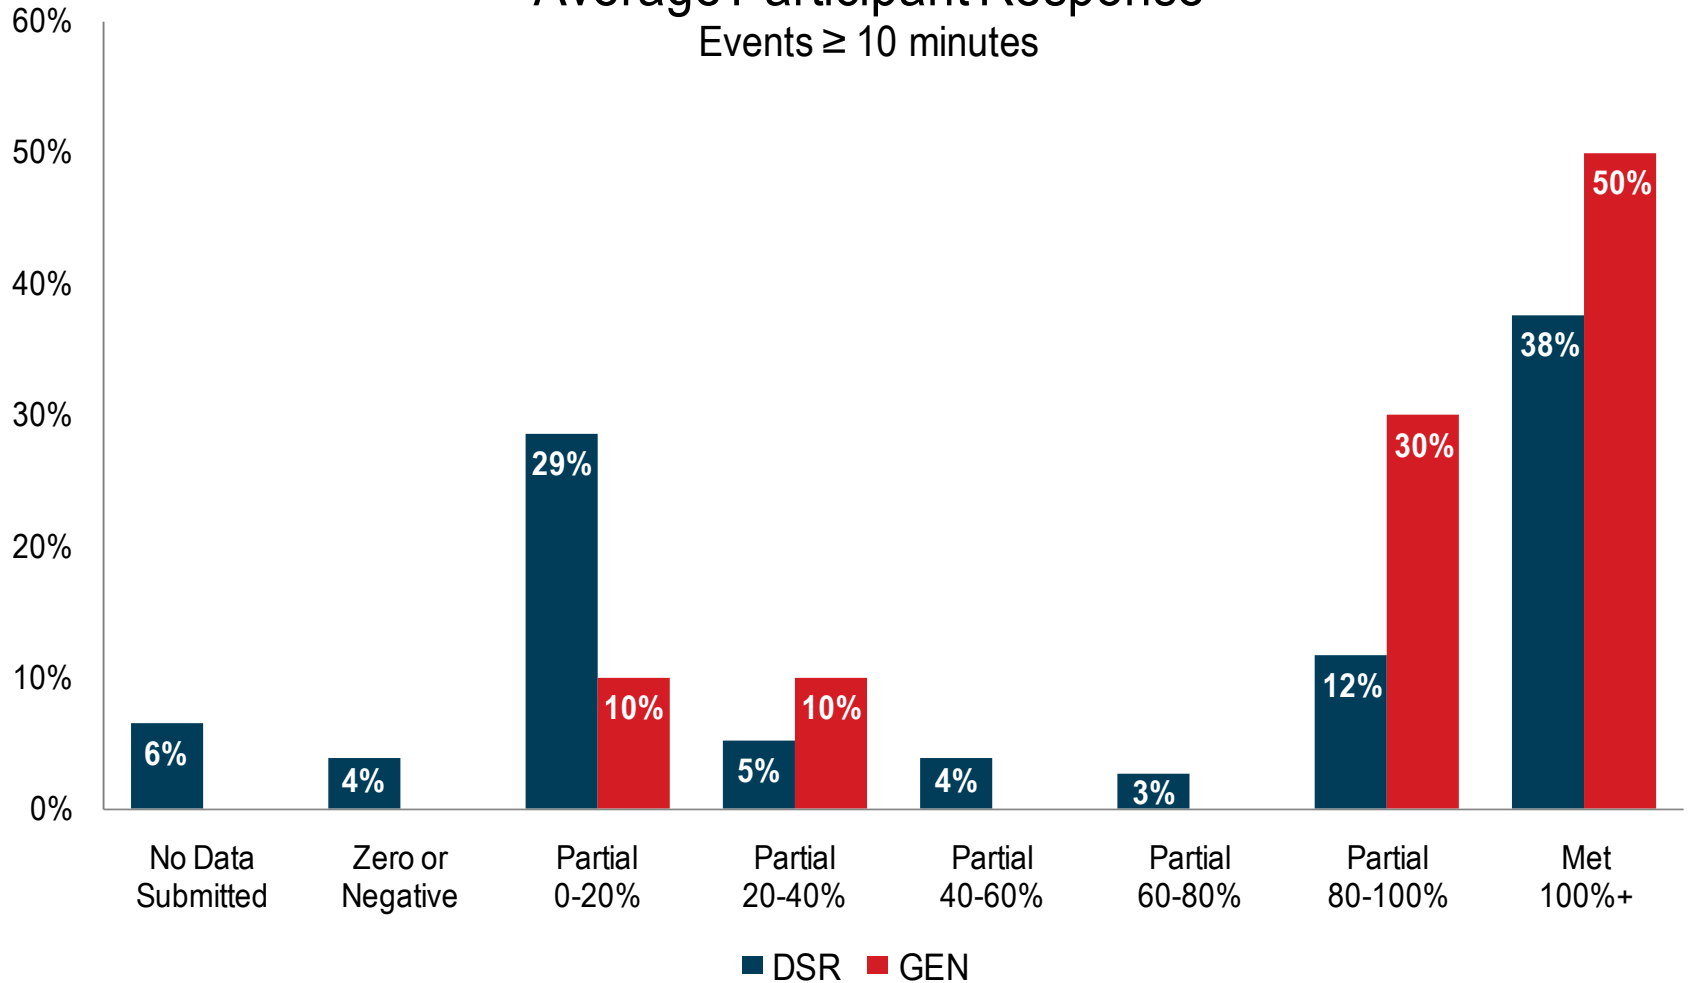

Synchronous Reserve DR Penetration by Month

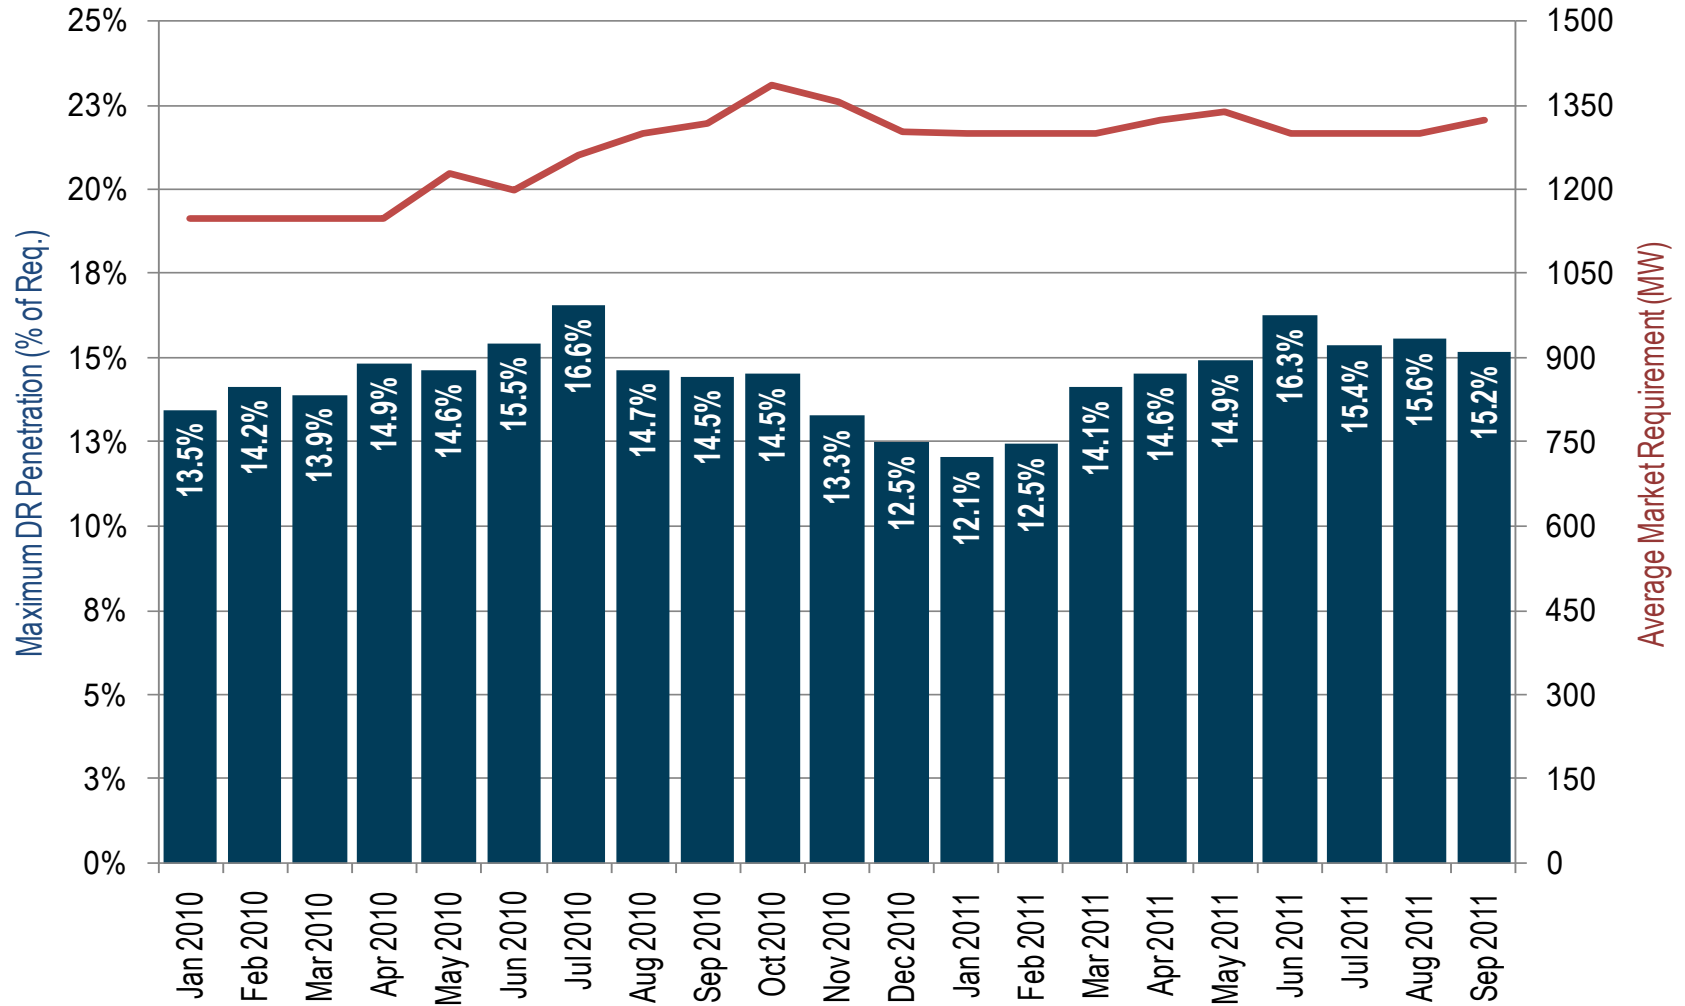

- Ten Synchronized Reserve Events in June through August
 - Three Events \geq 10 Minutes
- Participants that Met Assignment - Events \geq 10 Minutes
 - Generation - 50%
 - Demand Response - 38%
- Demand Response Market Penetration – Highest Hour
 - June - 16.28%
 - July - 15.38%
 - August - 15.58%