



Net Energy Injections at Load Busses Quarterly Report


Ken Schuyler,
Manager Renewable Services

Market Implementation Committee
August 9, 2023

- Follow up effort to the Net Energy Metering Senior Task Force (NEMSTF) recommendation
 - PJM will implement a quarterly review to track and trend overall incidents of net energy injections at load busses
- PJM Manual 28 Requirement
 - PJM will assess and trend quarterly the degree of net energy injections at load busses modeled in the PJM network system model (i.e., reverse power flows) in order to detect and correct any modeling issues and to identify any generation in excess of load that appears at a load bus.




PJM Load Busses with Negative Energy on Average

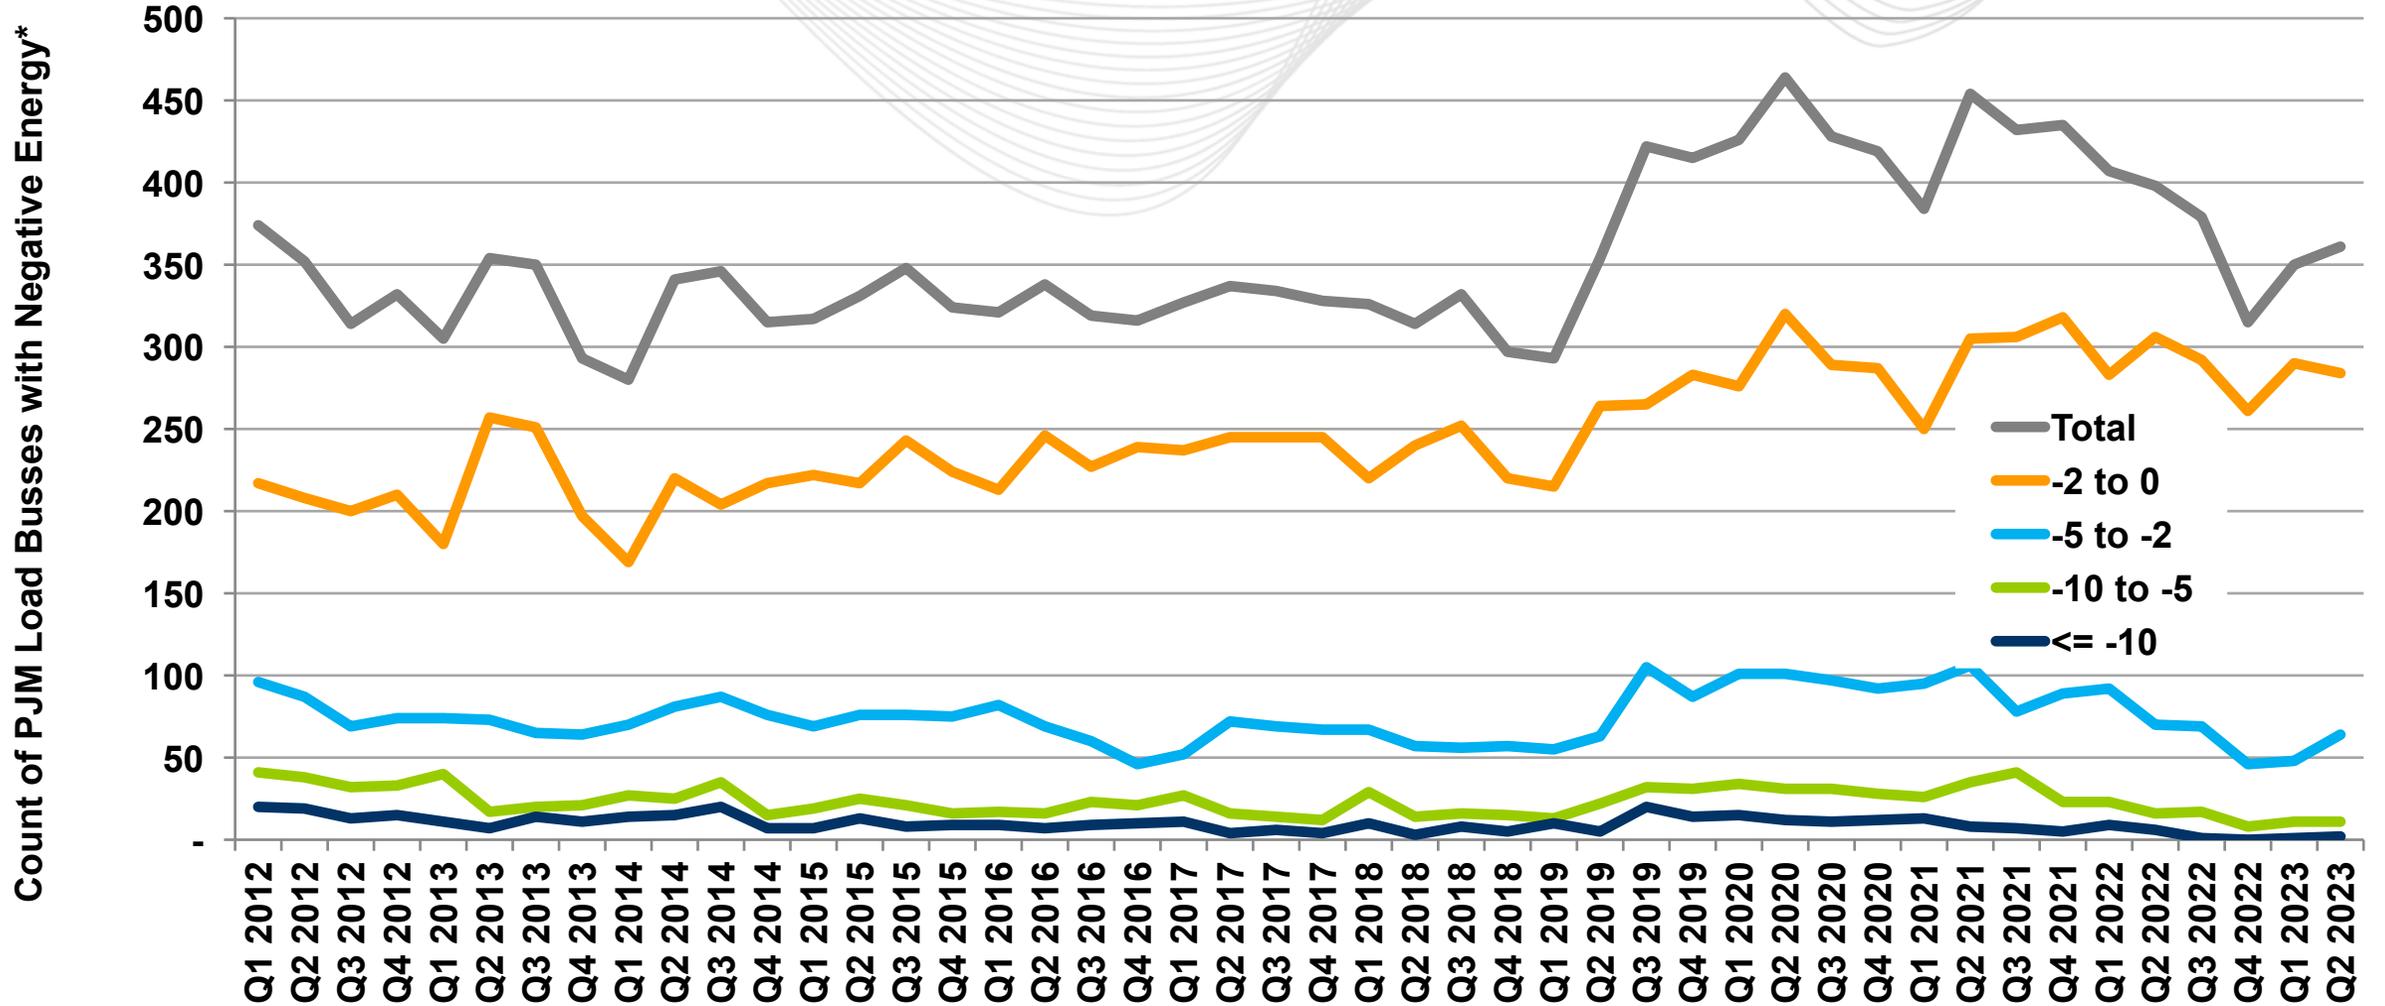


* The total number of PJM load busses is 10,801 as of the most recent model build.

Mid-Atlantic State Load Busses with Negative Energy on Average

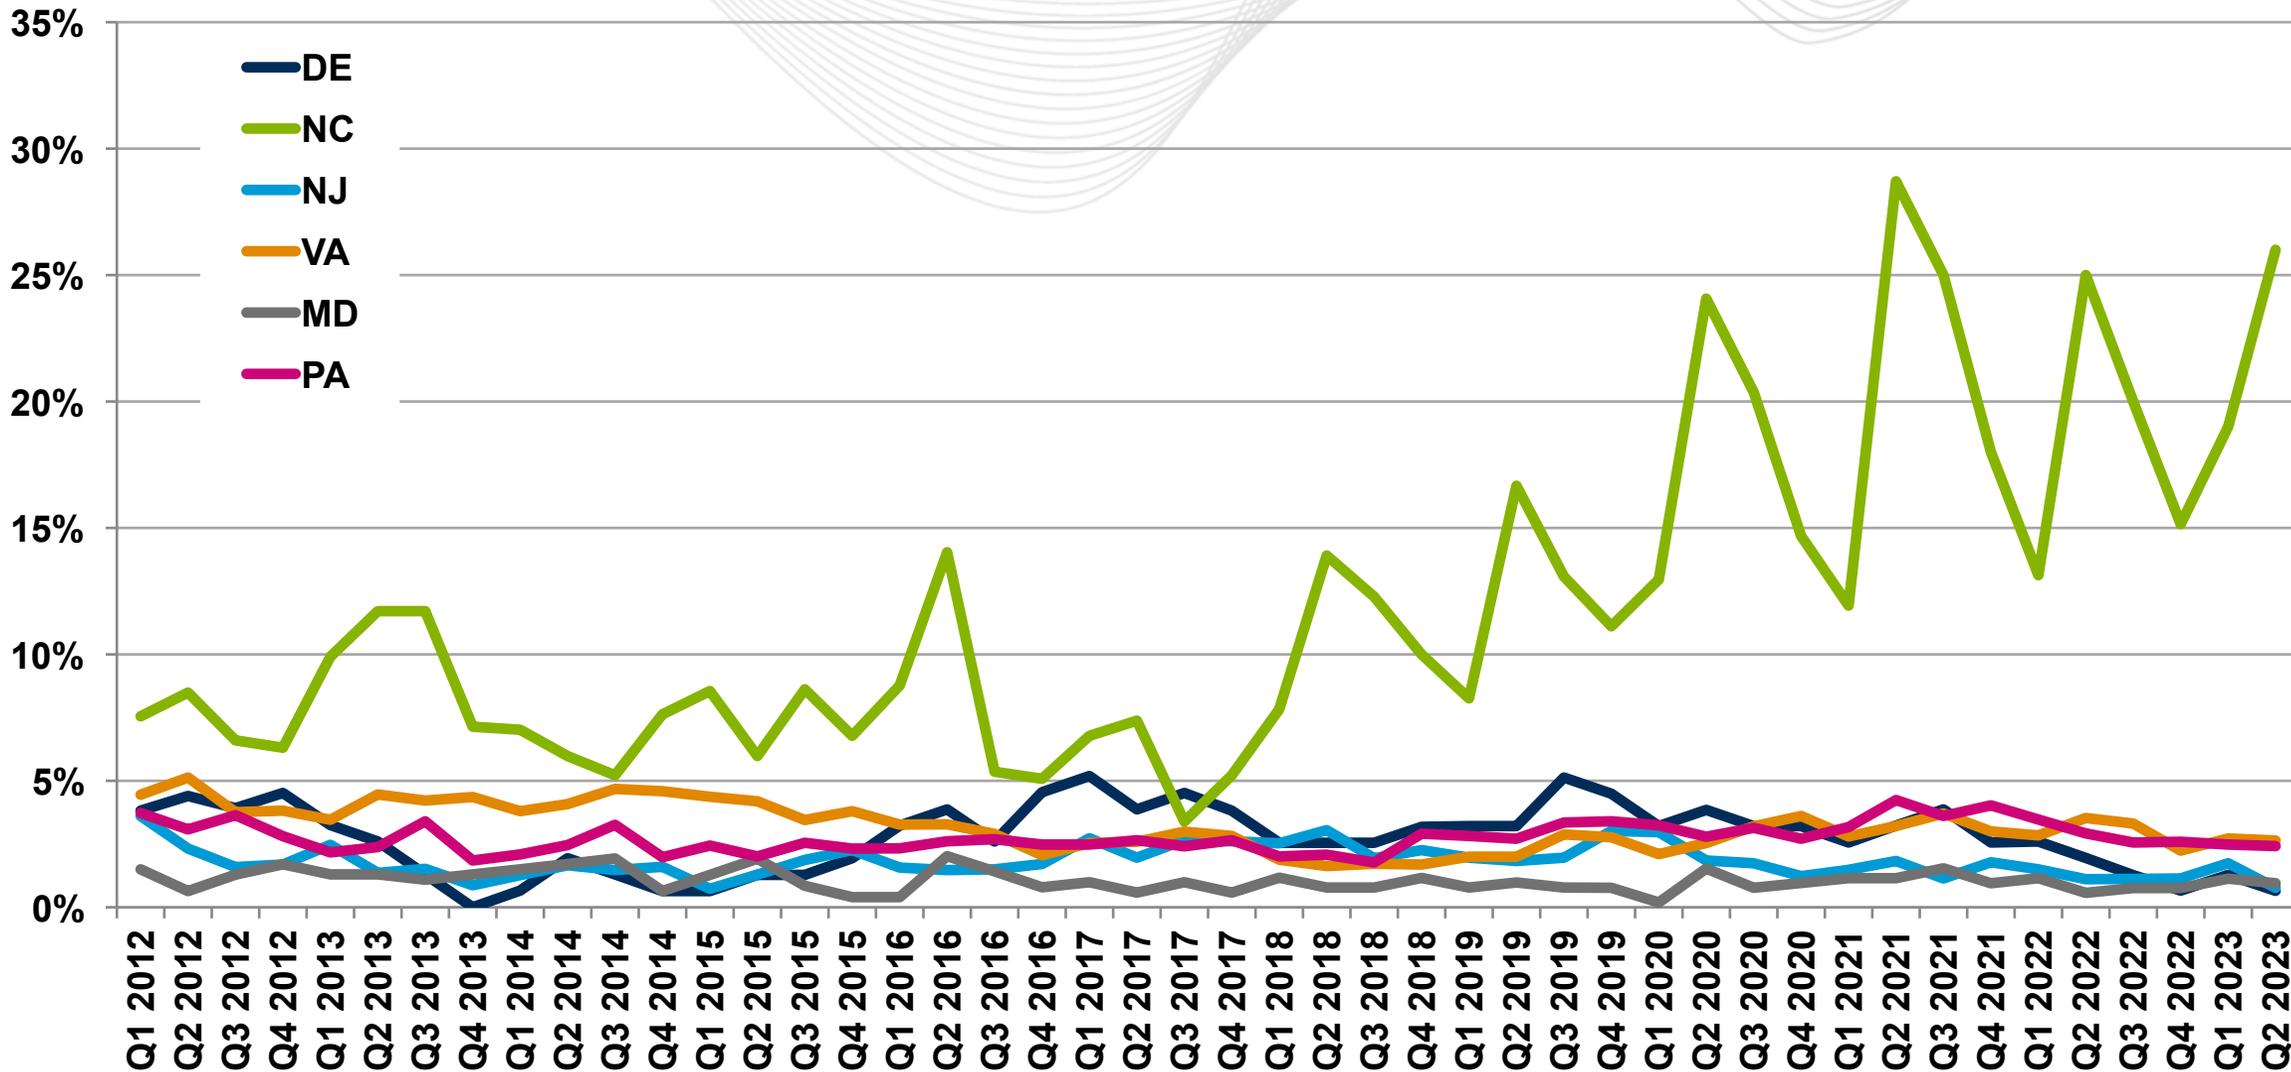

New Jersey Load Busses with Negative Energy on Average

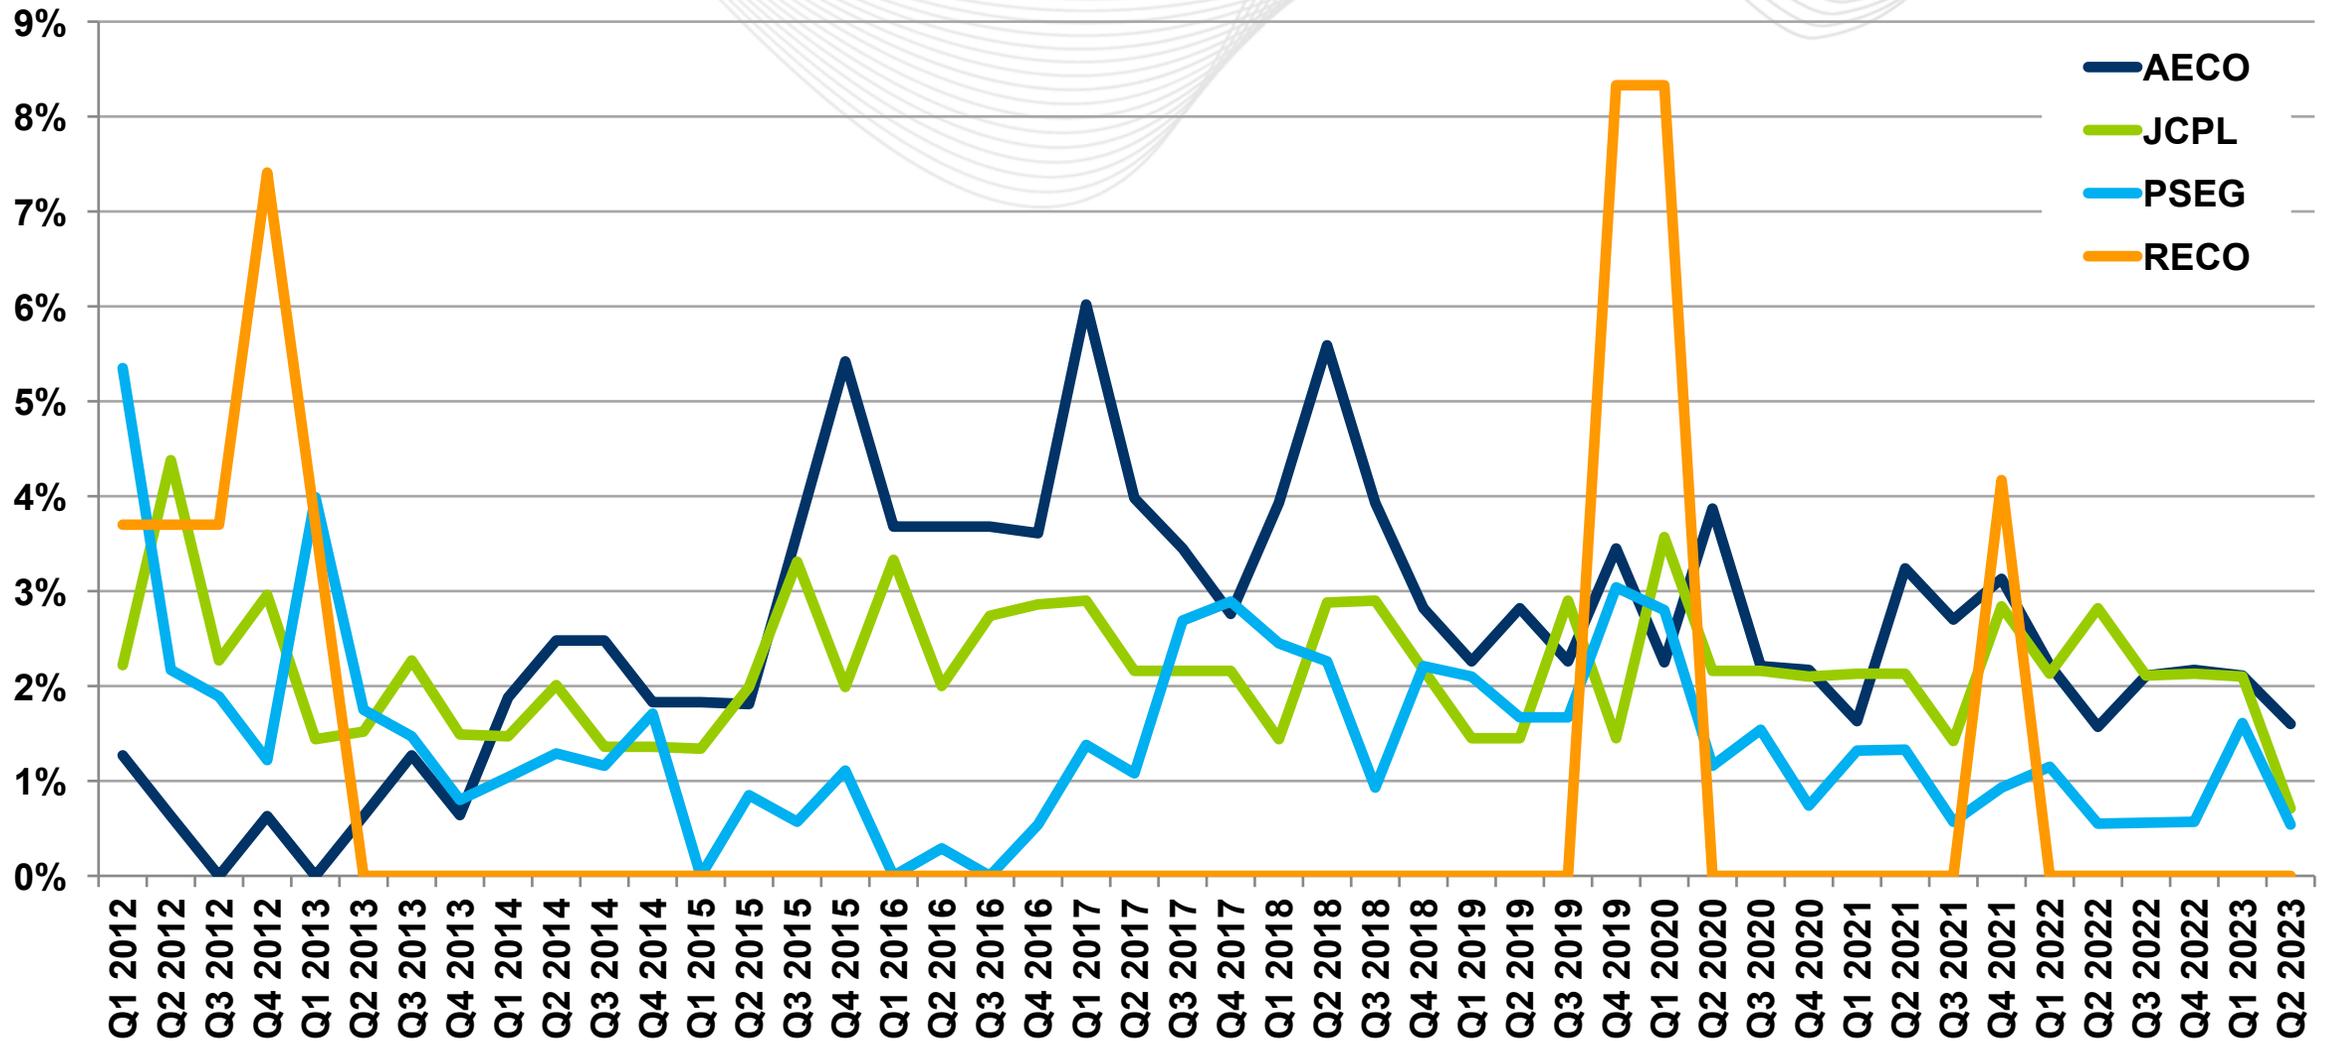

- The total number of load busses with negative energy on average increased 3.1% in Q2 2023 compared to the previous quarter, and decreased 9.3% compared to the same quarter last year (slide 3).
- The total number of load busses with negative energy on average in Q2 2023 is about 3% lower than when PJM started tracking in 2012 (361 vs 374), even though the total number of load busses (10,801) has increased 33% over that eleven-year period (slide 3).
- As expected, NC had an increase in the number of negative load busses in Q2. This has occurred every year for the past several years. The count will likely decline again in Q3 and Q4. This pattern is attributable to utility-scale solar facilities that are not participating in the PJM Market (slide 4).
- PJM continues to track this data to improve its EMS Network Model. To date, trends have not been indicative of an underlying Net Energy Metering issue.

SME:
Ken Schuyler,
Ken.Schuyler@pjm.com

Net Energy Injections at Load Busses



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com