




PJM Manual 12: Balancing Operations v46 Revision Summary

Mike Handlin
Supervisor, Dispatch

- Section 4.1.2 Loading reserves
- Section 5.5 Generator Stability Limitations

- Section 4.1.2 Loading Reserves
 - Added language stating PJM dispatch will utilize Intelligent Reserve Deployment (IRD) in SCED to initiate a Synchronized Reserve Event by approving the latest solved IRD case if there is insufficient regulation and economic generation to recover ACE.
 - Highlighted Automated and Manual Methods of implementing Contingency Reserve

- Section 5.5 Generator Stability Limitations
 - New Section highlights Stability Limited Generation clarifying PJM and Member Actions
 - Reference to Stability Limitations outlined in M-03

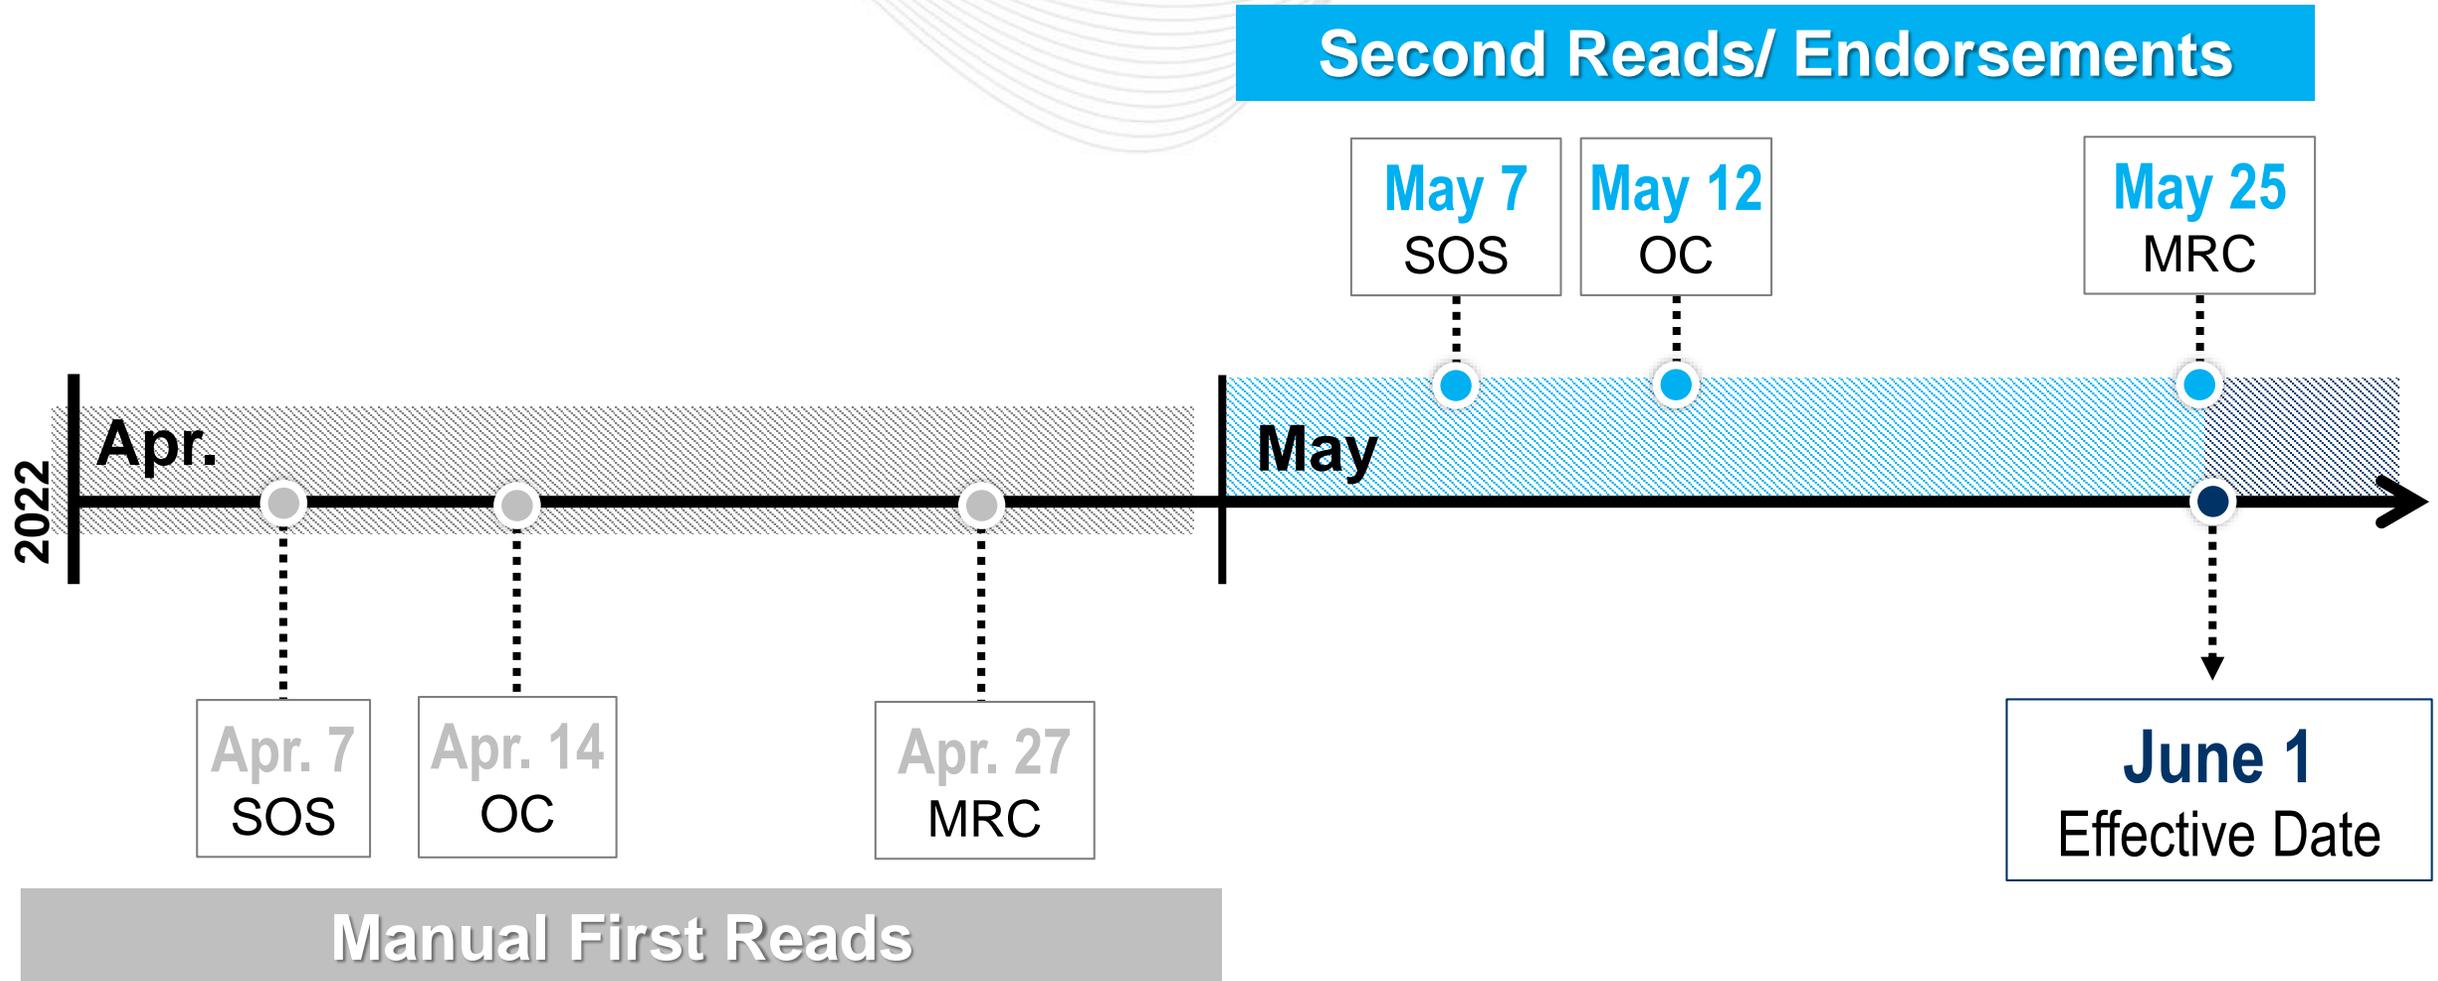

SME/Presenter:

Mike Handlin,
Michael.Handlin@pjm.com

Manual 12, Rev. 46



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com

**PROTECT THE
POWER GRID
THINK BEFORE
YOU CLICK!**



Be alert to
malicious
phishing emails.

Report suspicious email activity to PJM.
(610) 666-2244 / it_ops_ctr_shift@pjm.com