



**PJM RTEP – 2017 RTEP Proposal Window #1**

**Tanners Creek-Miami Fort 345 kV**

**A Proposal to PJM Interconnection, Submitted August 25, 2017**

**Submitted by**

**Transource® Energy, LLC**

**1 Riverside Plaza, Columbus, Ohio 43215-2372**







## Table of Contents

<b>A.</b>	<b>Executive Summary</b> .....	<b>1</b>
A.1.	General Description of Proposed Project .....	1
A.2.	Reliability Problem(s) Proposed to Resolve .....	2
A.3.	Overall Schedule Duration .....	2
A.4.	Overview of Estimate .....	2
A.5.	Designated Entity Statement of Intent .....	2
<b>B.</b>	<b>Company Evaluation Information</b> .....	<b>4</b>
B.1.	Transource Qualifications .....	4
B.2.	Overview of Transource Energy .....	6
<b>C.</b>	<b>Proposed Project Constructability Information</b> .....	<b>9</b>
<b>D.</b>	<b>Analytical Assessment</b> .....	<b>10</b>
<b>E.</b>	<b>Cost</b> .....	<b>11</b>
<b>F.</b>	<b>Schedule</b> .....	<b>12</b>
<b>G.</b>	<b>Operations/Maintenance</b> .....	<b>13</b>
G.1.	Operational Plan .....	13
G.2.	Maintenance Plan .....	13

## A. Executive Summary

Transource® Energy, LLC (Transource) is pleased to provide the following proposal to PJM in response to the *PJM RTEP-2017 RTEP Proposal Window #1 Problem Statement & Requirements Document*. Transource was specifically formed as a joint venture between subsidiaries of American Electric Power Company (AEP) and Great Plains Energy Incorporated (GPE) to participate in competitive processes for transmission development and to provide benefits to transmission customers through the planning, construction, and ownership of high quality, low cost transmission infrastructure. Transource is located at 1 Riverside Plaza in Columbus, Ohio.

### A.1. General Description of Proposed Project

Transource proposes to build the “Tanners Creek-Miami Fort Project” (or, “the Project”) in southern Indiana, northern Kentucky and southern Ohio.

The Project includes the following:

- A 345 kV Transmission Line between Tanners Creek and Miami Fort substations to be approximately 4.16 miles in length.
- One new 345 kV circuit breaker at Tanners Creek.
- One new 345 kV circuit breaker at Miami Fort.

Transource has completed the necessary preliminary project development work to determine project constructability, preliminary cost estimates, and a construction schedule. Experienced AEP engineering personnel were the primary resources for this work.

For the purpose of this proposal, Transource developed a Conceptual Route based on a desktop review of publicly available data. The Conceptual Route was used as the basis for the designs and estimates contained in this proposal. However, the Conceptual Route is not intended to represent a preferred, alternate or final route for purposes of the applicable siting, permitting and other regulatory approval processes.



## A.2. Reliability Problem(s) Proposed to Resolve

The Project addresses the planning criteria violations listed below:

**Table 1. Addressed Contingencies Identified by PJM**

PJM Generation Deliverability Results (Winter)																
FG #	Fr Bus	Name	To Bus	Name	CKT	KVs	Areas	Rating	FN DC Flow	FN AC Flow	FN DC %	FN AC %	Cont Label	Cont Type	Conductor Rating (MVA)	PJM Comment
GD-W3	243233	OSTANNER	249567	08M.FORT	1	345/345	205/212	2022	2238.22	2238.22	111	111	':345.DE0&K.B2 TERMINAL-EAST BEND 4516'	single	AEP = 2550/2550, DEOK=2406/2406	Terminal equipment limited
GD-W5	243233	OSTANNER	249567	08M.FORT	1	345/345	205/212	2022	2078.78	2082.55	103	103	'AEP_P1-2_#7441'	single	AEP = 2550/2550, DEOK=2406/2406	Terminal equipment limited
GD-W6	243233	OSTANNER	249567	08M.FORT	1	345/345	205/212	2022	2011.99	2011.99	100	100	'AEP_P1-2_#1358'	single	AEP = 2550/2550, DEOK=2406/2406	Terminal equipment limited
GD-W7	243233	OSTANNER	249567	08M.FORT	1	345/345	205/212	2022	1982.85	1975.09	98	98	':345.DE0&K-OVEC.B2 FOSTER-PIERCE 4502'	single	AEP = 2550/2550, DEOK=2406/2406	Terminal equipment limited
GD-W8	243233	OSTANNER	249567	08M.FORT	1	345/345	205/212	2022	1982.85	1975.09	98	98	'AEP_P1-2_#876'	single	AEP = 2550/2550, DEOK=2406/2406	Terminal equipment limited

The worst generation deliverability issue that PJM identified (FG#GD-W3) occurs for a line outage that removes the Terminal – East Bend 345 kV circuit. The Project introduces an additional 345 kV outlet from Tanners Creek to Miami Fort that will prevent this violation from occurring should any of the subject line outage contingencies ever take place. Furthermore, Transource performed analysis of existing and new contingencies that the Project may create and found no planning criteria violations.

## A.3. Overall Schedule Duration

The Project is expected to be placed in service 59 months after execution of the PJM Designated Entity Agreement (DEA). Assuming the DEA is executed by February 1, 2018, Transource could place the Project in service December 31, 2022.

## A.4. Overview of Estimate

The estimated capital cost of the Project is approximately \$11,452,976 (in 2017 dollars). This estimated cost includes all Project components, including work that PJM may consider as upgrades. Please refer to Section E of this proposal for details on the project cost.

## A.5. Designated Entity Statement of Intent

Transource, as the pre-qualified entity, seeks to be considered the Designated Entity for the project described within this Proposal. Ultimately, Transource anticipates that its wholly-owned subsidiary companies, Transource Ohio, LLC (Transource Ohio), Transource Kentucky, LLC (Transource Kentucky) and Transource Indiana, LLC (Transource Indiana) will design,



construct, own, operate, and maintain the facilities and assets, subject to determination regarding components deemed upgrades by PJM. Transource Ohio will design, construct, own, operate, and maintain the facilities and assets located within the state of Ohio. Transource Kentucky will design, construct, own, operate, and maintain the facilities and assets located within the state of Kentucky. Transource Indiana will design, construct, own, operate, and maintain the facilities and assets located within the state of Indiana. As such, should PJM award this project to Transource, we respectfully request that PJM address the Construction Designation in Attachment A of the Notification of Designation of Construction Responsibility (NDCR) letter to Transource Ohio, Transource Kentucky and Transource Indiana, according to the intended ownership described above.

## B. Company Evaluation Information

Transource Energy, LLC is located at 1 Riverside Plaza in Columbus, Ohio. Specific contact information is provided below.

### Transource Contacts

Primary Contact	Adam Hickman Manager, Transource Business Development	Transource Energy, LLC 1 Riverside Plaza Columbus, Ohio 43215-2372 Telephone: 614-716-2854 Email Address: ajhickman@aep.com
Secondary Contact	Takis Laios Manager, Transmission Asset Strategy	Transource Energy, LLC 1 Riverside Plaza Columbus, Ohio 43215-2372 Telephone: 614-716-3462 Email Address: tlaios@aep.com


### B.1. Transource Qualifications

Transource has been pre-qualified to be a Designated Entity for transmission projects in PJM under section 1.5.8 (a) of the PJM Operating Agreement. The pre-qualification information is contained in the document submitted to PJM on April 29, 2013, entitled *Pre-Qualification Application of American Electric Power and Certain Affiliates*. This document is on record with PJM and posted on the PJM website, with PJM pre-qualification ID of 13-05. PJM confirmed the pre-qualified status of Transource in a letter dated July 7, 2013. As required annually, Transource has reviewed this information and an Addendum to this posted document was submitted to PJM on September 30, 2016. PJM reaffirmed the pre-qualified status of AEP in a letter dated October 27, 2016.

Transource will bring to bear the talents, resources, and capabilities of AEP, GPE, and their respective subsidiaries to execute the Project. These capabilities are detailed in Transource’s prequalification submittal to PJM.

Overview of Capital Resources

Transource Ohio, Transource Kentucky and Transource Indiana are anticipated to be the respective owners of the portions of the awarded project that lie within the state boundaries of Ohio, Kentucky and Indiana. Transource Ohio, Transource Kentucky and Transource Indiana will follow the successful model of financing that is currently used by its affiliate sister companies. Transource Ohio, Transource Kentucky and Transource Indiana will intend to use a combination of debt and equity financing to fund its ownership of the projects. Figure 1 below depicts the legal structure and financing arrangement for Transource Energy and its existing active subsidiary companies, including Transource Missouri, LLC, which currently owns and operates transmission assets in SPP, and Transource West Virginia, LLC, Transource Maryland, LLC and Transource Pennsylvania, LLC which are developing transmission projects in the PJM Interconnection.

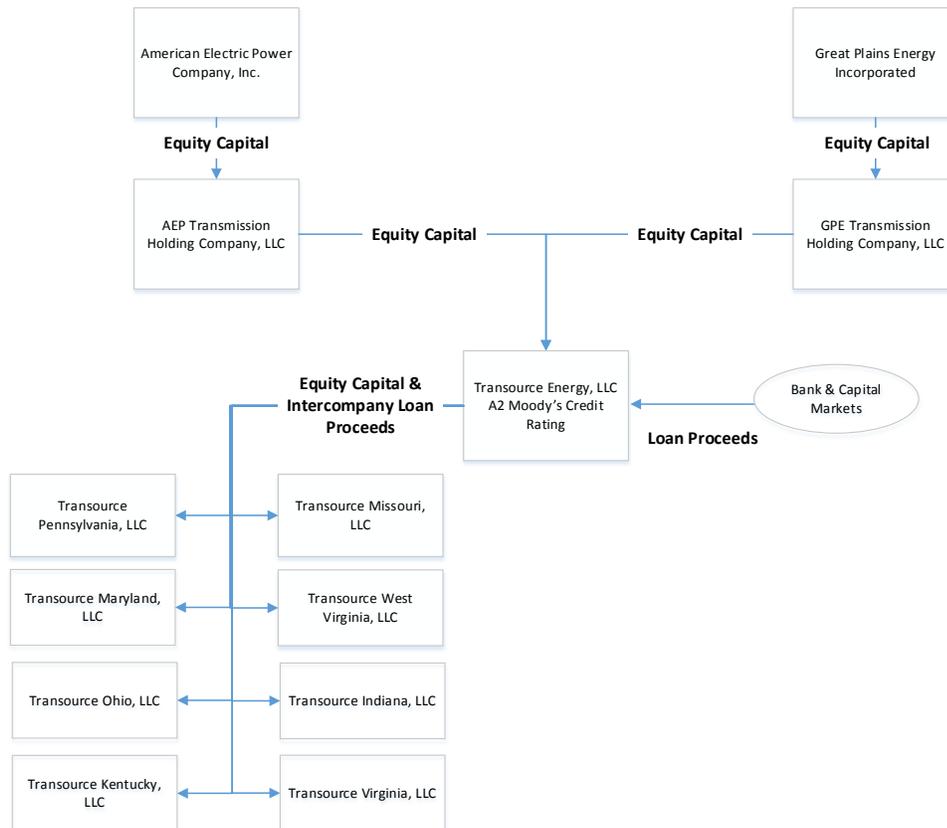

**Figure 1. Transource Financial Structure**

Transource's funding authority is governed by an Operating Agreement, whereby the Members of the Operating Agreement, AEP Transmission Holding Company, LLC and GPE Transmission Holding Company, LLC, have set forth an agreement with respect to obligations to fund capital contributions for ongoing expenditures at Transource Energy and its subsidiary companies. Debt capital raised at Transource Energy (A2 Moody's credit rating) will be lent, at cost, through an intercompany lending agreement to Transource Ohio, Transource Kentucky and Transource Indiana. Transource Ohio, Transource Kentucky and Transource Indiana will pay Transource Energy for the cost of these loans, including any interest expense, commitment fees, upfront lending fees, rating agency fees, or other financing costs according to each company's pro rata portion of the loans.

## **B.2. Overview of Transource Energy**

Transource was formed to pursue the development of competitive transmission projects in marketplaces initiated by the implementation of FERC Order No. 1000. AEP owns 86.5 percent of Transource, and GPE owns 13.5 percent. Transource owns 100% of its subsidiary companies. The combined strengths of AEP and GPE in engineering, project management, procurement, project development, construction, and operation/maintenance will result in effective and efficient delivery of transmission solutions that benefit transmission customers.




Figure 2. Summary of Transource Ownership Structure

Transource developed two Southwest Power Pool (SPP) approved transmission projects in the state of Missouri through its subsidiary Transource Missouri, LLC (Transource Missouri): The Iatan-Nashua 345 kV transmission project, placed into service in April 2015, and the Sibley-Nebraska City 345 kV transmission project, placed into service in December 2016.

Transource, in coordination with AEP affiliate Appalachian Power Company, is also developing a project in West Virginia through its subsidiary company, Transource West Virginia, LLC. The \$75 million project consists of building 25 miles of 138 kV transmission line and three substations, and upgrades to other transmission facilities in Roane and Kanawha counties of West Virginia. The project is expected to be in-service in 2019.

In addition to these projects in Missouri and West Virginia, Transource was awarded PJM’s largest-ever market efficiency project on the Pennsylvania-Maryland border in August 2016. In January 2017, Transource, through authorization from the Federal Energy Regulatory Commission (FERC), established formula rates and received approval for certain incentives.

The figure below provides a snapshot of the states in which Transource's owners, AEP and GPE, currently own or are developing transmission assets, demonstrating the breadth and capabilities of Transource.

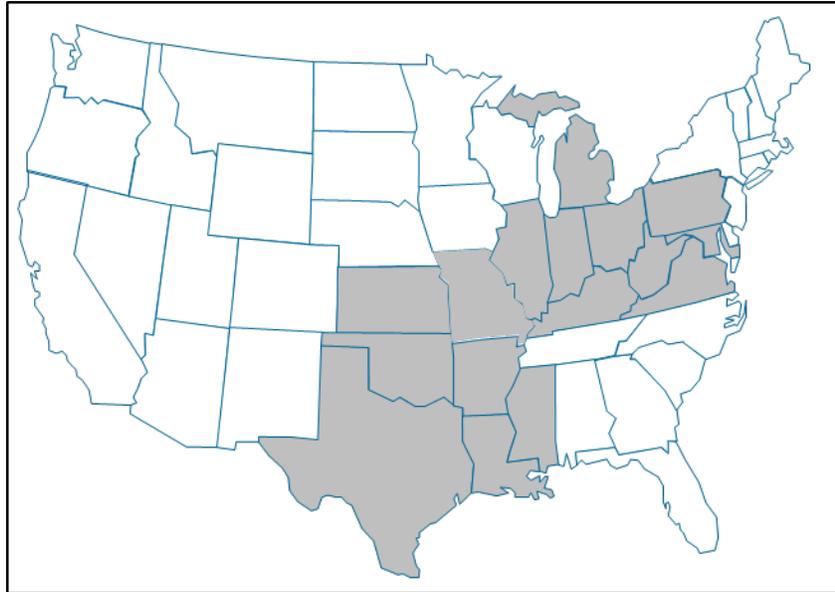

**Figure 3. AEP and GPE Combined Transmission Presence**

## C. Proposed Project Constructability Information

[REDACTED]

## D. Analytical Assessment

[REDACTED]



## E. Cost

[REDACTED]



## F. Schedule

[REDACTED]

## G. Operations/Maintenance

### G.1. Operational Plan

Transource is flexible regarding Project operations that can be provided using one of the following approaches:

- Transource can operate the new facilities directly using the capabilities of the AEP Transmission Operations (TOps) organization.
- Transource can work with the incumbent transmission owner to facilitate their operations of the new facilities.

The TOps organization operates from a state-of-the-art System Control Center (SCC) located in New Albany, Ohio. AEP TOps also operates five Transmission Operations Centers that coordinate transmission switch orders and interface with field personnel. The SCC and Transmission Operations Centers are staffed with NERC and PJM-Certified operators.

Operator tools include a State Estimator covering AEP's 11-state transmission system, real-time contingency analysis, and visualization and situational awareness tools. TOps has a back-up control center that can be staffed and fully functional within one hour from declaration of an emergency. TOps completes approximately 18,000 switching jobs totaling over 200,000 switching steps with an accuracy rate exceeding 99.99 percent annually.

### G.2. Maintenance Plan

[REDACTED]





**TRANSOURCE ENERGY, LLC**  
1 Riverside Plaza  
Columbus, OH 43215  
**P** 614-716-2884  
**E** [info@TranSourceEnergy.com](mailto:info@TranSourceEnergy.com)  
[www.transourceenergy.com](http://www.transourceenergy.com)

