


Manual 03, Revision 68

Transmission Operations

Rob Dropkin, Sr. Engineer II
Transmission Operations

Markets and Reliability Committee
April 23, 2025

- **Revision 68 (05/21/2025):**
 - Periodic Review
 - Section 2.1.1 – Clarify language for actions in regards to LTE and STE ratings
 - Section 3.2 – Clarify language in Voltage Operating Criteria

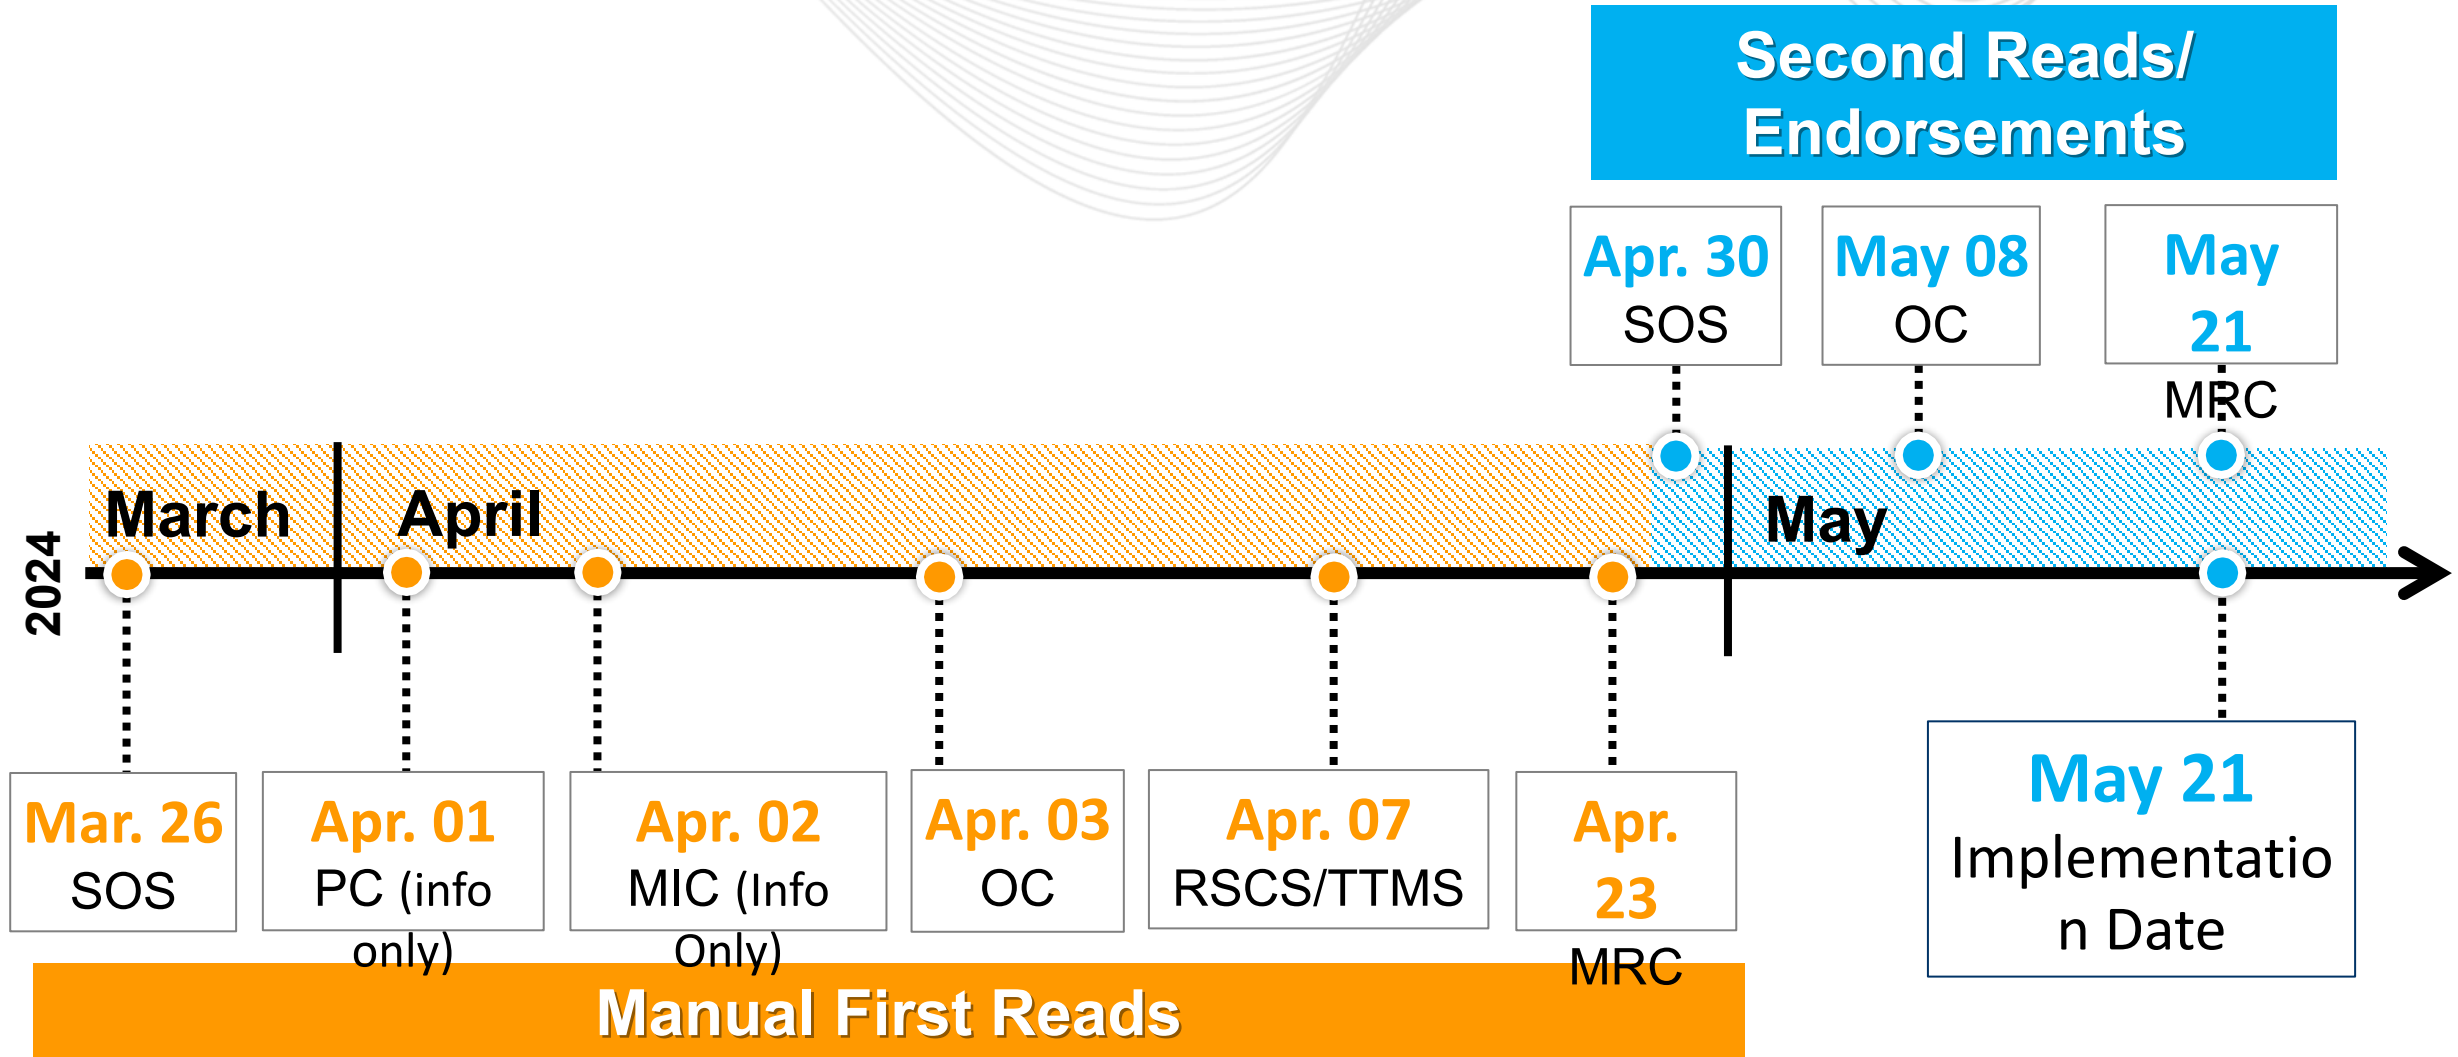

SME/Presenter:

Rob Dropkin,

Robert.Dropkin@pjm.com

M-03 Change Contact:

M03_Change@pjm.com

Manual 03, Rev 68 – Periodic Review



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com


Appendix

- **Revision 66.3 (11/19/2024):**
 - RTO Operation: Updated Beaver Valley NPIR voltage drop limit.
 - RTO Operation: Updated ownership for Beaver Valley, Davis Besse, and Perry
 - RTO Operation: Updated Cook NPIR voltage limits.
 - Attachment A: Updated facility list due to new PRC-026 revision.
 - Attachment B: Updated ownership for various generators.

**PROTECT THE
POWER GRID**
**THINK BEFORE
YOU CLICK!**



**BE ALERT TO
MALICIOUS PHISHING
EMAILS**

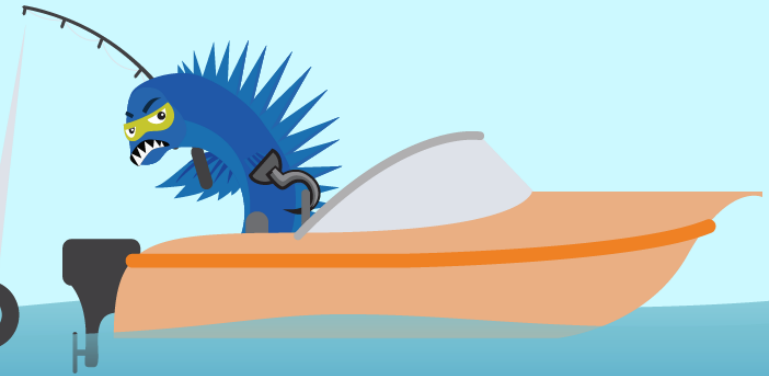

Report suspicious email activity to PJM.
Call (610) 666-2244 or email it_ops_ctr_shift@pjm.com