

# Proposal: Wind and Solar Dispatch in Real-Time Market Clearing Engines

Vijay Shah  
Real-Time Market Operations

Markets & Reliability Committee  
October 23, 2025

- Introduced Problem Statement and Issue Charge at June 3, 2024 DISRS meeting
- Completed Key Work Activities:
  - Education, Interests, Solution Options
  - Published paper on [renewable dispatch in market clearing engines](#) October, 2024
- One joint proposal with PJM and several stakeholders endorsed at Aug MIC
  - The committee endorsed the solution proposal at this meeting with 187 (98.9%) in favor, 2 (1.1%) opposed, and 21 abstentions


- Renewable resources are making up an increasing portion of the PJM generation mix
- It has become difficult to manage the dispatch of these resources using PJM's real-time market clearing engines
- There are three areas of primary focus for enhancements in this Issue Charge:
  - Reducing the volatility that renewable resources can have on constraint control
  - Improving the data PJM's security constrained economic dispatch (SCED) uses to dispatch these resources (to improve overall system dispatch)
  - Improving SCED ability to dispatch these resources, thus improving system dispatch and reliability

- The proposal creates a concept of an “Effective EcoMax”
- Effective EcoMax would change based on how the resources was dispatched in the previously approved RTSCED case.
- If resource was not previously curtailed, a non-curtailement period, the Effective EcoMax would be equal to the State Estimator solution value (Dispatchable range).
- If resource was previously curtailed, a curtailment period, the Effective EcoMax will be the maximum of solved SE value, PJM forecast value or the Bid-In EcoMax value.

- To help minimize volatility, resources will limit ramp rates no greater than 20% ICAP value per minute for wind and solar resources
- Effective EcoMax will be utilized in both the dispatch and pricing runs
- No changes to market settlement or intra-day offer rules, regardless of option selected
  - Make whole / deviation charges remain status quo and will be based on Bid-in EcoMax

Reminder: All dispatchable (Economic or Must-run) resources are expected to submit accurate bid-in parameters, including ramp rates, and follow PJM's dispatch signal for target time as closely as possible

- Improves inputs into SCED engines with a more accurate representation of Wind and Solar resources' capability.
- Added transparency with the curtailment flag for Wind and Solar resources.
- Reduce constraint volatility with resources ramping linearly.

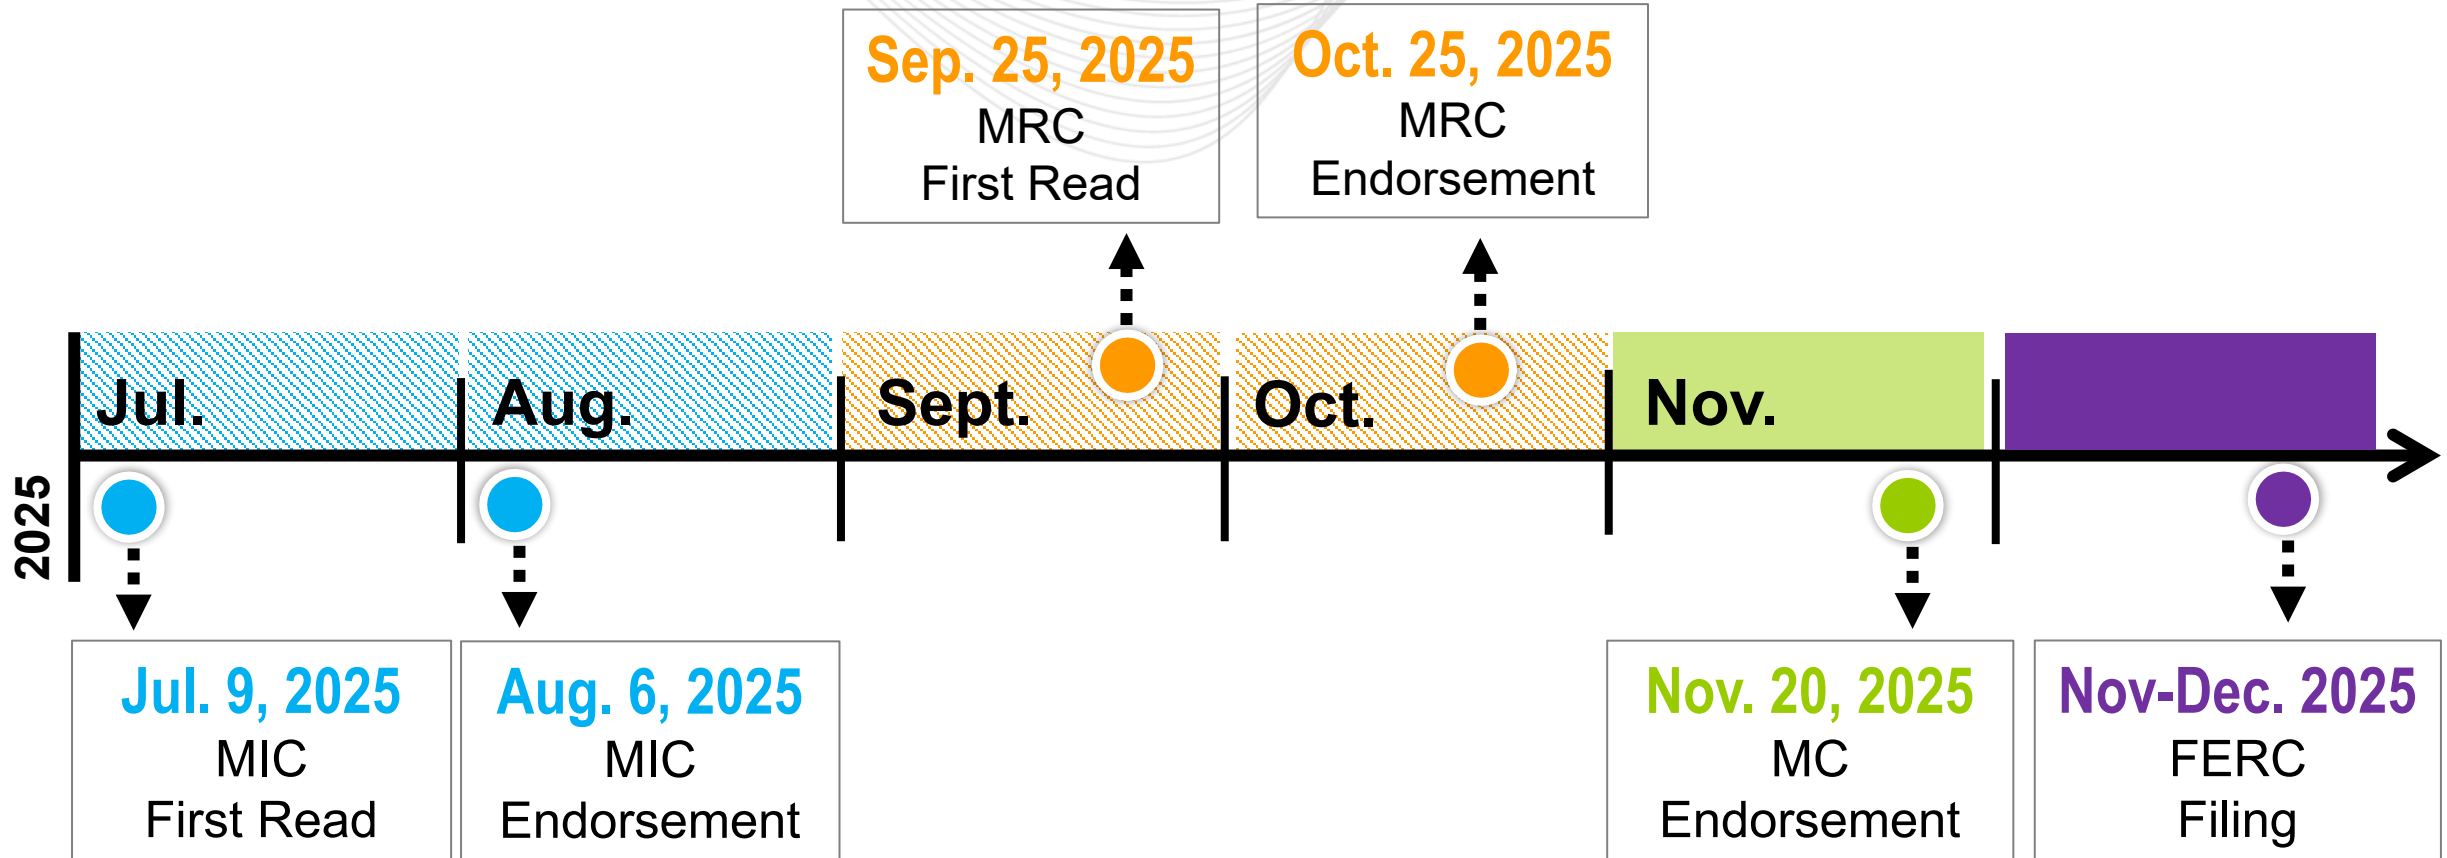

# Appendix

| Name                 | Type   | Description                                                                                                                                                                                                                                              |
|----------------------|--------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Interval             |        | Each row represents one hypothetical RTSCED case solution.                                                                                                                                                                                               |
| SE MW                | Input  | Solved State Estimator solution value, which is treated as the initial MW for each RTSCED case.                                                                                                                                                          |
| Curtailment Flag     | Input  | Proposed resource specific flag, used to determine the Effective Economic Max that should be use for the current interval. This is based on previously approved RTSCED case solution.                                                                    |
| Forecast MW          | Input  | PJM forecast MW data.                                                                                                                                                                                                                                    |
| Bid-in EcoMax        | Input  | Resource Bid-In Economic Maximum MW.                                                                                                                                                                                                                     |
| Effective EcoMax     | Input  | Proposed dispatchable range, up to effective EcoMax. In this option, the Effective EcoMax would be based on the formula: $\text{Effective EcoMax} = \text{Max}(\text{SE}, \text{Forecast}, \text{Bid in EcoMax})$ when resource is previously curtailed. |
| Calculated Basepoint | Output | Based on RTSCED solution would be the proposed, calculated output based on the effective EcoMax formula and economics of the unit and case.                                                                                                              |
| Curtailment Flag     | Output | Calculated based on RTSCED case solution, based on the effective EcoMax and economics of the unit and case.                                                                                                                                              |
| Description          |        | Interpretation of the case solution.                                                                                                                                                                                                                     |

# Example 1 - Unit Operating Above Bid-In EcoMax

| Interval | SE (MW) | Curtailed | Forecast MW | Bid-In EcoMax (MW) | Effective EcoMax (MW) | Calculated Base Point | Curtailed | Description                                                                                                                                                                        |
|----------|---------|-----------|-------------|--------------------|-----------------------|-----------------------|-----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Type     | Input   | Input     | Input       | Input              | Input                 | Output                | Output    |                                                                                                                                                                                    |
| 1        | 0       | 0         | 0           | 100                | 0                     | 0                     | 0         | Unit is offline                                                                                                                                                                    |
| 2        | 50      | 0         | 75          | 100                | 50                    | 50                    | 0         | Unit is online, dispatchable up to Effective EcoMax, which is equal to the SE value because the unit was not curtailed in the previous interval.                                   |
| 3        | 110     | 0         | 75          | 100                | 110                   | 110                   | 0         | Unit continues to produce more MWs, since it was not curtailed in the previous interval, continues to be dispatchable up to effective EcoMax, which is the SE value at this point. |
| 4        | 95      | 0         | 95          | 100                | 95                    | 95                    | 0         | Effective EcoMax continues to be based on the solved SE value since it was not curtailed in the previous interval.                                                                 |

\*Since unit is not curtailed, Effective EcoMax = SE Value.

| Interval | SE (MW) | Curtailed | Forecast MW | Bid-In EcoMax (MW) | Effective EcoMax (MW) | Calculated Base Point | Curtailed | Description                                                                                                                                                                                                                                                |
|----------|---------|-----------|-------------|--------------------|-----------------------|-----------------------|-----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Type     | Input   | Input     | Input       | Input              | Input                 | Output                | Output    |                                                                                                                                                                                                                                                            |
| 1        | 110     | 0         | 75          | 100                | 110                   | 85                    | 1         | 1)Unit providing above bid-in EcoMax. 2)Assume constraint binds and SCED needs to move the unit down to 85MW. 3) Unit was not previously curtailed. Effective EcoMax would be up to 110MW.                                                                 |
| 2        | 90      | 1         | 95          | 100                | 100                   | 85                    | 1         | 1) Constraint continues to bind. 2) Unit moves down but not enough. 2) Resources continues to be dispatched to 85 MW. 3) Unit continues to be curtailed since it is not dispatched up to Effective EcoMax (assuming economic would have allowed it to be). |
| 3        | 85      | 1         | 95          | 100                | 100                   | 100                   | 0         | 1) Unit moves down to 85 MWs, constraint no longer active. 2)Effective EcoMax formula in place because resource was previously curtailed within 2 RTSCED cases. 3) Resource dispatched up to calculated EcoMax, 100MW 4) <b><u>Transition period.</u></b>  |
| 4        | 90      | 0         | 95          | 100                | 100                   | 100                   | 0         | 1) Constraint no longer active. 2) Effective EcoMax formula in place because resource was previously curtailed within 2 RTSCED cases. 3) Resource dispatched up to calculated EcoMax, 100MW 4) <b><u>Transition period.</u></b>                            |
| 5        | 110     | 0         | 95          | 100                | 110                   | 110                   | 0         | 1) Constraint no longer active. 2) Effective EcoMax formula changes to reflect SE is no longer curtailed for 2 consecutive approved RTSCED cases. 3) Resource is dispatched up to SE MW, 110MW.                                                            |

**When previously curtailed\*** = Effective EcoMax = Max (SE, Forecast, Bid-in EcoMax)

**\*This formula will be in place for 2 consecutive non-curtailement period.**

- The current package proposes to effectively update the bid-in Economic Max value considered in RTSCED for Solar and Wind resources.
- No settlements changes were included in the package, which means bid-in Economic Max, rather than the Effective Economic Max will be used in settlements
- The bid-in Economic Max influences several key calculations in Operating Reserve Settlements
- The following slide illustrates impacts of continuing to use bid-in Economic Max in Settlements.

# Status Quo and Use of Eco Max in Operating Reserves

| Desired MW Type                    | Status Quo                                                                                                                                                                                                                        | Proposal (use of Effective Eco Max) absent any Settlement Changes                                                                                                                                                                                             | Impacts                                                                                                                                                          |
|------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Ramp-limited Desired (RLD)         | <p>Output level that a resource should have achieved <i>between</i> Dispatch Signals.</p> <p>The Dispatch Signal is a direct input.</p> <p>The calculated RLD is capped at bid-in Economic Max in Settlements.</p>                | <p>Because the dispatch signals are proposed to use the Effective Eco Max, the Effective Eco Max is inherently used in calculating the RLD MW.</p> <p>The RLD will continue to be capped at bid-in Economic Max in Settlements.</p>                           | <p>The cost of the MWs produced above bid-in Eco Max may not be compensated through make whole or LOC.</p> <p><i>This is the same as how it works today.</i></p> |
| Dispatch signal MW or Basepoint MW | <p>Output level requested via the dispatch basepoint bound by bid-in Eco Min and Eco Max. This value is issued by PJM's real-time dispatch tools.</p> <p>The Dispatch signal is capped at bid-in Economic Max in Settlements.</p> | <p>Because the dispatch signals are proposed to use the Effective Eco Max, the dispatch basepoint will be bound by the bid-in Eco Min and Effective Eco Max.</p> <p>The Dispatch signal will continue to be capped at bid-in Economic Max in Settlements.</p> | <p>The cost of the MWs produced above bid-in Eco Max may not be compensated through make whole or LOC.</p> <p><i>This is the same as how it works today.</i></p> |
| Dispatch LMP Desired               | <p>Output level based on the dispatch run LMP and the incremental offer curve. This value is not ramp limited.</p> <p>The Dispatch LMP Desired is capped at bid-in Economic Max in Settlements.</p>                               | <p>The Dispatch LMP Desired will continue to be capped at bid-in Economic Max in Settlements.</p>                                                                                                                                                             | <p>The cost of the MWs produced above bid-in Eco Max may not be compensated through make whole or LOC.</p> <p><i>This is the same as how it works today.</i></p> |

Any settlement impacts of the change to use Effective Eco Max in SCED can be minimized by updating the bid-in Economic Maximum to reflect real-time operating conditions.

Presenter/SME:

Vijay Shah, [Vijay.Shah@pjm.com](mailto:Vijay.Shah@pjm.com)

**MRC: Wind and Solar Dispatch in Real-Time Market Clearing Engines**



**Member Hotline**

(610) 666 – 8980


(866) 400 – 8980

[custsvc@pjm.com](mailto:custsvc@pjm.com)

**PROTECT THE  
POWER GRID**  
**THINK BEFORE  
YOU CLICK!**



**BE ALERT TO  
MALICIOUS PHISHING  
EMAILS**

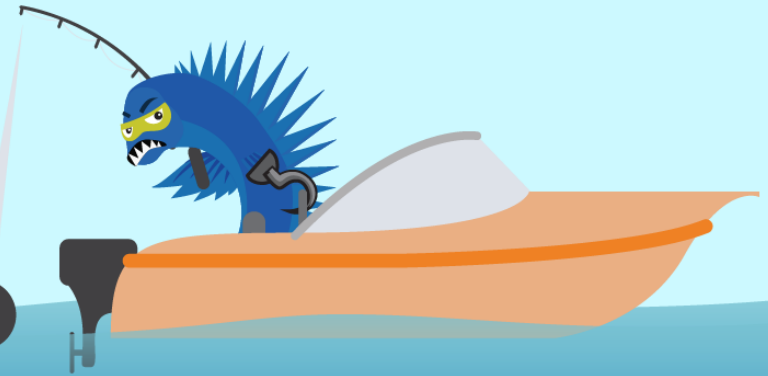

**Report suspicious email activity to PJM.**  
Call (610) 666-2244 or email [it\\_ops\\_ctr\\_shift@pjm.com](mailto:it_ops_ctr_shift@pjm.com)