

PJM Manual 21B: Periodic Review


Josh Bruno
Resource Adequacy Planning
Planning Committee
August 4, 2026

Disclaimer: While materials are current at the time of publishing, applicable requirements may change. PJM Governing Documents control.

- Cover to Cover Periodic Review
- Administrative Updates: Spelling Errors, Section References, etc.
- Added clarifying language to ICAP definition
- Clarified testing rules around ambient conditions, simultaneous requirements, and specified submission deadlines
- Added Appendix A to codify existing test data requirements
- Clarified that additional data can be gathered to facilitate ELCC analysis in Section 9
- Updated Performance Adjustment section for DER calculation

Revision	Redline	Reason
Clarifying language to ICAP definition	This is also referred to as the "rated capability" or "rated ICAP." Rated capability or rated ICAP is determined by adjusting the generators capability for generator site conditions coincident with the dates and times of the last 15 years PJM summer peaks (also known as summer conditions) and all generating units at a plant must be rated for simultaneous operation.	Transferring explicit requirement that was previously approved in M21 Section 1.4.4
Testing rules around ambient conditions	Multiple changes specifying: tests must should be conducted when the observed generator site...	Ensure applicability of the requirement by removing ambiguity due to nomenclature
Simultaneous Testing	Net Capability of multiple generating units that are connected behind a single revenue meter and have CIRs issued based on that single revenue meter, must be determined by the simultaneous testing of all generating units behind a single revenue meter for the aforementioned durations.	Transferring explicit requirement that was previously approved in M21 Section 1.3.5 (1)
Appendix A	Please see Appendix A in posted material for full redlines	Memorializing status quo in the manual (previously in a FAQ doc cited in M21B) to facilitate the calculation of the data fields submitted to PJM to ensure application of various rules spread throughout other manuals

Review/Endorsement Timeline

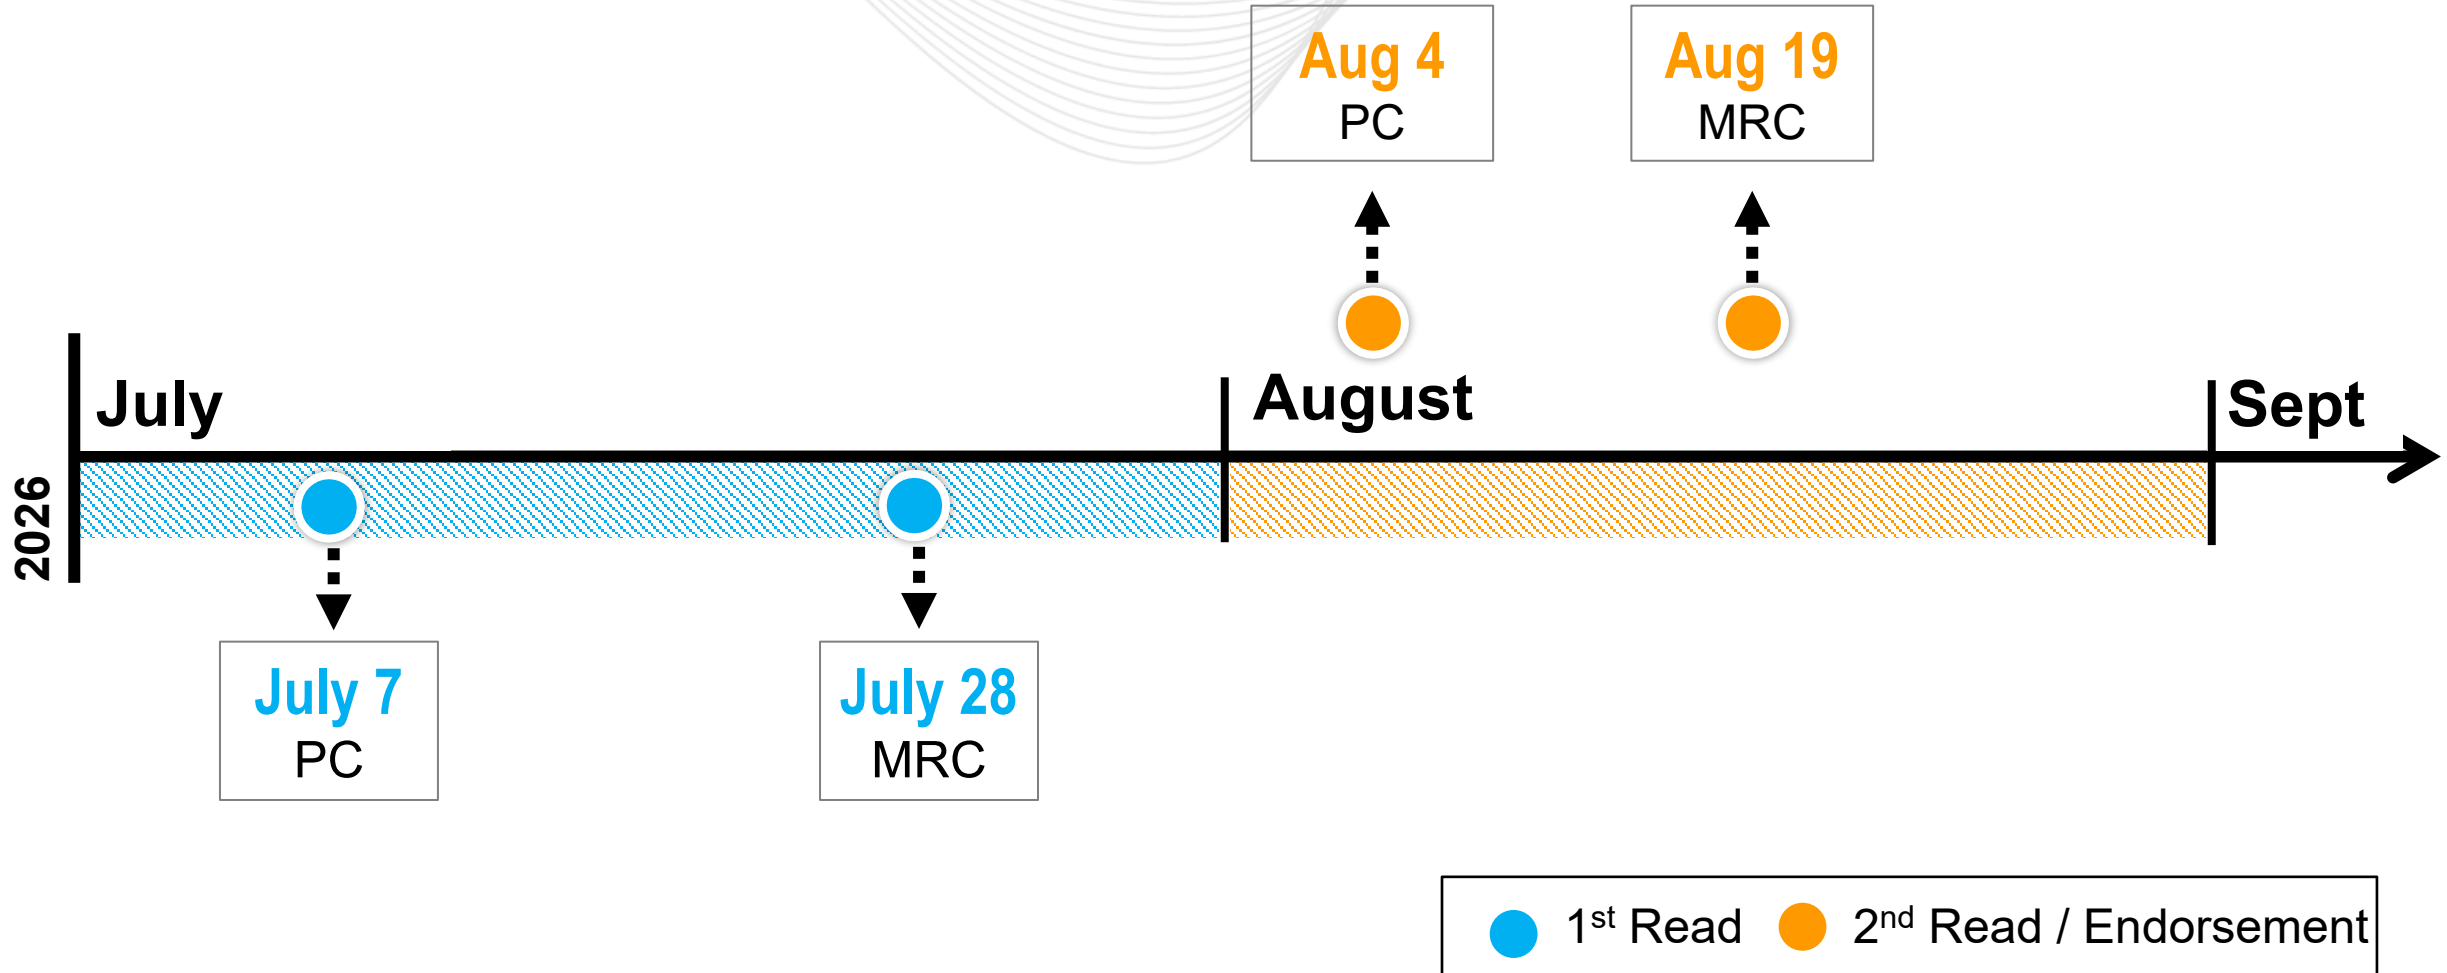

SME/Presenter:
Josh Bruno,
Joshua.Bruno@pjm.com

PJM Manual 21B: Periodic Review



Member Hotline

(610) 666 – 8980


(866) 400 – 8980

custsvc@pjm.com

**PROTECT THE
POWER GRID**
**THINK BEFORE
YOU CLICK!**



**BE ALERT TO
MALICIOUS PHISHING
EMAILS**

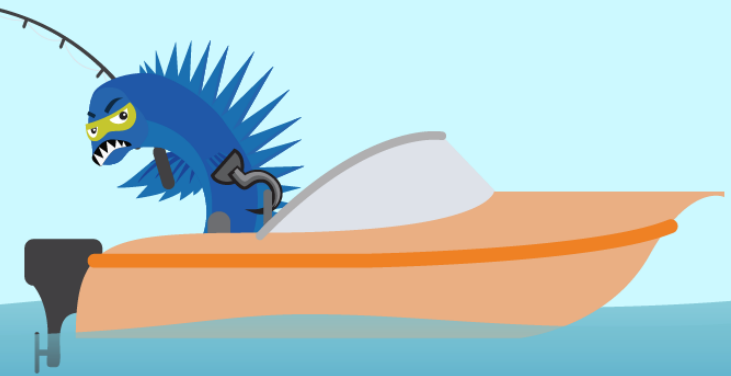

Report suspicious email activity to PJM.
Call (610) 666-2244 or email it_ops_ctr_shift@pjm.com