



# SRRTEP - Western Committee ComEd Supplemental Projects

January 17, 2025

# Needs

Stakeholders must submit any comments within 10 days of this meeting in order to provide time necessary to consider these comments prior to the next phase of the M-3 process

# ComEd Transmission Zone M-3 Process 138 kV L10301 Wavetrapp at Lombard

**Need Number:** ComEd-2025-001

**Process Stage:** Need Meeting 1/17/2025

**Project Driver:**


Equipment Material Condition, Performance and Risk

**Specific Assumption Reference:**

- Transmission infrastructure replacements (EOL/condition/obsolescence) that are consistent with efficient asset management decisions

**Problem Statement:**

The 138 kV 1200 A, 36kA L10301 wavetrapp at Lombard is over its rated fault current.

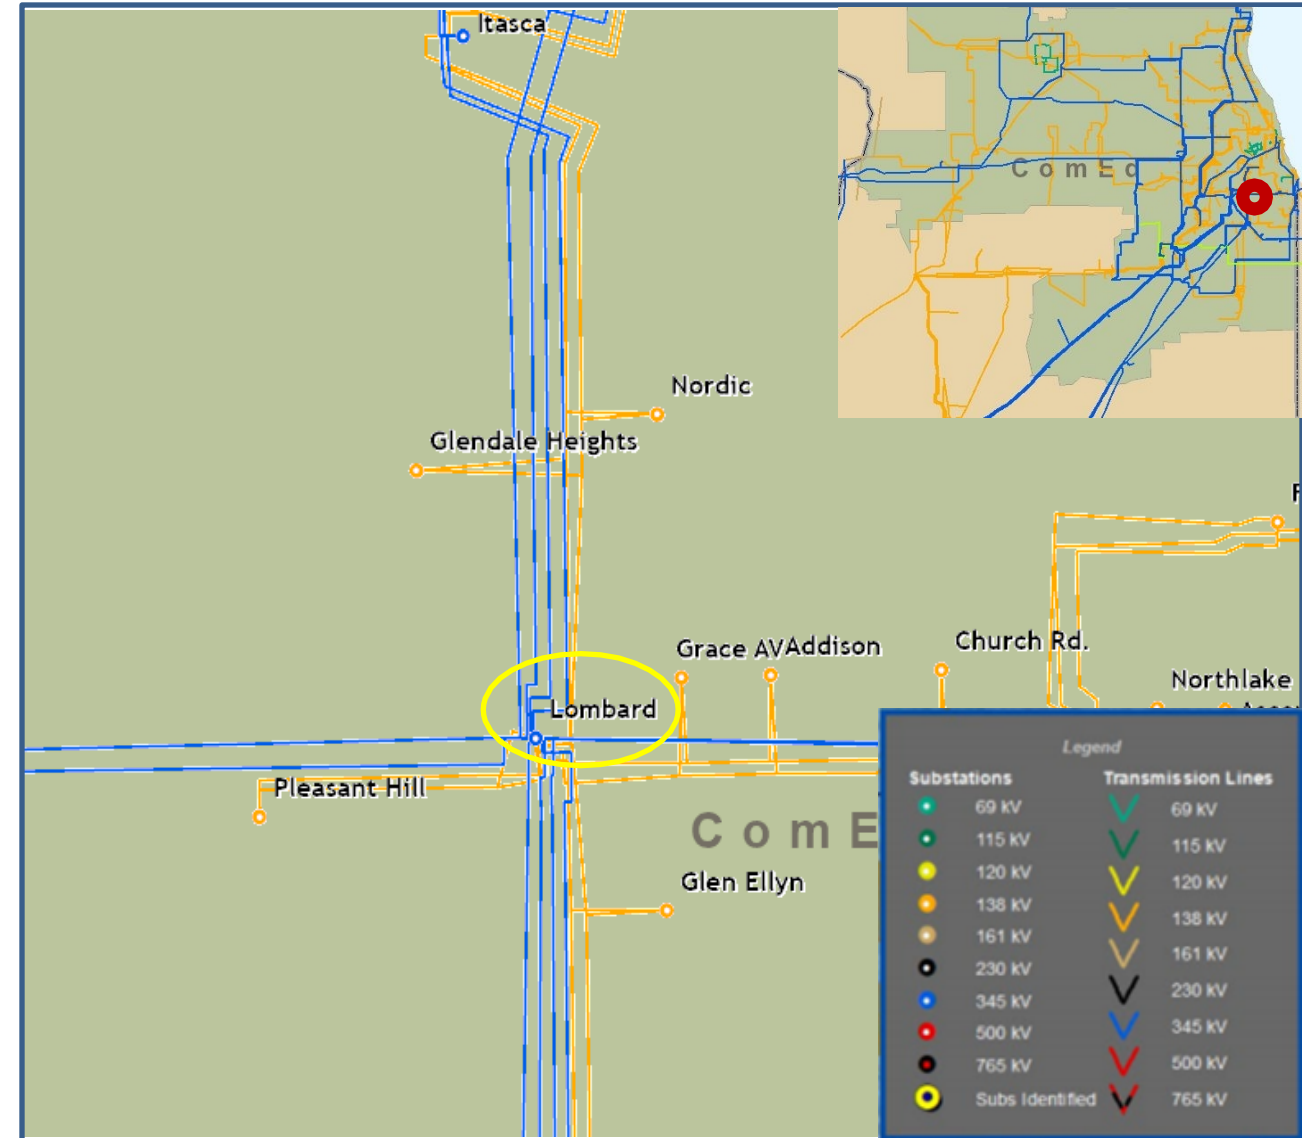

# ComEd Transmission Zone M-3 Process 138 kV L10302 Wavetrapp at Lombard

**Need Number:** ComEd-2025-002

**Process Stage:** Need Meeting 1/17/2025

**Project Driver:**


Equipment Material Condition, Performance and Risk

**Specific Assumption Reference:**

- Transmission infrastructure replacements (EOL/condition/obsolescence) that are consistent with efficient asset management decisions

**Problem Statement:**

The 138 kV 1200 A, 36kA L10302 wavetrapp at Lombard is over its rated fault current.

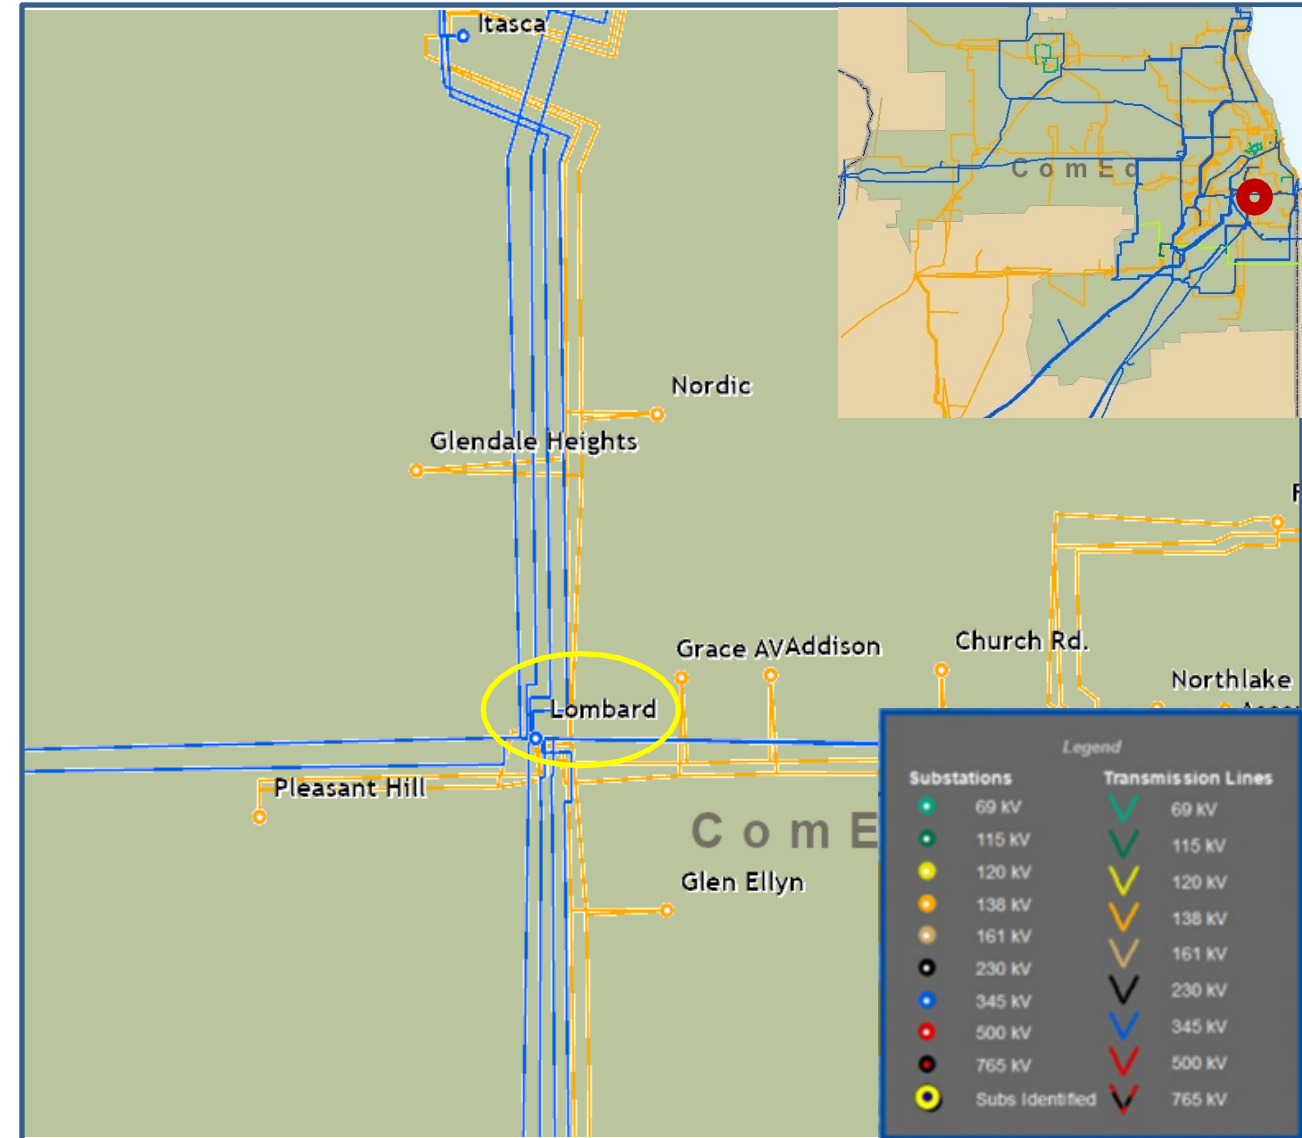

# Appendix

# High Level M-3 Meeting Schedule

## Assumptions

Activity	Timing
Posting of TO Assumptions Meeting information	20 days before Assumptions Meeting
Stakeholder comments	10 days after Assumptions Meeting

## Needs

Activity	Timing
TOs and Stakeholders Post Needs Meeting slides	10 days before Needs Meeting
Stakeholder comments	10 days after Needs Meeting

## Solutions

Activity	Timing
TOs and Stakeholders Post Solutions Meeting slides	10 days before Solutions Meeting
Stakeholder comments	10 days after Solutions Meeting

## Submission of Supplemental Projects & Local Plan

Activity	Timing
Do No Harm (DNH) analysis for selected solution	Prior to posting selected solution
Post selected solution(s)	Following completion of DNH analysis
Stakeholder comments	10 days prior to Local Plan Submission for integration into RTEP
Local Plan submitted to PJM for integration into RTEP	Following review and consideration of comments received after posting of selected solutions

# Revision History

1/7/2025 – V1 – Original version posted to pjm.com