


Reliability Analysis Update

Matthew Wharton
Manager, Transmission Planning – MAAC / South

Transmission Expansion Advisory Committee
August 5, 2025

2025 RTEP Window 1 Update

2025 RTEP Window 1 – Timeline

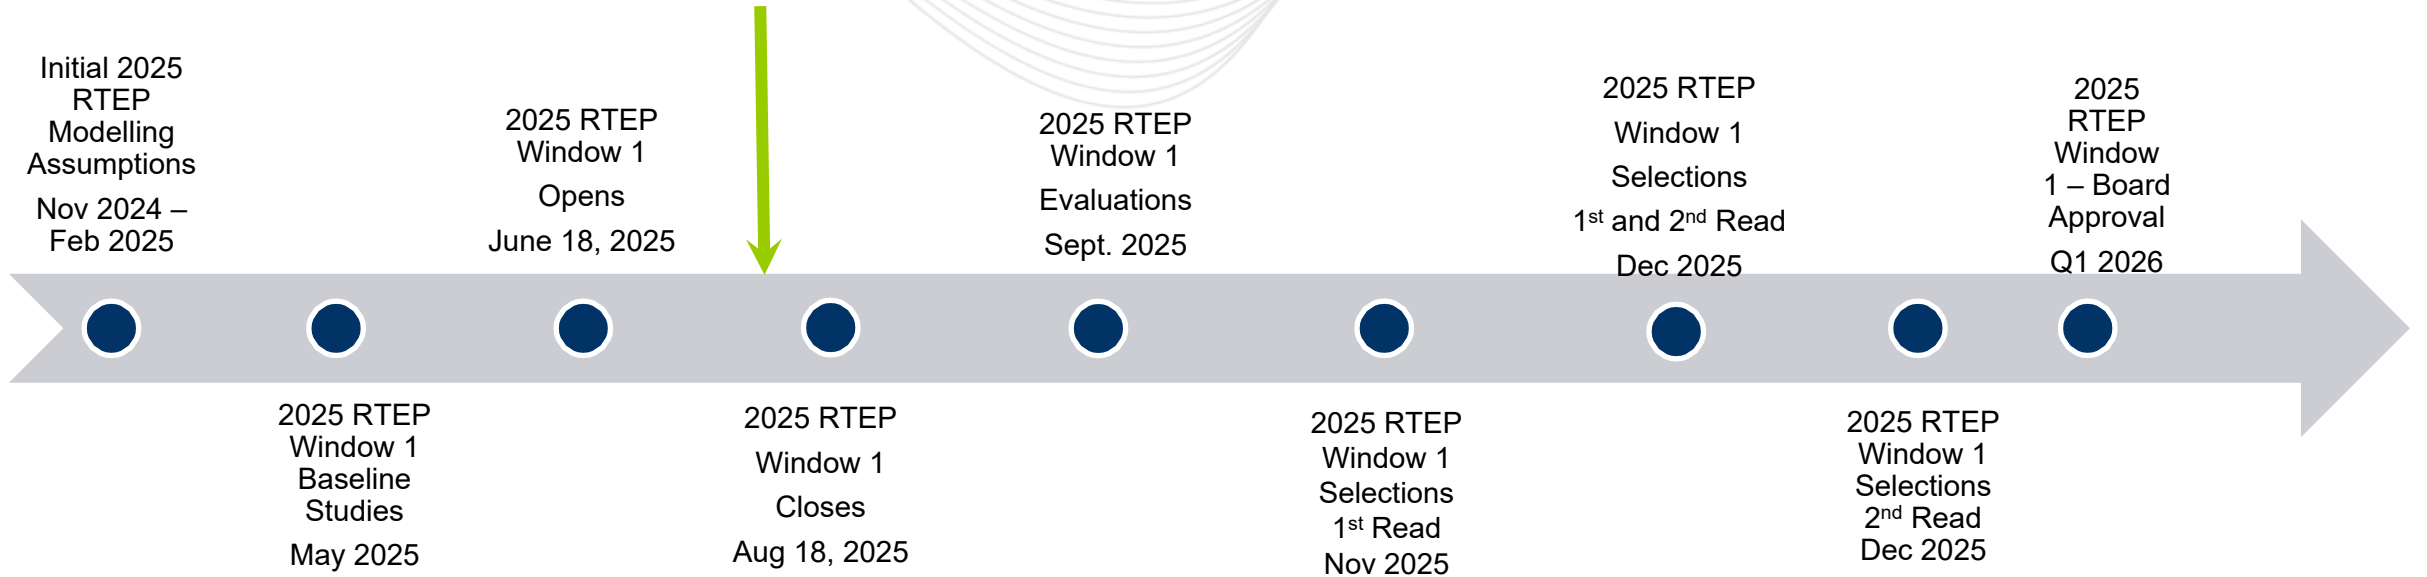

Baseline Reliability Projects Changes to Previously Approved Projects


B4000.200 was presented on 1/7/2025

Scope: Broadford 765 kV Upgrade: Replace Jackson's Ferry
CB Q2 (B4000.200)

Estimated Cost: \$4.5 M

Required IS Date : 6/1/2029

Reason for Cancellation: Rating error in the study for the
breaker. With corrected ratings, the project is not needed.

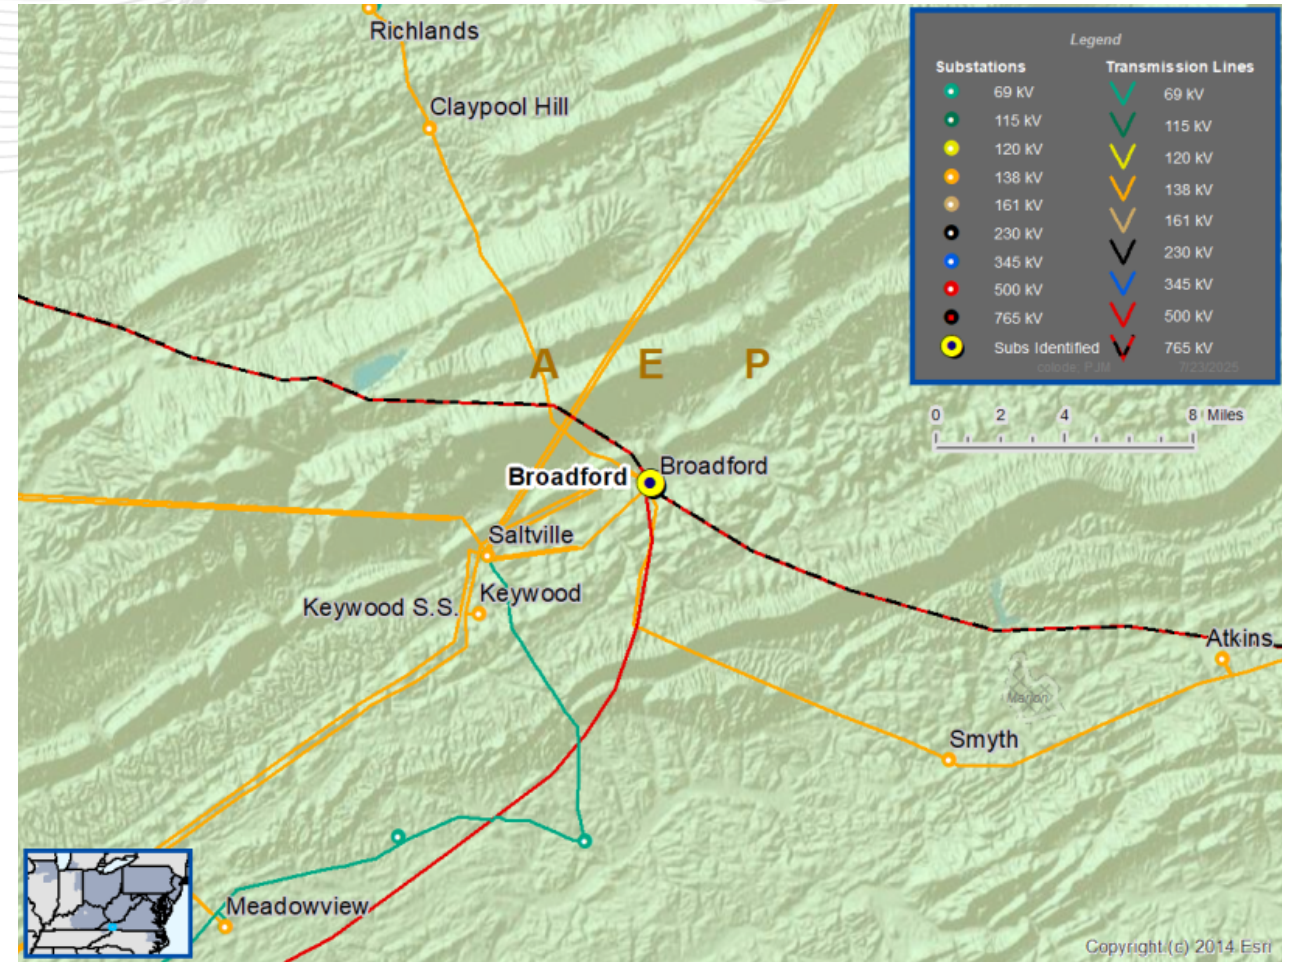

Facilitator:
Eric Hsia,
Eric.Hsia@pjm.com

Secretary:
Joshua Stephenson,
Joshua.Stephenson@pjm.com

SME/Presenter:
Matthew Wharton,
Matthew.Wharton@pjm.com

Reliability Analysis Update



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com

Version No.	Date	Description
1	7/31/2025	Initial slides posted

**PROTECT THE
POWER GRID
THINK BEFORE
YOU CLICK!**



Be alert to
malicious
phishing emails.

Report suspicious email activity to PJM.
(610) 666-2244 / it_ops_ctr_shift@pjm.com

