

Transmission Expansion Advisory Committee Supplemental Projects

PPL Transmission Zone

Needs

Stakeholders must submit any comments within 10 days of this meeting in order to provide time necessary to consider these comments prior to the next phase of the M-3 process



PPL Transmission Zone: Supplemental Jerseytown, PA

Need Number: PPL-2026-0001

Process Stage: Need Meeting 03/10/2026

Project Driver: Customer Service

Specific Assumption References:

PPL 2026 Annual Assumptions


Problem Statement:

A customer has submitted a request to have their facility served from a 230kV source in Washingtonville, PA. The total facility load is approximately 1,500 MW (2032). The requested in-service date is 5/2028.

Initial In-Service 2028 Load: 200 MW

Projected 2029 Load: 550 MW

Projected 2031 Load: 1,200 MW

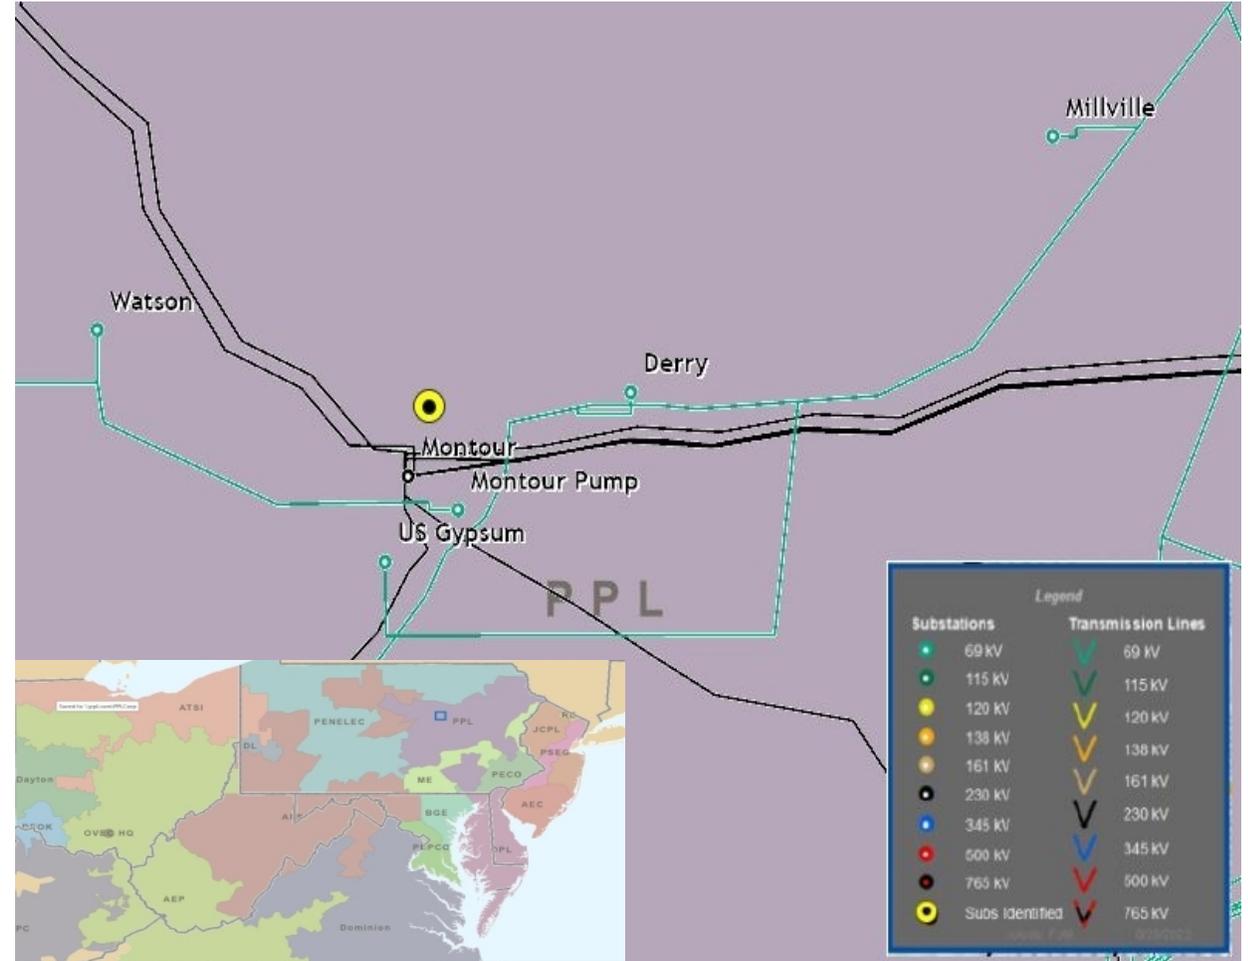



PPL Transmission Zone: Supplemental Callender Gap, PA

Need Number: PPL-2026-0002

Process Stage: Need Meeting 03/10/2026

Project Driver: Customer Service

Specific Assumption References:

PPL 2026 Annual Assumptions


Problem Statement:

A customer has submitted a request to have their facility served from a 230kV source in Archbald, PA. The total facility load is approximately 1,200 MW (2033). The requested in-service date is 5/2028.

Initial In-Service 2028 Load: 100 MW

Projected 2029 Load: 380 MW

Projected 2031 Load: 900 MW

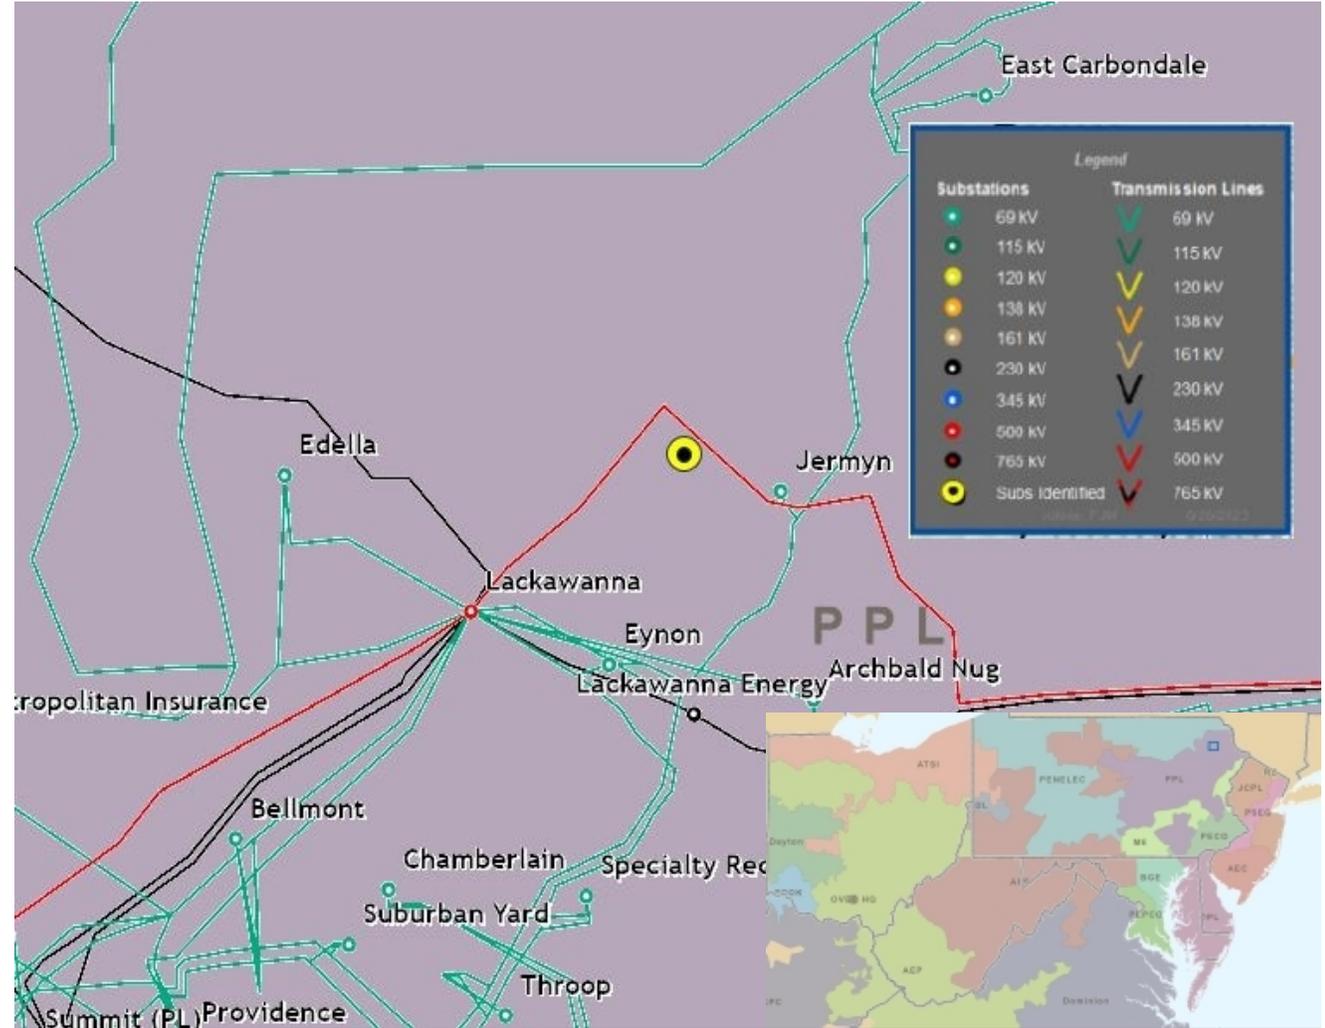



PPL Transmission Zone: Supplemental Beach Haven, PA

Need Number: PPL-2026-0003

Process Stage: Need Meeting 03/10/2026

Project Driver: Customer Service

Specific Assumption References:

PPL 2026 Annual Assumptions


Problem Statement:

A customer has submitted a request to have their facility served from a 230kV source in Berwick, PA. The total facility load is approximately 1,500 MW (2033). The requested in-service date is 5/2028.

Initial In-Service 2028 Load: 75 MW

Projected 2029 Load: 300 MW

Projected 2031 Load: 750 MW

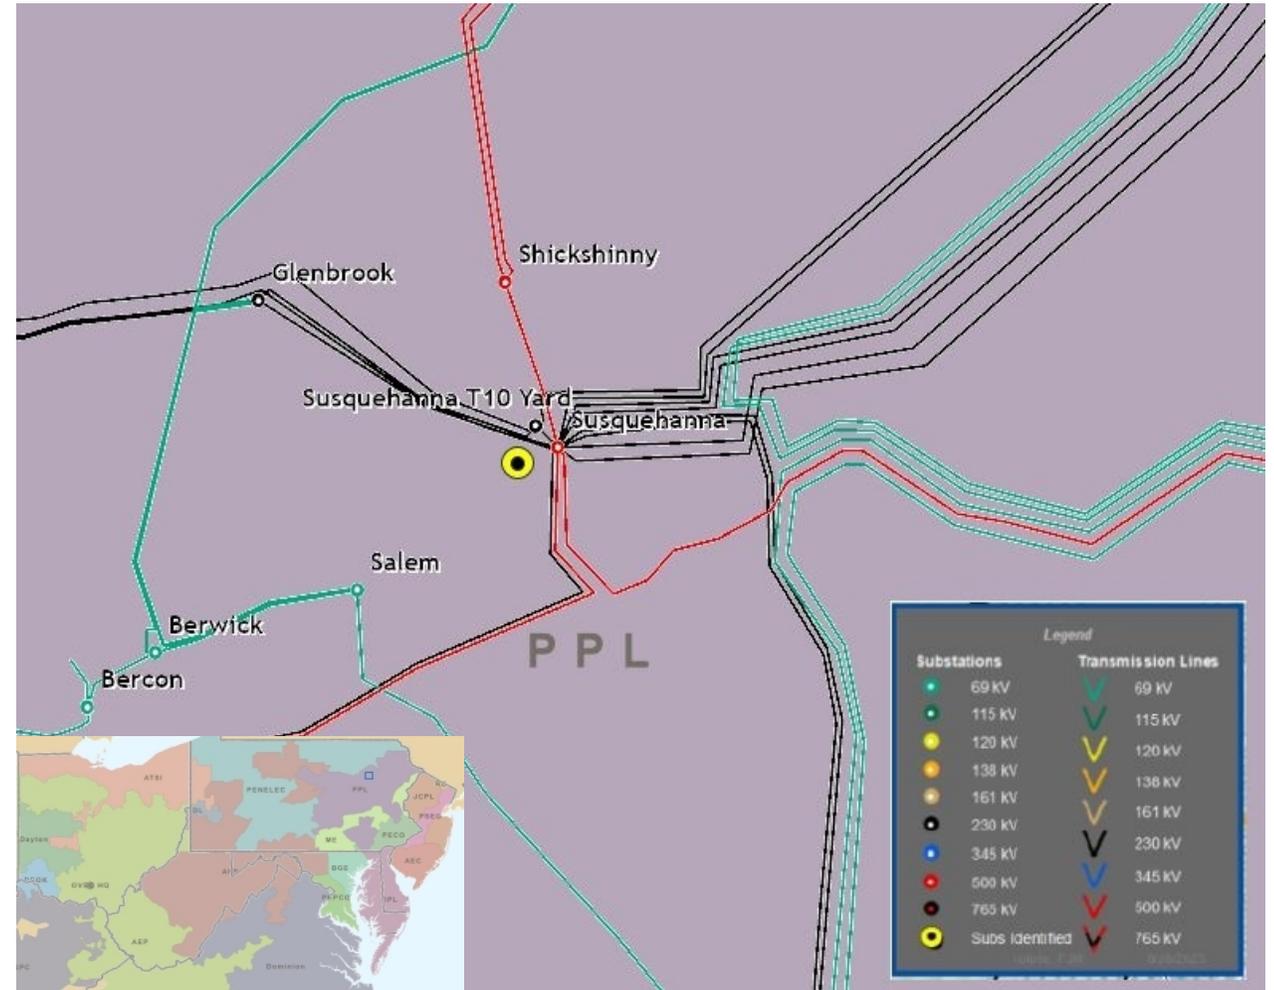



PPL Transmission Zone: Supplemental Nescopeck, PA

Need Number: PPL-2026-0004

Process Stage: Need Meeting 03/10/2026

Project Driver: Customer Service

Specific Assumption References:

PPL 2026 Annual Assumptions


Problem Statement:

A customer has submitted a request to have their facility served from a 230kV source in Nescopeck, PA. The total facility load is approximately 1,350 MW (2032). The requested in-service date is 10/2028.

Initial In-Service 2028 Load: 60 MW

Projected 2029 Load: 450 MW

Projected 2031 Load: 1,050 MW

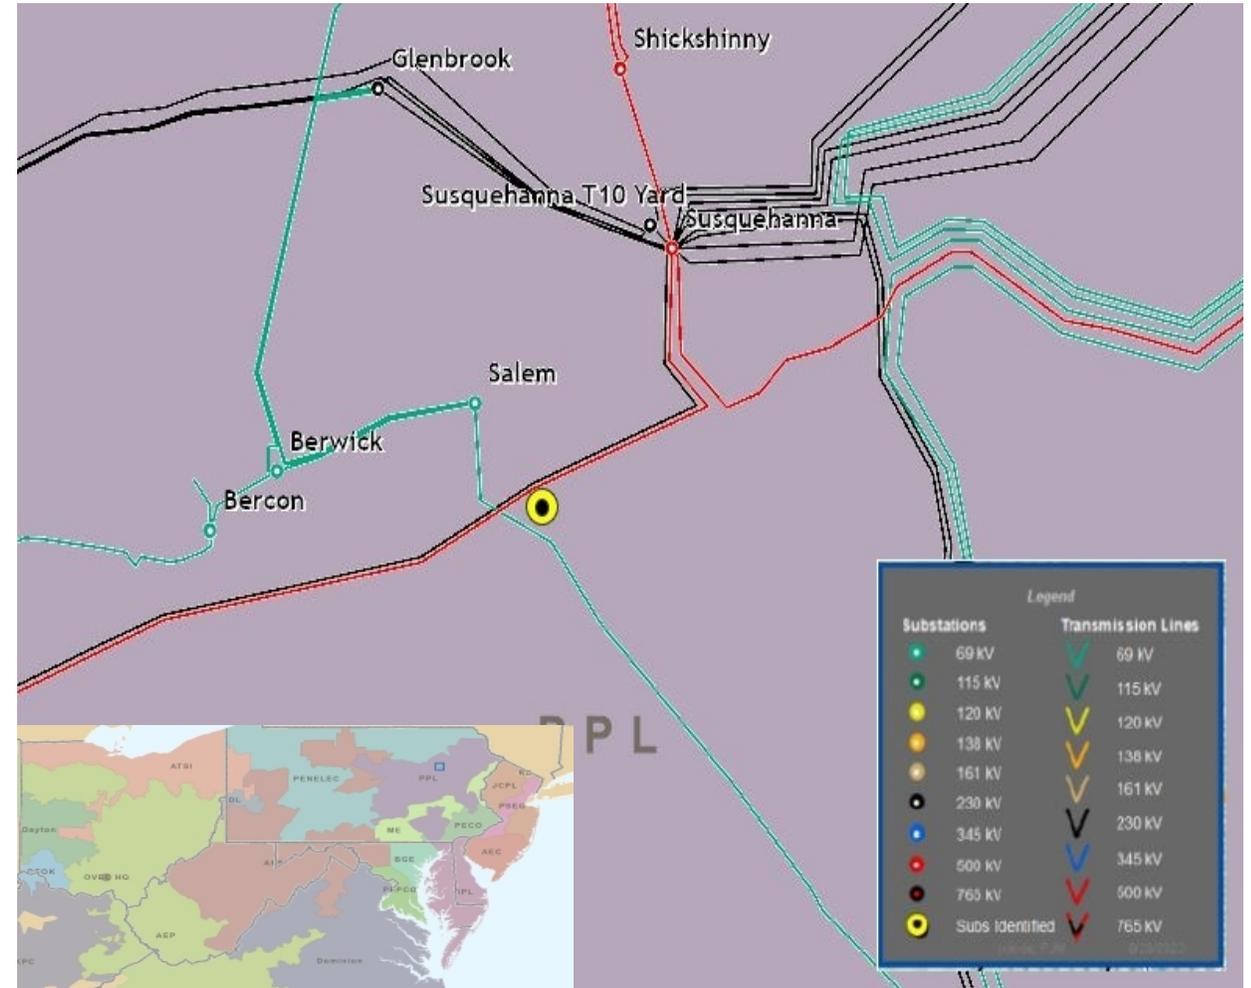

Revision History

2/27/2026 – V1 – Posted to pjm.com