



# Transmission Expansion Advisory Committee UGI Supplemental Projects

# Needs

Stakeholders must submit any comments within 10 days of this meeting in order to provide time necessary to consider these comments prior to the next phase of the M-3 process

**Need Number:** UGI-2026-0003

**Process Stage:** Need Meeting 06/02/2026


**Project Driver:** Customer Service

**Specific Assumption References:**

UGI 2026 Annual Assumptions

**Problem Statement:**

A customer located in Newport Township has requested service at 230kV to serve a total load of 500MW. The customer's requested in service date for an initial load of 250MW is Q3 of 2029 and an additional 250MW in Q1 of 2030.

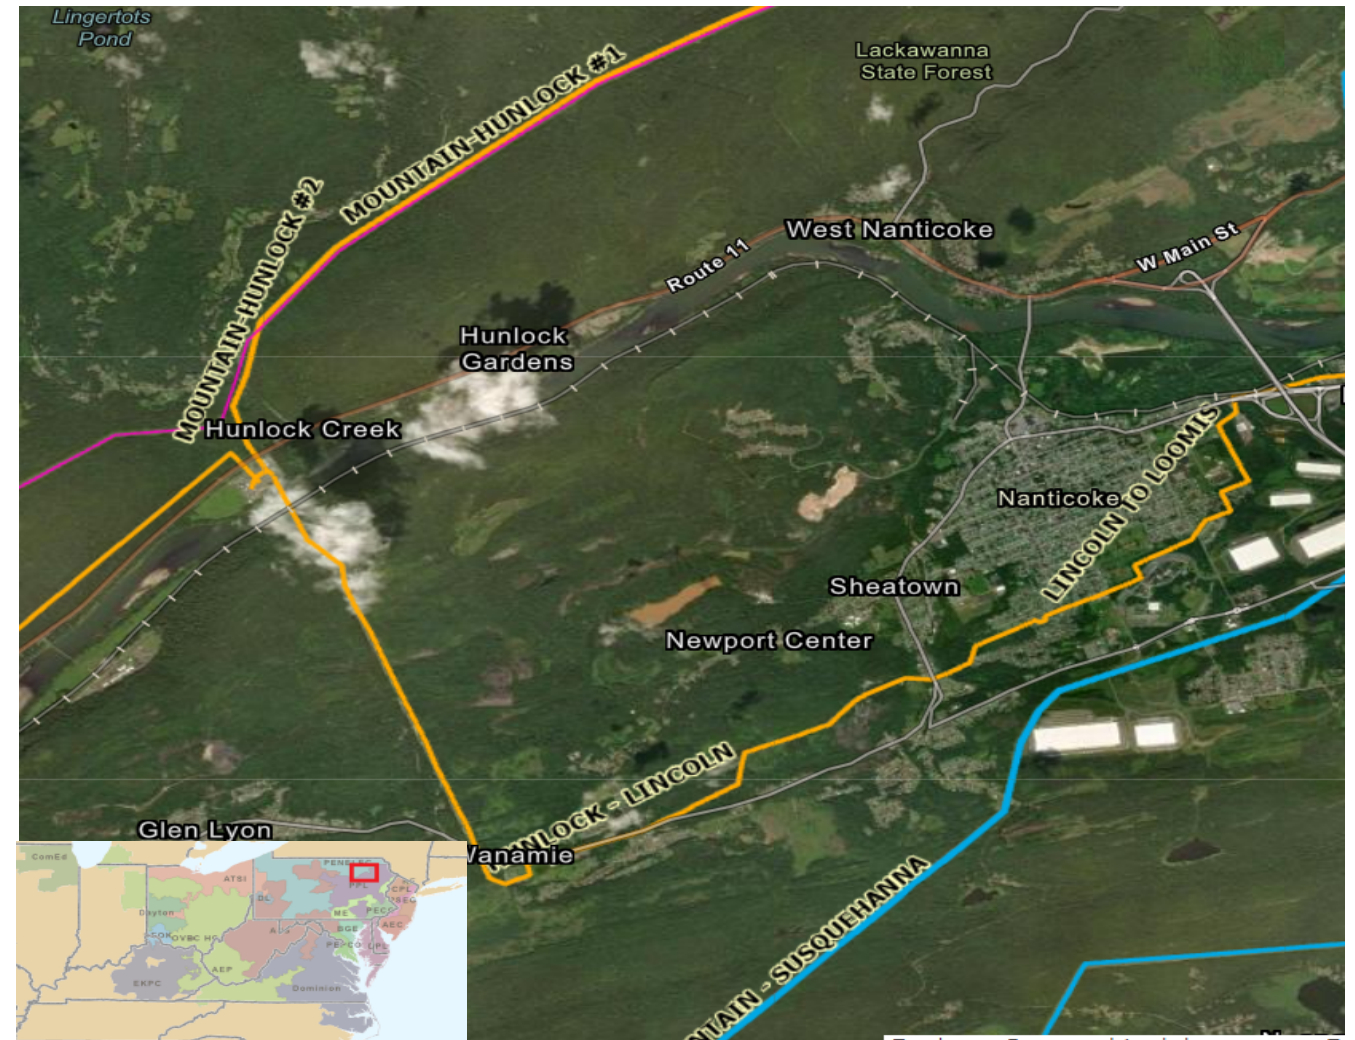

# Appendix

# High Level M-3 Meeting Schedule

| Assumptions                                      | Activity  | Timing  |
|--|---|---|
|  | Posting of TO Assumptions Meeting information         | 20 days before Assumptions Meeting  |
|  | Stakeholder comments                                  | 10 days after Assumptions Meeting   |
| Needs  | Activity  | Timing  |
|  | TOs and Stakeholders Post Needs Meeting slides        | 10 days before Needs Meeting  |
|  | Stakeholder comments                                  | 10 days after Needs Meeting   |
| Solutions  | Activity  | Timing  |
|  | TOs and Stakeholders Post Solutions Meeting slides    | 10 days before Solutions Meeting  |
|  | Stakeholder comments                                  | 10 days after Solutions Meeting   |
| Submission of Supplemental Projects & Local Plan | Activity  | Timing  |
|  | Do No Harm (DNH) analysis for selected solution       | Prior to posting selected solution  |
|  | Post selected solution(s)                             | Following completion of DNH analysis  |
|  | Stakeholder comments                                  | 10 days prior to Local Plan Submission for integration into RTEP                            |
|  | Local Plan submitted to PJM for integration into RTEP | Following review and consideration of comments received after posting of selected solutions |

# Revision History

5/22/2026 – V1 – Posted to pjm.com