EAST KENTUCKY POWER COOPERATIVE

A Touchstone Energy Cooperative

TEAC
EKPC Supplemental Projects

Dec. 1, 2026

Needs

Stakeholders must submit any comments within 10 days of this meeting in order to provide time necessary to consider these comments prior to the next phase of the M-3 process

EKPC Transmission Zone M-3 Process
Carroll County

Need Number: EKPC-2026-007

Process Stage: Need Meeting TEAC - 12/01/2026

Project Driver:

- *Customer Service*

Specific Assumption References:

EKPC Assumptions Presentation Slide 15

Problem Statement:

A new customer has requested transmission service in Carroll County, KY.


The initial load is expected to be 7 MW in 12/21/2028 with a load ramp schedule as follows:

170 MW by 6/2029

330 MW by 6/2030

620 MW by 6/2031

720 MW by 6/2032

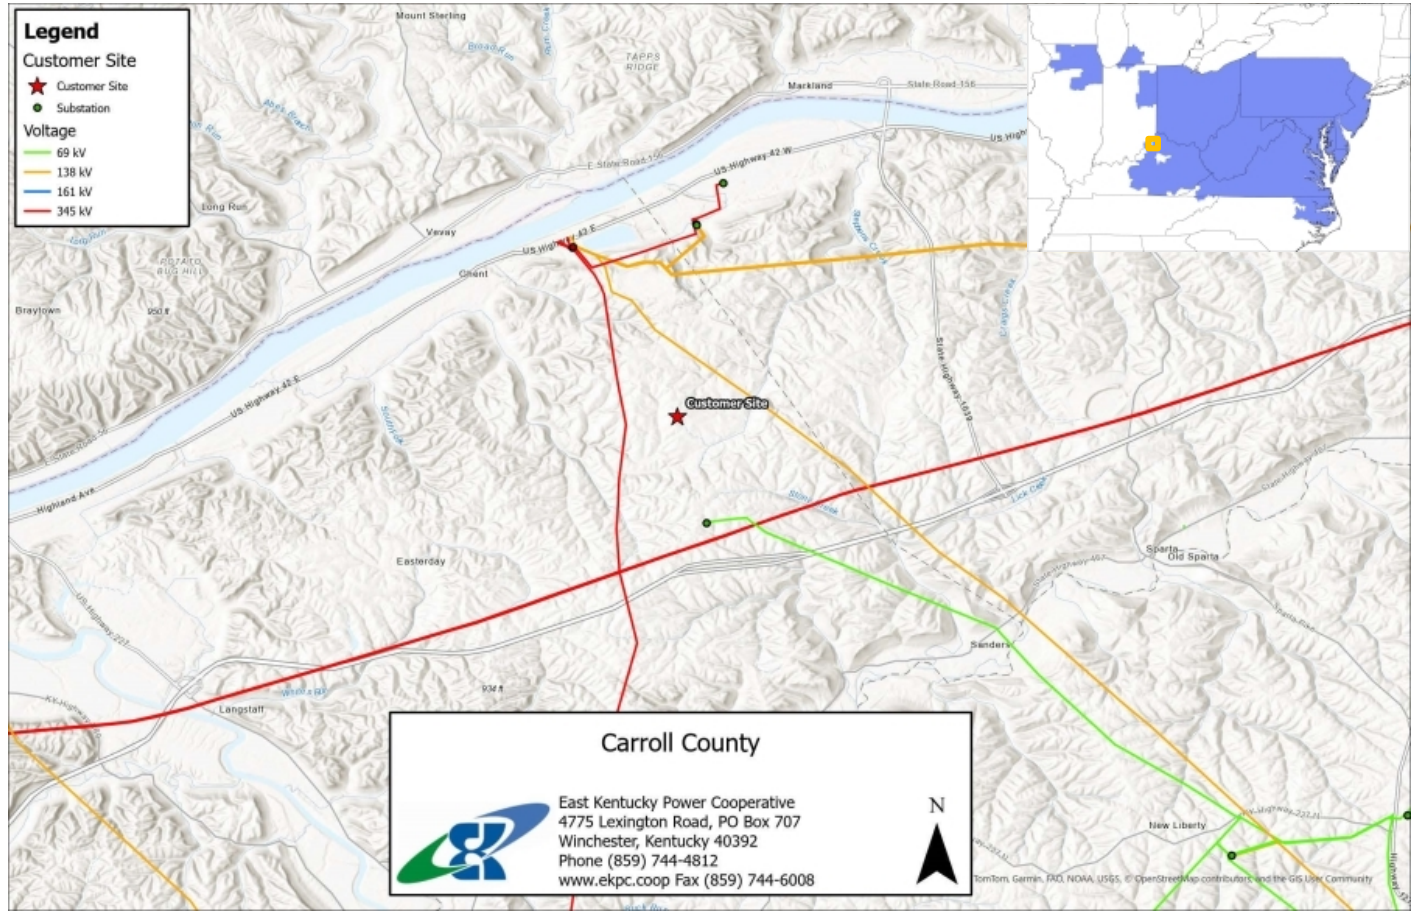

Appendix

High Level M-3 Meeting Schedule

Assumptions

Activity	Timing
Posting of TO Assumptions Meeting information	20 days before Assumptions Meeting
Stakeholder comments	10 days after Assumptions Meeting

Needs

Activity	Timing
TOs and Stakeholders Post Needs Meeting slides	10 days before Needs Meeting
Stakeholder comments	10 days after Needs Meeting

Solutions

Activity	Timing
TOs and Stakeholders Post Solutions Meeting slides	10 days before Solutions Meeting
Stakeholder comments	10 days after Solutions Meeting

Submission of Supplemental Projects & Local Plan

Activity	Timing
Do No Harm (DNH) analysis for selected solution	Prior to posting selected solution
Post selected solution(s)	Following completion of DNH analysis
Stakeholder comments	10 days prior to Local Plan Submission for integration into RTEP
Local Plan submitted to PJM for integration into RTEP	Following review and consideration of comments received after posting of selected solutions

Revision History

11/20/2026 – V1 – Original version posted to pjm.com