

# **Estimated Demand Response Activity June 23, 24, and 25, 2025**

**Demand Response Operations  
June 27, 2025**

- Load Management = Emergency DR + Pre-emergency DR
  - Capacity commitment and paid for load reduction when dispatched by PJM
  - Emergency DR = behind the meter generator with permit that requires an EEA2 to be issued in order to operate
  - Pre-Emergency DR = everything except Emergency DR
- Economic DR
  - Participates when economic for resource in energy and ancillary based on offer and availability
- 1 customer may participate as Load Management and Economic DR
  - Any overlap in dispatch is subject to Load Management rules



# Load Management Deploy and Release Times (No PAI events)

– June 23, 2025

- Mid-Atlantic/Dominion Zones

Notification Time	Deploy Time	Release Time	Resource Type	Lead Time	Zones
13:00	15:00	22:00	Pre-Emergency	Long_120	AECO, BGE, DOM, DPL, JCPL, METED, PECO, PENELEC, PEPCO, PPL, PSEG
14:00	15:00	22:00	Pre-Emergency	Short_60	AECO, BGE, DOM, DPL, JCPL, METED, PECO, PENELEC, PEPCO, PPL, PSEG

– June 24, 2025

- RTO wide

Notification Time	Deploy Time	Release Time	Resource Type	Lead Time	Zones
13:00	15:00	22:00	Pre-Emergency	Long_120	BGE, DOM, PECO, PEPCO
13:30	15:30	22:00	Pre-Emergency	Long_120	AECO, DPL, JCPL, METED, PENELEC, PPL, PSEG
14:00	16:00	22:00	Pre-Emergency	Long_120	AEP, APS, DAY, DUQ
14:30	16:30	22:00	Pre-Emergency	Long_120	ATSI, COMED, DEOK, EKPC
14:00	15:00	22:00	Pre-Emergency	Short_60	BGE, DOM, PECO, PEPCO
14:30	15:30	22:00	Pre-Emergency	Short_60	AECO, DPL, JCPL, METED, PENELEC, PPL, PSEG
15:00	16:00	22:00	Pre-Emergency	Short_60	AEP, APS, DAY, DUQ
15:30	16:30	22:00	Pre-Emergency	Short_60	ATSI, COMED, DEOK, EKPC




# Load Management Deploy and Release Times (No PAI events)

– June 25, 2025

## ■ Mid-Atlantic/Dominion/APS Zones


Notification Time	Deploy Time	Release Time	Resource Type	Lead Time	Zones
13:00	15:00	17:45	Pre-Emergency	Long_120	APS
13:00	15:00	18:10	Pre-Emergency	Long_120	AECO, BGE, DPL, JCPL, METED, PECO, PENELEC, PEPCO, PPL, PSEG
13:00	15:00	19:00	Pre-Emergency	Long_120	DOM
14:00	15:00	17:45	Pre-Emergency	Short_60	APS
14:00	15:00	18:10	Pre-Emergency	Short_60	AECO, BGE, DPL, JCPL, METED, PECO, PENELEC, PEPCO, PPL, PSEG
14:00	15:00	19:00	Pre-Emergency	Short_60	DOM

# Dispatched Demand Response in PJM: June 23, 2025

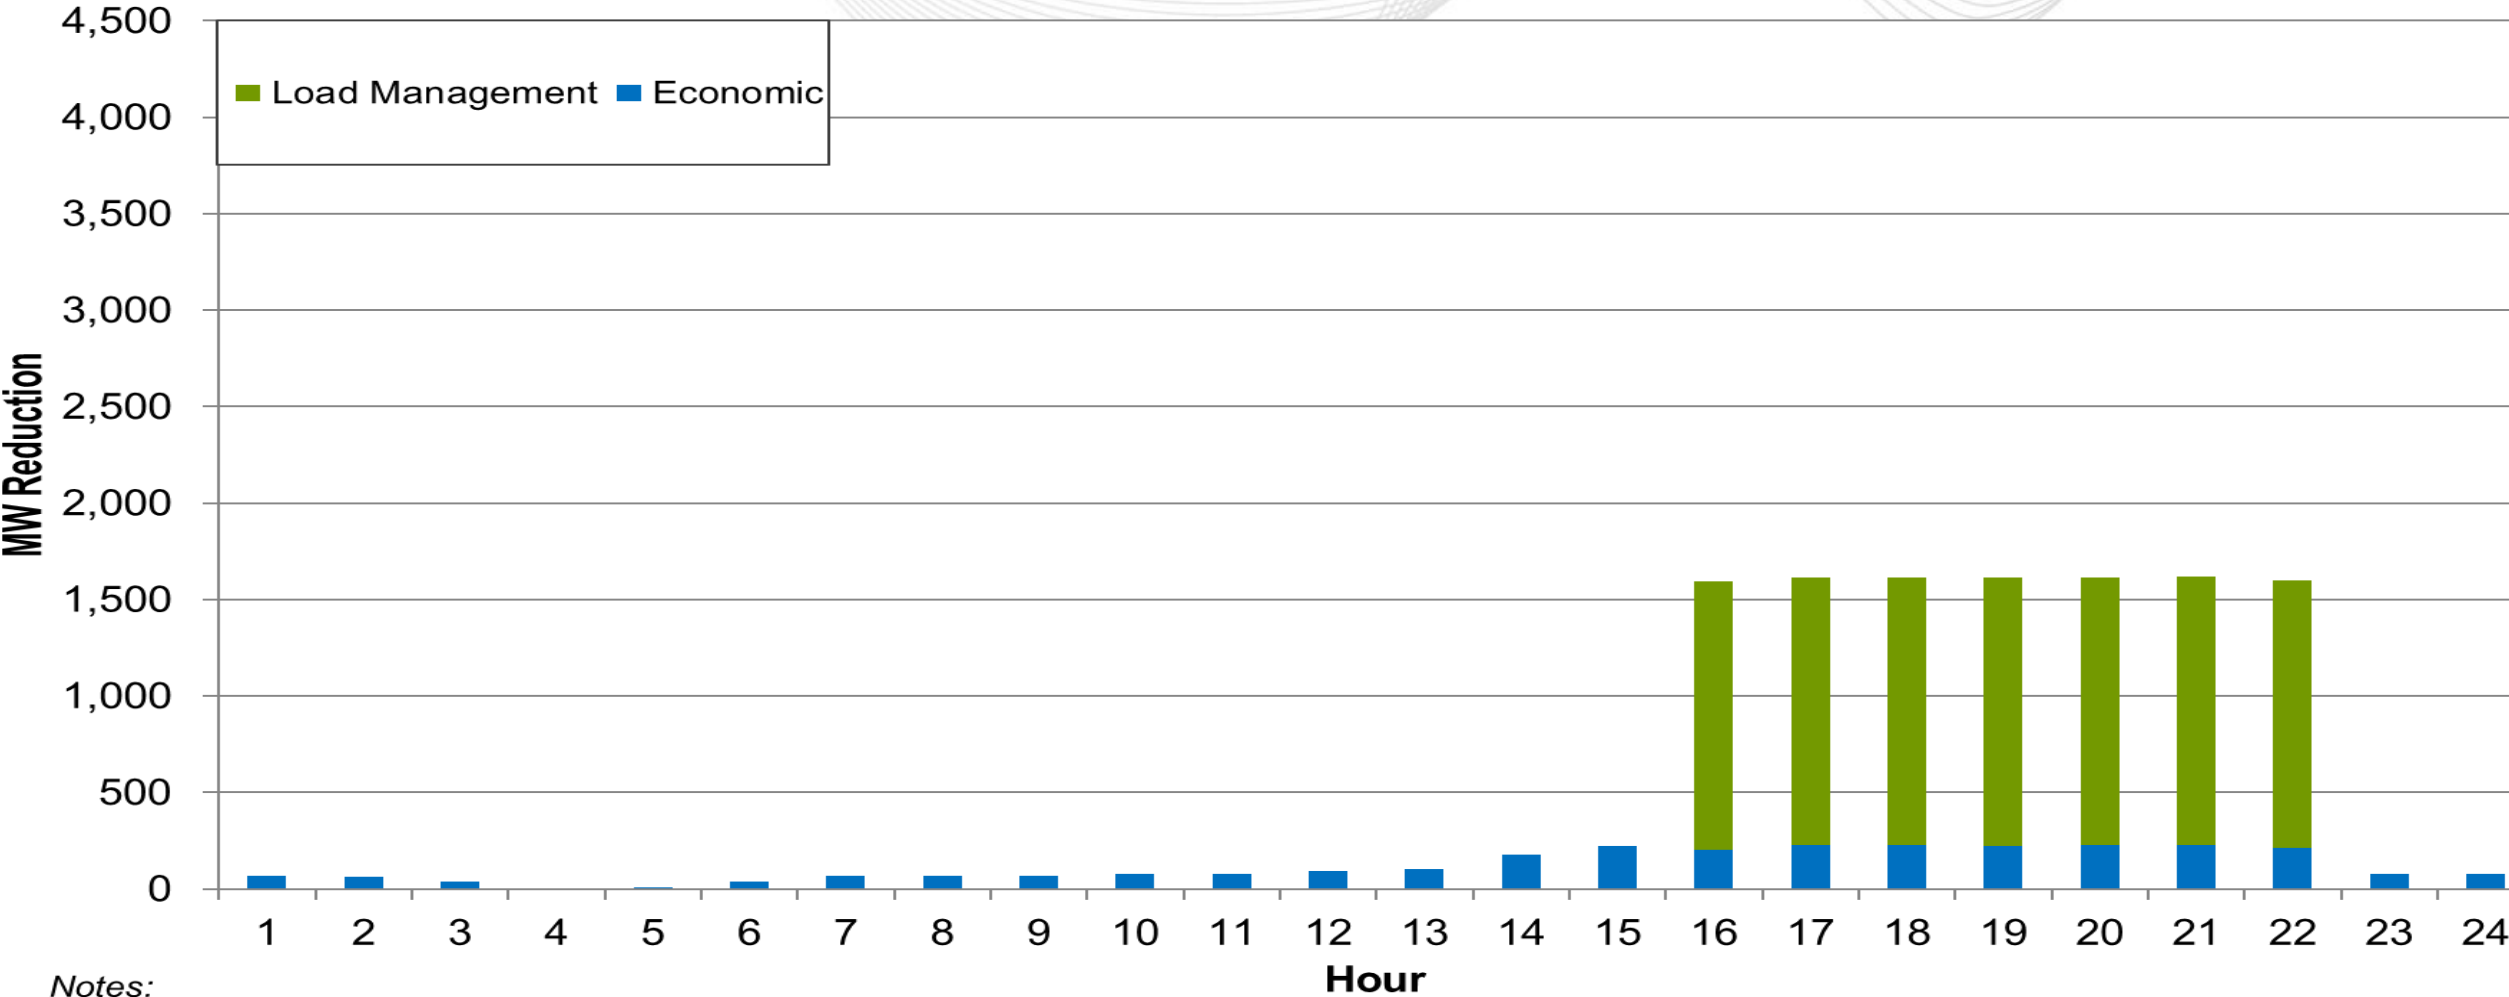


Notes:  
 Load Management values are based on nominated capacity commitment (ICAP). This may be different from actual real time hourly energy reductions.  
 Actual load reductions are not finalized until up to 3 months after event.

# Dispatched Demand Response in PJM: June 24, 2025

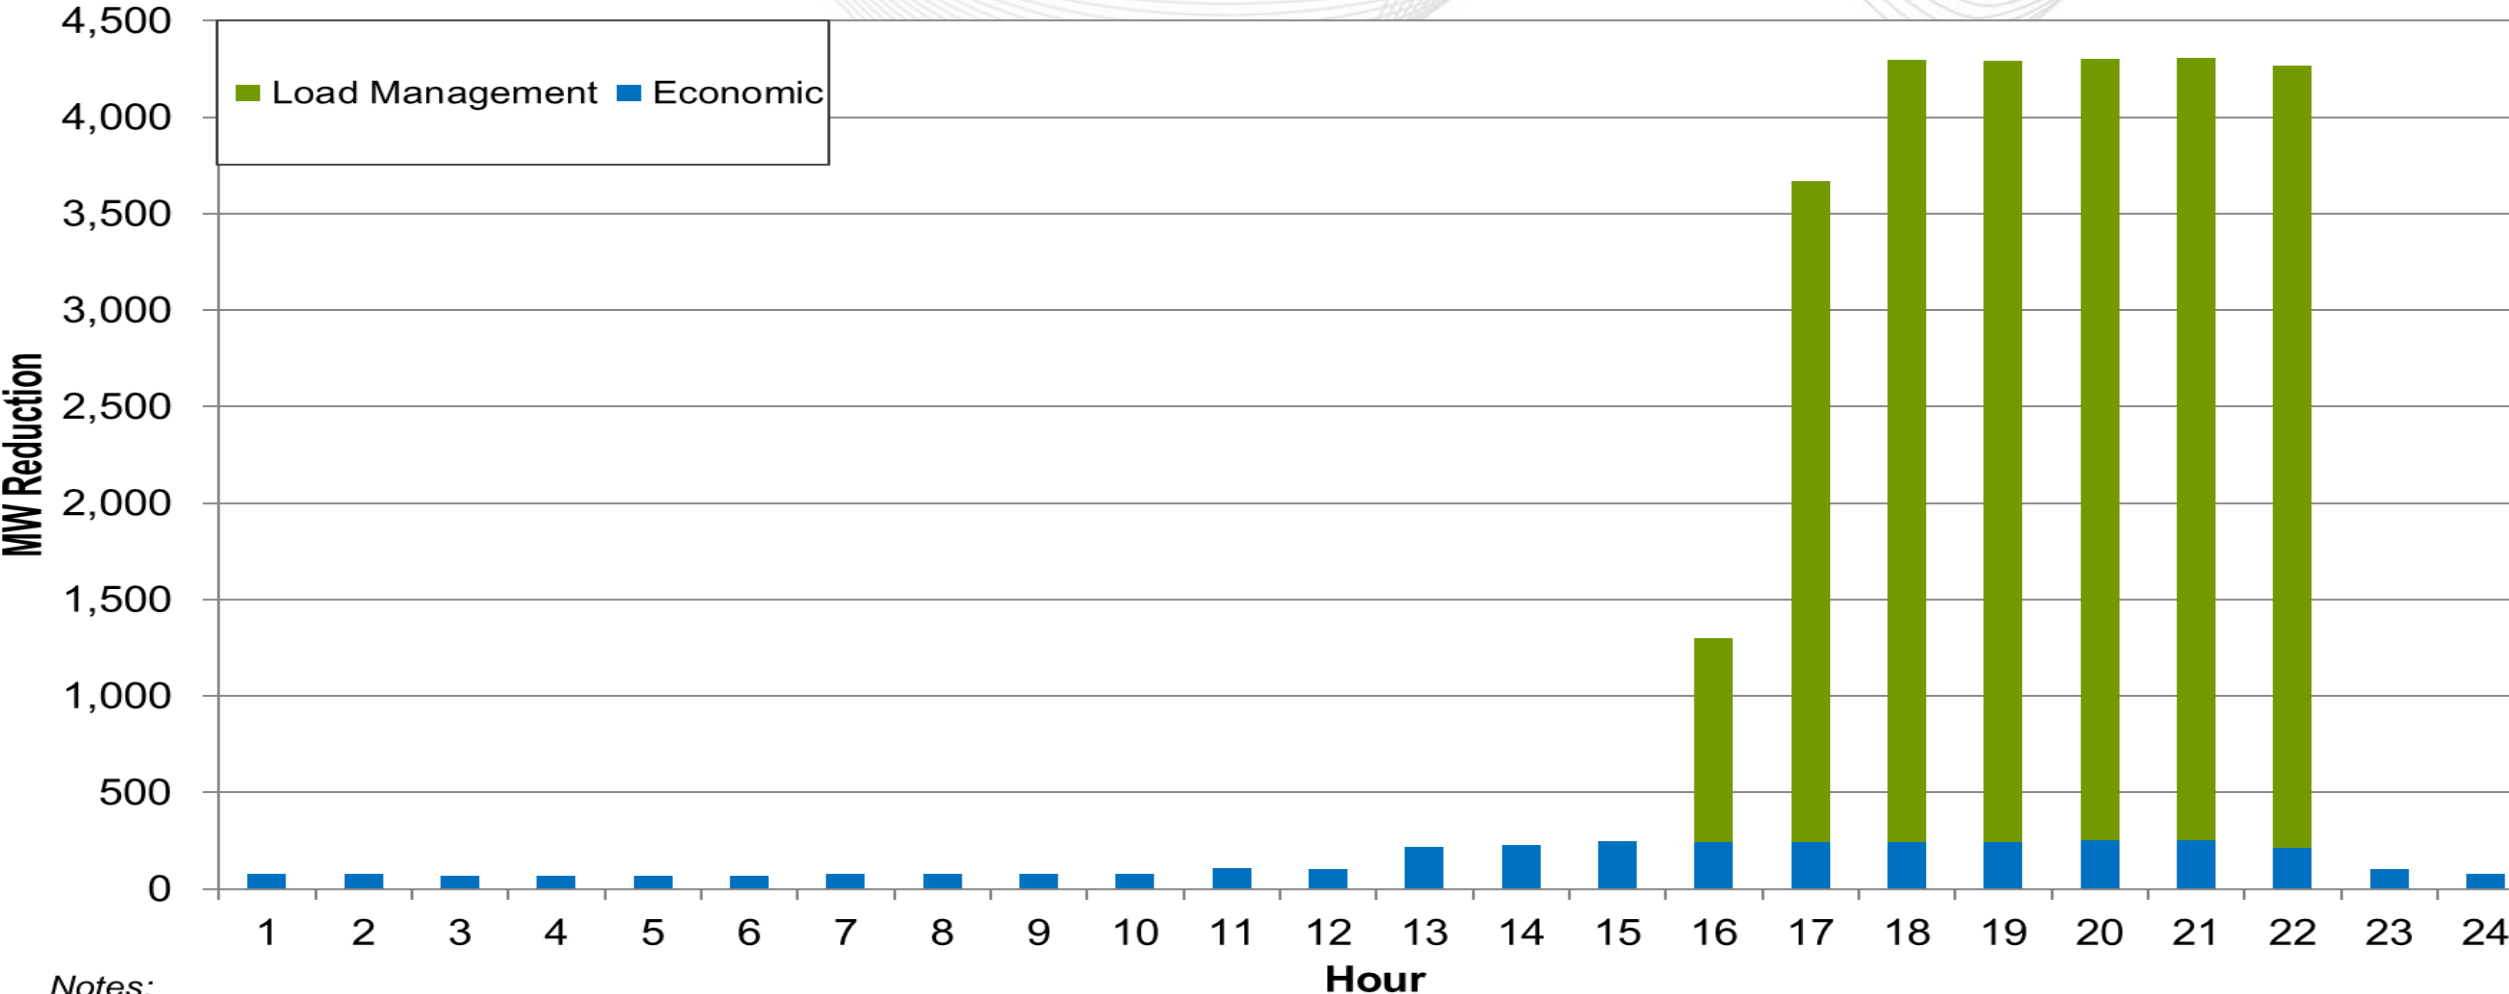

**Notes:**  
 Load Management values are based on nominated capacity commitment (ICAP). This may be different from actual real time hourly energy reductions.  
 Actual load reductions are not finalized until up to 3 months after event.

## Dispatched Demand Response in PJM: June 25, 2025

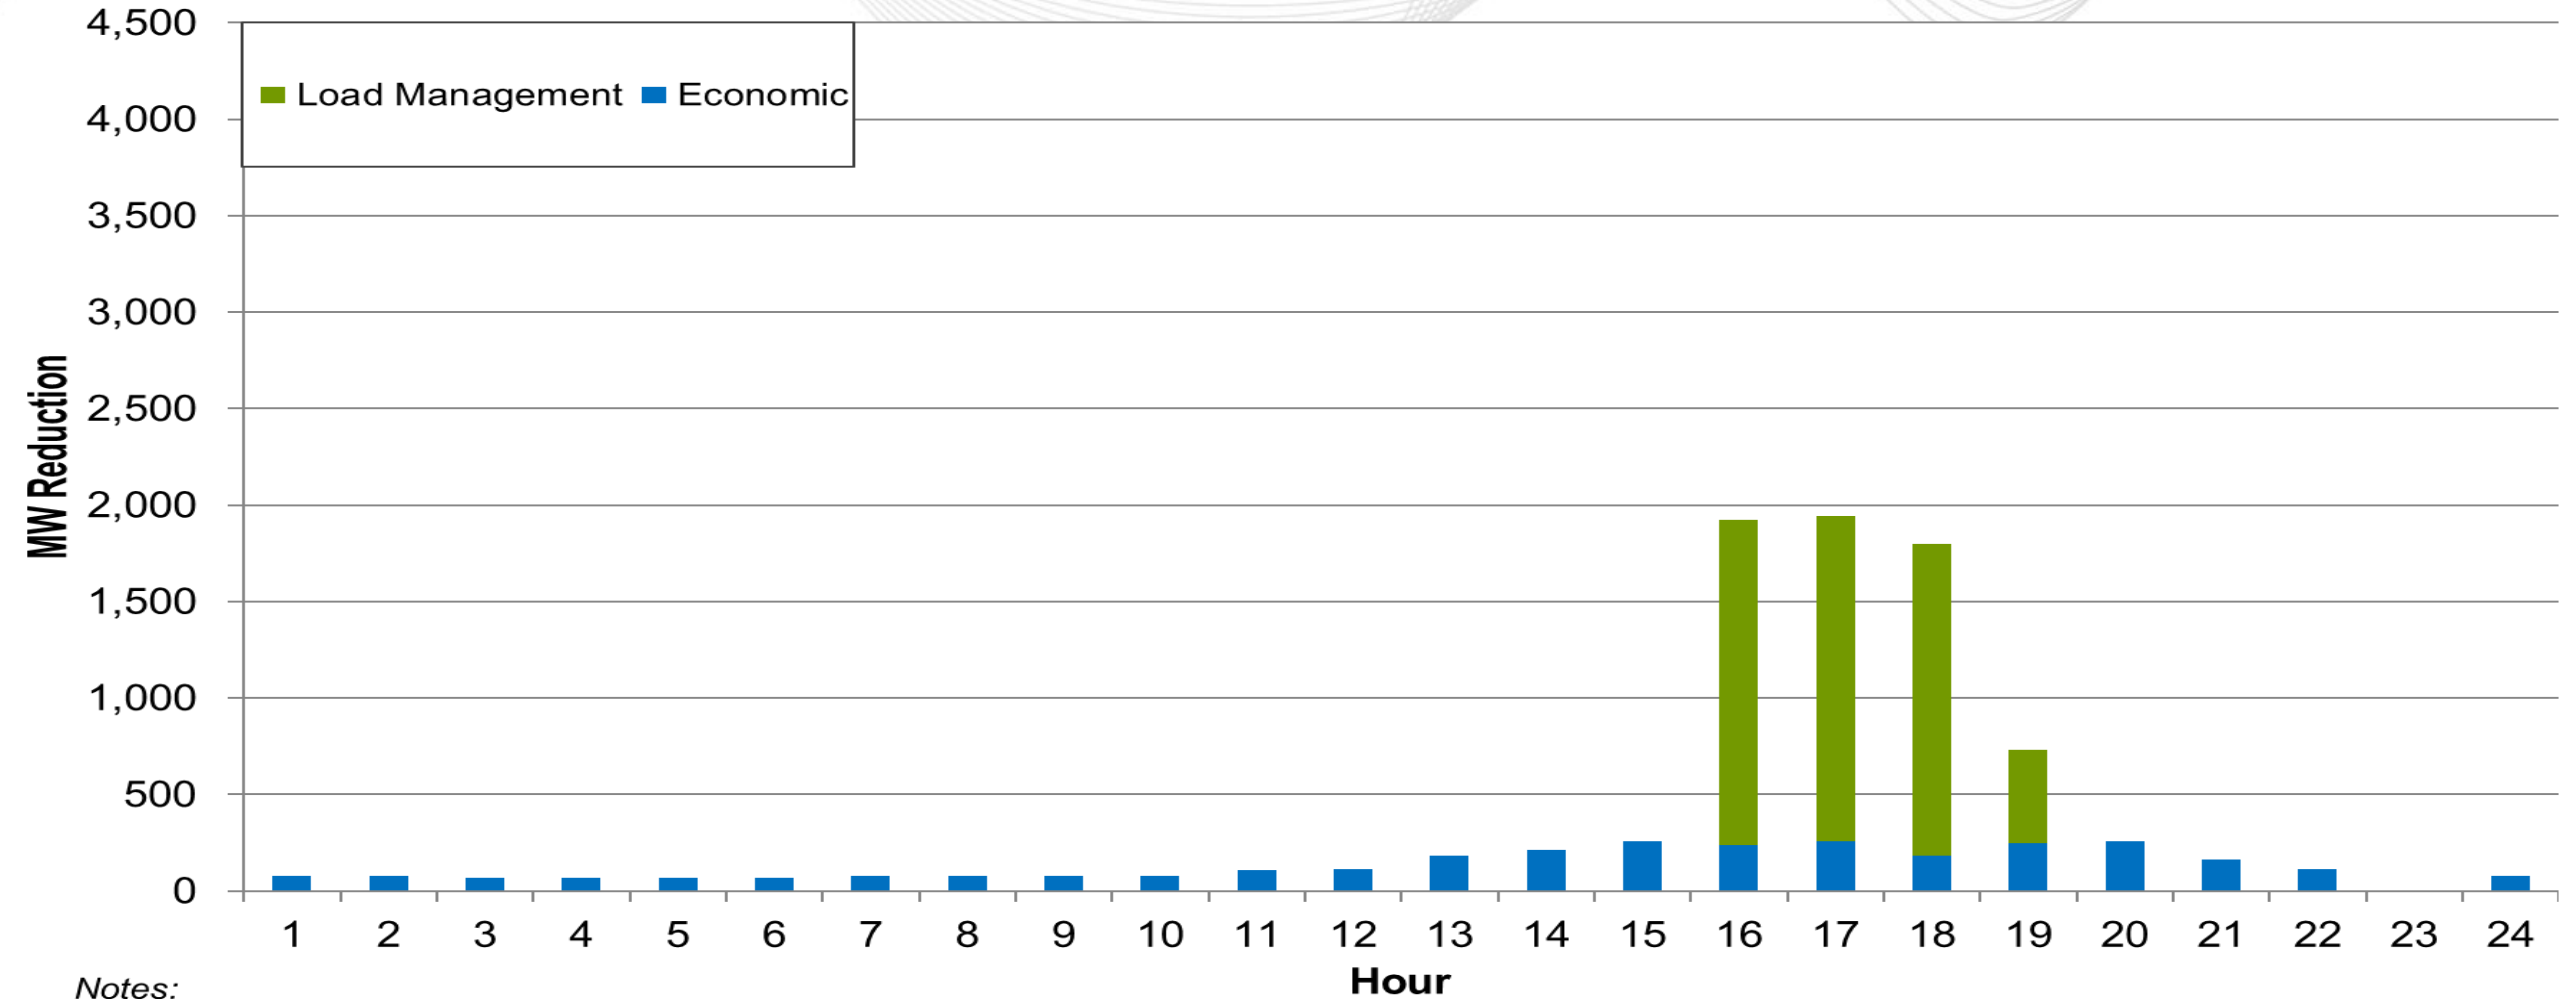

### Notes:

Load Management values are based on nominated capacity commitment (ICAP). This may be different from actual real time hourly energy reductions. Actual load reductions are not finalized until up to 3 months after event.

