

BAL-003-2 Performance Update &

Manual 12 Primary Frequency Response (PFR) Review

Ross Kelly Performance Compliance December 8, 2022 Operating Committee

/pjm

BAL-003-2 Frequency Response & Frequency Bias Setting

- **Purpose:** To require sufficient Frequency Response from the Balancing Authority (BA) to maintain Interconnection Frequency within predefined bounds by arresting frequency deviations and supporting frequency until the frequency is restored to its scheduled value. To provide consistent methods for measuring Frequency Response and determining the Frequency Bias Setting (FBS).
- Applicability: PJM is a Balancing Authority. PJM is not a member of Frequency Response Sharing Group (FRSG).
- Effective Date: 12/1/2020




BAL-003-2 Requirement 1

• **R1:** Each Frequency Response Sharing Group (FRSG) or Balancing Authority (BA) that is not a member of a FRSG shall achieve an annual Frequency Response Measure (FRM) (as calculated and reported in accordance with Attachment A) that is equal to or more negative than its Frequency Response Obligation (FRO) to ensure that sufficient Frequency Response is provided by each FRSG or BA that is not a member of a FRSG to maintain Interconnection Frequency Response equal to or more negative than the Interconnection Frequency Response Obligation (IFRO).

$$FRO_{BA} = IFRO \quad \times \frac{Annual Gen_{BA} + Annual Load_{BA}}{Annual Gen_{Int} + Annual Load_{Int}}$$

- 2022 Operating Year (OY) runs from December 2021 until November 2022
 - FRO_{PJM} for 2022 OY = $IFRO_{PJM}$ x Pro-rate Share_{PJM}

= (-915 MW/0.1Hz) x (25.989%) = -237.8 MW/0.1 Hz

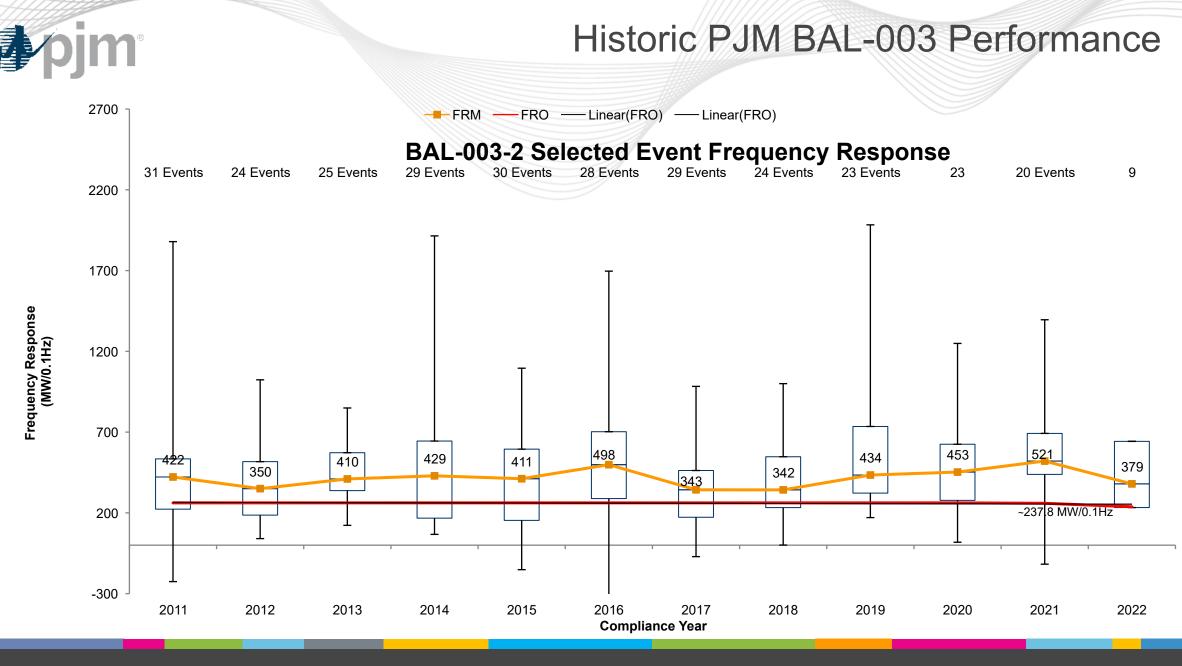



BAL-003 Phase II Updates

- Project 2017-01 Modifications to BAL-003 Phase II
 - BAL-003-3 Draft 1 was posted and opened for a 45-day formal comment period. Initial ballots for the standard and implementation plan, as well as a non-binding poll of the associated Violation Risk Factors and Violation Severity Levels were conducted August 29 – September 7, 2022.



M-12 Primary Frequency Response

- PJM continues to monitor unit PFR performance using criteria described in PFRSTF and documented in PJM Manual 12.
 - https://www.pjm.com/library/manual
- Event Selection
 - Frequency goes outside +/- 40mHz deadband
 - Frequency stays outside +/- 40mHz deadband for 60 continuous seconds
 - Minimum/maximum frequency reaches +/- 53mHz

M-12 PFR Selected Events



- Today's review included
 - Low Frequency Events
 - 08/31/2022 16:34:31
 - 09/25/2022 18:47:33
 - 10/03/2022 00:00:27
 - 10/14/2022 21:01:57
 - 10/21/2022 07:01:11
 - 10/22/2022 20:03:22
 - 10/31/2022 12:03:22
 - 11/05/2022 21:02:05
 - High Frequency Events
 - 11/09/2022 06:55:59
 - 11/15/2022 18:00:12


Fuel Type	# of Units evaluated
Coal	177
Hydro	25
Natural Gas	278
Oil	39
Solar	34
Wind	87
Other	7
Total	647

7




8/31/2022 16:34:31

9/25/2022 18:47:33

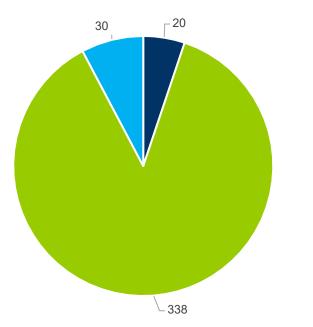




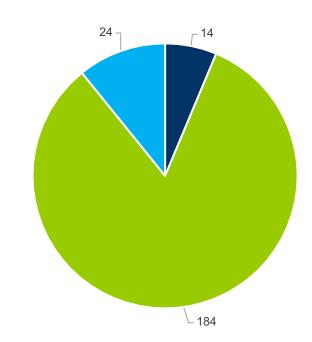




10/03/2022 00:00:27

10/14/2022 21:01:57

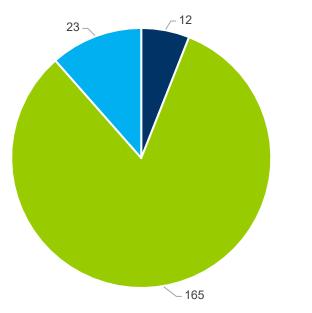


Further Evaluation NeededNo PFRPFR

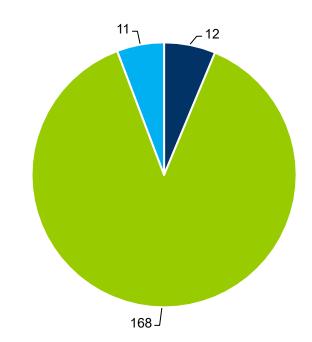




10/21/2022 07:01:11

10/22/2022 20:03:22

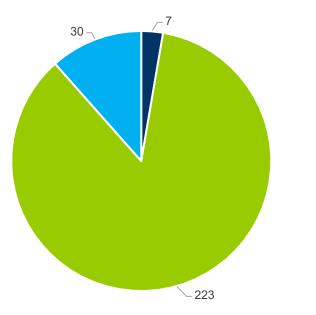


Further Evaluation NeededNo PFRPFR

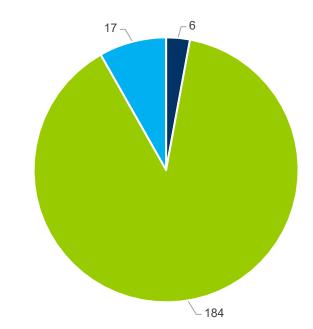




10/31/2022 12:03:22

11/05/2022 21:02:05

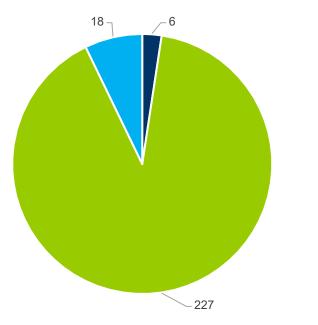


Further Evaluation NeededNo PFRPFR

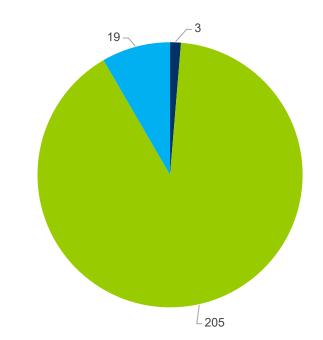




11/09/2022 06:55:59

11/15/2022 18:00:12

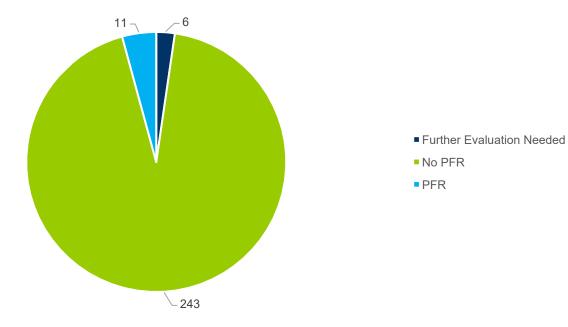


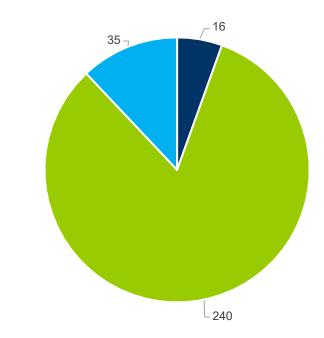



PJM Primary Frequency Response Review

M-12 PFR by Fuel Type For Units > 50 MW

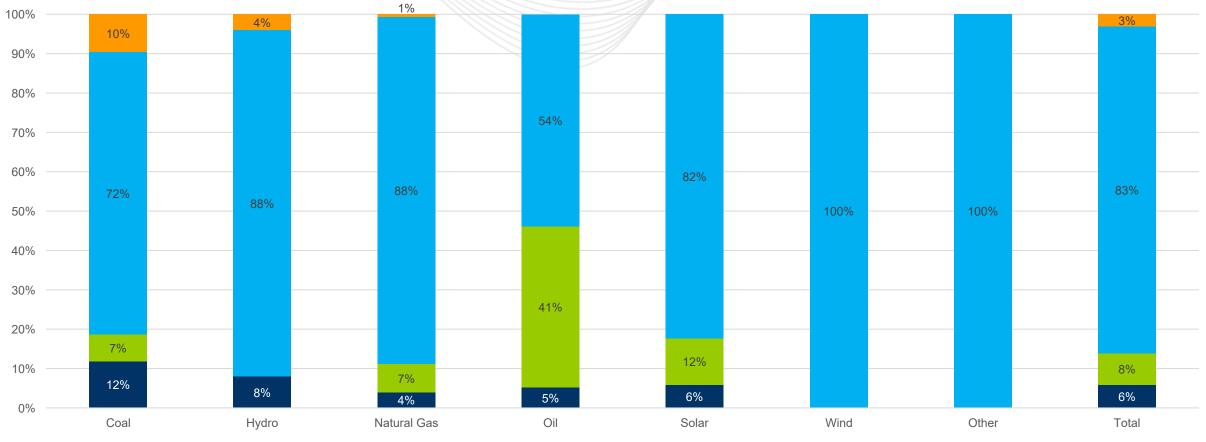

■ Further Evaluation Needed ■ Insufficient Data ■ No PFR ■ PFR





Presenter/SME: Ross Kelly Ross.Kelly@pjm.com SME: Ilyana Dropkin Ilyana.Dropkin@pjm.com **Frequency Response** FrequencyResponse@pjm.com

Member Hotline (610) 666 – 8980 (866) 400 – 8980 custsvc@pjm.com



Appendix



PJM Interactive Tool

- Interactive tool for members to use to assist with understanding unit performance
 - <u>https://www.pjm.com/-/media/committees-groups/task-forces/pfrstf/20181127/20181127-fr-performance-events.ashx</u>



Actual Response –	6.71	MW
Expected Response –	7.07	MW
Performance-	95%	MW

