



**Generation Interconnection
Feasibility Study Report
for
Queue Project AE2-153
BRAIDWOOD-DAVIS CREEK
35.2 MW Capacity / 200 MW Energy**

July, 2019

Table of Contents

1	Preface.....	5
2	General.....	7
2.1	Primary Point of Interconnection	8
2.2	Cost Summary.....	8
3	Transmission Owner Scope of Work.....	9
4	Attachment Facilities	9
5	Direct Connection Cost Estimate.....	10
6	Non-Direct Connection Cost Estimate.....	11
7	Schedule.....	12
8	Transmission Owner Analysis.....	13
9	Interconnection Customer Requirements.....	15
10	Revenue Metering and SCADA Requirements	16
11	Network Impacts for Primary Point of Interconnection	17
12	Generation Deliverability	19
13	Multiple Facility Contingency	19
14	Contribution to Previously Identified Overloads	19
15	Potential Congestion due to Local Energy Deliverability.....	20
16	System Reinforcements.....	22
17	Flow Gate Details	29
17.1	Index 1	30
17.2	Index 2	35
17.3	Index 3	40
17.4	Index 4	45
17.5	Index 5	50
17.6	Index 6	55
17.7	Index 7	60
17.8	Index 8	65
17.9	Index 9	70
17.10	Index 10.....	75
17.11	Index 11.....	80
17.12	Index 12.....	85

17.13	Index 13.....	90
17.14	Index 14.....	95
17.15	Index 15.....	100
17.16	Index 16.....	105
17.17	Index 17.....	108
17.18	Index 18.....	111
18	Affected Systems	116
18.1	LG&E.....	116
18.2	MISO	116
18.3	TVA.....	116
18.4	Duke Energy Progress.....	116
18.5	NYISO	116
19	Short Circuit.....	120
20	Secondary Point of Interconnection General	121
20.1	Secondary Point of Interconnection.....	121
20.2	Cost Summary.....	121
21	Network Impacts for Secondary Point of Interconnection.....	122
22	Generation Deliverability	124
23	Multiple Facility Contingency	124
24	Contribution to Previously Identified Overloads	124
25	Potential Congestion due to Local Energy Deliverability.....	125
26	Flow Gate Details	128
26.1	Index 1	129
26.2	Index 2	134
26.3	Index 3	139
26.4	Index 4	144
26.5	Index 5	149
26.6	Index 6	154
26.7	Index 7	159
26.8	Index 8	161
26.9	Index 9	166
26.10	Index 10.....	171
26.11	Index 11.....	176

26.12	Index 12.....	181
26.13	Index 13.....	186
26.14	Index 14.....	187
26.15	Index 15.....	192
26.16	Index 16.....	197
26.17	Index 17.....	202
26.18	Index 18.....	207
26.19	Index 19.....	210
26.20	Index 20.....	213
27	Short Circuit.....	221

1 Preface

The intent of the feasibility study is to determine a plan, with ballpark cost and construction time estimates, to connect the subject generation to the PJM network at a location specified by the Interconnection Customer. The Interconnection Customer may request the interconnection of generation as a capacity resource or as an energy-only resource. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing: (1) Direct Connections, which are new facilities and/or facilities upgrades needed to connect the generator to the PJM network, and (2) Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system.

In some instances a generator interconnection may not be responsible for 100% of the identified network upgrade cost because other transmission network uses, e.g. another generation interconnection, may also contribute to the need for the same network reinforcement. Cost allocation rules for network upgrades can be found in PJM Manual 14A, Attachment B. The possibility of sharing the reinforcement costs with other projects may be identified in the feasibility study, but the actual allocation will be deferred until the impact study is performed.

The Interconnection Customer seeking to interconnect a wind or solar generation facility shall maintain meteorological data facilities as well as provide that meteorological data which is required per Schedule H to the Interconnection Service Agreement and Section 8 of Manual 14D.

An Interconnection Customer with a proposed new Customer Facility that has a Maximum Facility Output equal to or greater than 100 MW shall install and maintain, at its expense, phasor measurement units (PMUs). See Section 8.5.3 of Appendix 2 to the Interconnection Service Agreement as well as section 4.3 of PJM Manual 14D for additional information.

PJM utilizes manufacturer models to ensure the performance of turbines and inverters is properly captured during the simulations performed for stability verification and, where applicable, for compliance with low voltage ride through requirements. Turbine manufacturers provide such models to their customers. The list of manufacturer models PJM has already validated is contained in Attachment B of Manual 14G. Manufacturer models may be updated from time to time, for various reasons such as to reflect changes to the control systems or to more accurately represent the capabilities turbines or inverters and controls which are currently available in the field. Additionally, as new turbine models are developed, turbine manufacturers provide such new models which must be used in the conduct of these studies. PJM needs adequate time to evaluate the new models in order to reduce delays to the System Impact Study process timeline for the Interconnection Customer as well as other Interconnection Customers in the study group. Therefore, PJM will require that any Interconnection Customer with a new manufacturer model must supply that model to PJM, along with a \$10,000 fully refundable deposit, no later than three (3) months prior to the starting date of the System Impact Study (See Section 4.3 for starting dates) for the Interconnection Request which shall specify the use of the new model. The Interconnection Customer will be required to submit a completed dynamic model study request form (Attachment B-1 of Manual 14G) in order to document the request for the study.

The Feasibility Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities. The project developer is responsible for the right of way, real estate, and construction permit issues. For properties currently owned by Transmission Owners, the costs may be included in the study.

2 General

The Interconnection Customer (IC), has proposed a wind generating facility located in Kankakee County, Illinois. The installed facilities will have a total capability of 200 MW with 35.2 MW of this output being recognized by PJM as Capacity. The proposed in-service date for this project is March 31, 2021. This study does not imply a TO commitment to this in-service date.

Queue Number	AE2-153
Project Name	BRAIDWOOD-DAVIS CREEK
State	Illinois
County	Kankakee
Transmission Owner	ComEd
MFO	200
MWE	200
MWC	35.2
Fuel	Wind
Basecase Study Year	2022

2.1 Primary Point of Interconnection

Queue Position AE2-153, a 200 MW wind facility, proposes to interconnect with the ComEd transmission system by tying into the Braidwood-Davis Creek 345kV line 2004, approximately 7.8 miles from Braidwood.

2.2 Cost Summary

The AE2-153 project will be responsible for the following costs:

Description	Total Cost
Attachment Facilities	\$ 7,100,000
Direct Connection Network Upgrade	\$23,000,000
Non Direct Connection Network Upgrades	\$ 2,000,000
Total Costs	\$32,100,000

In addition, the AE2-153 project may be responsible for a contribution to the following costs

Description	Total Cost
System Upgrades Loadflow	\$124,056,120
System Upgrades Short Circuit	
Total Costs	\$124,056,120

Cost allocations for these upgrades will be provided in the System Impact Study Report.

3 Transmission Owner Scope of Work

4 Attachment Facilities

The AE2-153 generator lead would interconnect to a new 345kV Interconnection Substation. The required Attachment Facilities are a series 5 ohm 345kV reactor, one 345kV line MOD, a dead-end structure and revenue metering as shown in the one-line diagram.

Scope of Work	Cost Estimate
Installation of one 345kV line MOD, one dead-end structure and one set of revenue metering (see notes below on cost estimate)	\$ 1,000,000
Install series 5 ohm 345 kV reactor	\$6,100,000
	\$7,100,000

5 Direct Connection Cost Estimate

In order to accommodate interconnection of AE2-153, a new 345kV Interconnection Substation would need to be built close to the Braidwood-Davis Creek 345kV line 2004, approximately 7.8 miles from Braidwood.

The scope of work includes the installation of three 345kV circuit breakers in a “breaker-and-a-half” bus configuration and cutting in the Interconnection Substation to the Braidwood-Davis Creek 345kV line 2004, as shown in the one-line diagram below.

The Interconnection Customer (“IC”) is responsible for constructing all of the facilities on the IC side of the Point of Interconnection (“POI”) outside of the substation. It is assumed for the purposes of this report that the IC will obtain the site for the Interconnection Substation and right-of-way between the Interconnection Substation and the 345kV transmission line.

In the event that the IC exercises the option to build the interconnecting substation, the IC will be required to construct all interconnection facilities that will be turned over to ComEd in accordance with ComEd published standards and the PJM Tariff.

ComEd would design, engineer and construct the tie-in of the Interconnection Substation to the Braidwood-Davis Creek 345kV line 2004.

The preliminary cost estimate for Direct Connection Network Upgrade is given in the following tables.

For Option to Build Direct Connection cost estimates:

Scope of Work	Cost Estimate
Installation of a new 345kV substation as described above	N/A
Transmission line tie in work (foundations, structures, conductors)	\$3,000,000
ComEd oversight and testing	\$1,500,000
Total Cost Estimate (see notes below on cost estimate)	\$4,500,000

For ComEd building the interconnecting substation cost estimates:

Scope of Work	Cost Estimate
Installation of a new 345kV substation as described above	\$20,000,000
Transmission line tie in work (foundations, structures, conductors)	\$3,000,000
Total Cost Estimate (see notes below on cost estimate)	\$23,000,000

6 Non-Direct Connection Cost Estimate


The integration of the new 345kV Interconnection Substation would require relay/communications/SCADA upgrades at Braidwood Sta 20 and Davis Creek TSS 86. The ComEd cost is given below:

Scope of Work	Cost Estimate
Relay/communications/SCADA upgrades at Wilmington TSS 149	\$ 1,000,000
Relay/communications/SCADA upgrades at Davis Creek TSS 86	\$ 1,000,000
Total Cost Estimate (see notes below on cost estimate)	\$ 2,000,000

7 Schedule

ComEd would take approximately 24-months to construct the substation and transmission line work after the ISA / ICSA are signed.

8 Transmission Owner Analysis

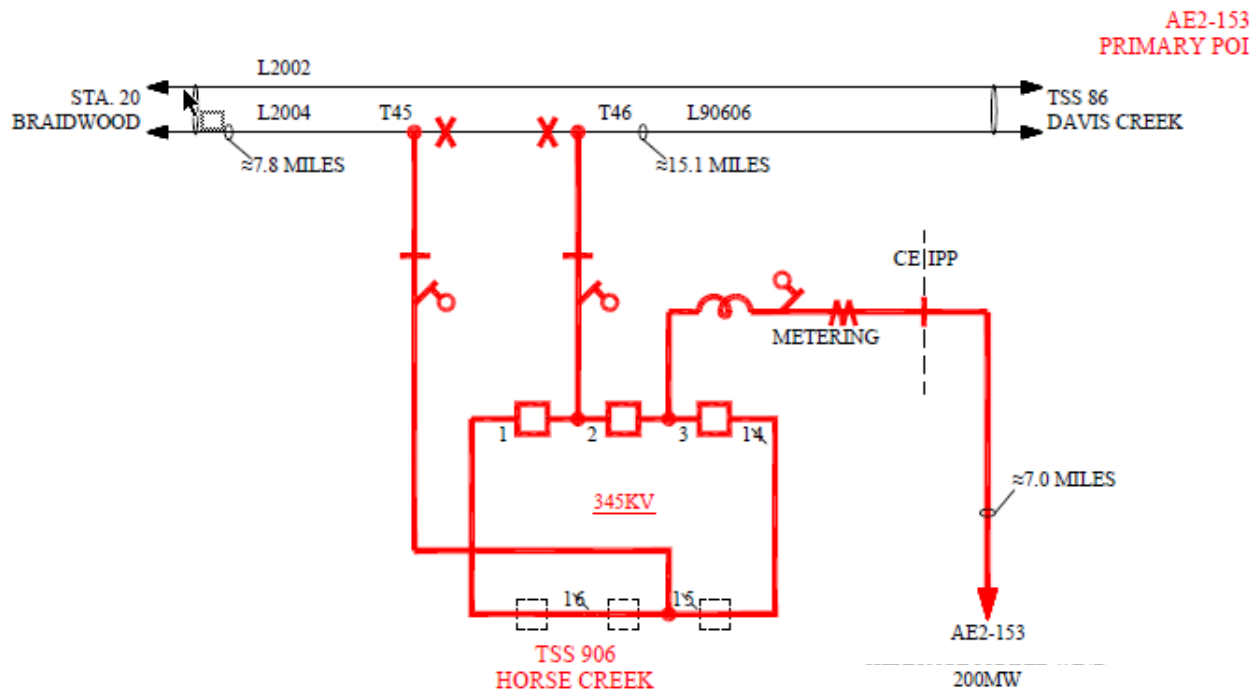

Notes on Cost Estimate:

- 1) These estimates are Order-of-Magnitude estimates of the costs that ComEd would bill to the customer for this interconnection. These estimates are based on a one-line electrical diagram of the project and the information provided by the IC.
- 2) There were no site visits performed for these estimates. There may be costs related to specific site related issues that are not identified in these estimates. The site reviews will be performed during the Facilities Study or during detailed engineering.
- 3) These estimates are not a guarantee of the maximum amount payable by the IC and the actual costs of ComEd's work may differ significantly from these estimates. The IC will be responsible for paying actual costs of ComEd's work in accordance with Sections 212.1 and 217 of the PJM Open Access Transmission Tariff.
- 4) The IC is responsible for all engineering, procurement, testing and construction of all equipment on the IC's side of the POI.
- 5) These cost estimates do not include cost of acquiring right-of-way for the transmission line and purchasing any additional land, if needed, for the line terminations. The need and cost of acquiring property and associated legal costs will be investigated during Facilities Study for this project.

9 Interconnection Customer Requirements

In the event that the IC exercises the option to build the Interconnecting Substation, the IC will be required to construct all interconnection facilities that will be turned over to ComEd in accordance with ComEd published standards and the PJM Tariff.

ComEd interconnection requirements can be found at <https://www.pjm.com/planning/design-engineering/to-tech-standards/private-comed.aspx>

Requests for interconnection to the ComEd distribution system are addressed in documentation that is available on the respective Company websites which may be accessed via the ComEd website at <https://www.comed.com/SmartEnergy/MyGreenPowerConnection/Pages/ConnectingToTheGrid.aspx>.

To the extent that these Applicable Technical Requirements and Standards may conflict with the terms and conditions of the Tariff, the Tariff shall control.

ComEd distribution line drops to move customer cranes and heavy equipment is not part of PJM process. The customer should directly contact ComEd New Business Group to arrange for line drops, if needed.

10 Revenue Metering and SCADA Requirements

The Interconnection Customer will be required to install equipment necessary to provide Revenue Metering (KWH, KVARH) and real time data (KW, KVAR) for IC's generating Resource. See PJM Manuals M-01 and M-14D, and PJM Tariff Section 8 of Attachment O.

11 Network Impacts for Primary Point of Interconnection

The Queue Project AE2-153 was evaluated as a 200.0 MW (Capacity 35.2 MW) injection tapping the Braidwood to Davis Creek 345kV line in the ComEd area. Project AE2-153 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AE2-153 was studied with a commercial probability of 0.53. Potential network impacts were as follows:

Summer Peak Load Flow

12 Generation Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

13 Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

14 Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC/D C	MW IMPACT
1542324	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	121.77	122.01	DC	15.14
1542325	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	COMED_P4_112-65-BT4-5	breaker	1409.0	111.8	112.04	DC	16.69
1542326	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	COMED_P4_112-65-BT3-4	breaker	1409.0	111.8	112.04	DC	16.69
1542327	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	COMED_P4_023-65-BT2-3	breaker	1409.0	111.8	112.04	DC	16.69
2229371	255104	17GREENACRE	NIPS	270771	GREENACRE; T	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	111.95	112.08	DC	17.86
2229239	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	133.39	133.54	DC	19.69
2229240	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_023-65-BT2-3	breaker	1091.0	133.21	133.34	DC	19.86
2229241	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_112-65-BT4-5	breaker	1091.0	132.86	133.0	DC	19.85
2229242	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_112-65-BT3-4	breaker	1091.0	132.85	133.0	DC	19.85
1541920	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	173.14	173.3	DC	30.78
1543537	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L94507_B-S+_345-L97008_R-S	tower	4105.0	107.08	107.19	DC	65.94
1543538	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L6607_B-S+_345-L97008_R-S	tower	4105.0	104.98	105.09	DC	66.02
2229444	270677	BURNHAM ;OR	CE	255109	17MUNSTER	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1441.0	100.78	100.93	DC	26.85
2229342	270728	E FRANKFO; B	CE	274750	CRETE EC;BP	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1399.0	114.69	114.87	DC	27.82
2229343	270728	E FRANKFO; B	CE	274750	CRETE EC;BP	CE	1	COMED_P4_023-65-BT2-3	breaker	1399.0	114.25	114.42	DC	28.0
2229344	270728	E FRANKFO; B	CE	274750	CRETE EC;BP	CE	1	COMED_P4_112-65-BT4-5	breaker	1399.0	114.17	114.35	DC	27.96
2229345	270728	E FRANKFO; B	CE	274750	CRETE EC;BP	CE	1	COMED_P4_112-65-BT3-4	breaker	1399.0	114.16	114.34	DC	27.96
1542191	270771	GREENACRE; T	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	125.77	125.92	DC	17.86
2229244	270886	ST JOHN ; T	CE	255104	17GREENACRE	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	133.39	133.54	DC	19.69

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC/D C	MW IMPACT
2229245	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_023-65-BT2-3__	breaker	1091.0	133.21	133.34	DC	19.86
2229246	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_112-65-BT4-5__	breaker	1091.0	132.86	133.0	DC	19.85
2229247	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_112-65-BT3-4__	breaker	1091.0	132.85	133.0	DC	19.85
2229177	270926	WILTON ; B	CE	275232	WILTON ;3M	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.88	163.06	DC	34.43
2229179	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.6	162.81	DC	35.14
2229195	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1399.0	159.86	160.02	DC	27.49
2229196	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_023-65-BT2-3__	breaker	1399.0	159.41	159.57	DC	27.67
2229197	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_112-65-BT4-5__	breaker	1399.0	159.36	159.52	DC	27.64
2229198	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_112-65-BT3-4__	breaker	1399.0	159.36	159.52	DC	27.64
1542057	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	138.54	138.75	DC	21.72
1542058	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_023-65-BT2-3__	breaker	971.0	137.41	137.63	DC	21.93
1542059	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_112-65-BT4-5__	breaker	971.0	137.41	137.63	DC	21.92
1542060	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_112-65-BT3-4__	breaker	971.0	137.41	137.63	DC	21.92
1542061	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_023-65-BT4-5__	breaker	971.0	137.4	137.62	DC	21.92
2229175	275232	WILTON ;3M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.88	163.06	DC	34.43
2229181	275233	WILTON ;4M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.6	162.81	DC	35.14
2229851	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L2001__B-S_+ 345-L2003__R-S-B	tower	1846.0	147.48	149.77	DC	42.11
2229852	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L2001__B-S_+ 345-L2003__R-S-A	tower	1846.0	146.1	148.4	DC	42.2
2229846	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L2001__B-S_+ 345-L2003__R-S-B	tower	1846.0	155.43	157.72	DC	42.11
2229847	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L2001__B-S_+ 345-L2003__R-S-A	tower	1846.0	153.64	155.94	DC	42.2
7078669	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	122.25	122.74	DC	15.14

15 Potential Congestion due to Local Energy Deliverability

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Note: Only the most severely overloaded conditions are listed below. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission Interconnection Request, a subsequent analysis will be performed which shall study all overload conditions associated with the overloaded element(s) identified.

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1543192	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P1-2_#695A	operation	1409.0	111.8	112.03	DC	16.69
2229731	255104	17GREEN_ACRE	NIPS	270771	GREENACRE; T	CE	1	AEP_P1-2_#695A	operation	1091.0	110.91	111.05	DC	18.1
2229627	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	AEP_P1-2_#695A	operation	1091.0	132.84	132.99	DC	19.85
1542679	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	AEP_P1-2_#695A	operation	1409.0	170.2	170.39	DC	31.75
1542684	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	Base Case	operation	1409.0	110.23	110.35	DC	18.78
1543213	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	Base Case	operation	3555.0	105.53	105.63	DC	55.51
2229814	270670	BRAIDWOOD; B	CE	934730	AD1-100 TAP	CE	1	COMED_P1-2_345-L2004_AR-S-B	operation	1528.0	95.93	100.95	DC	76.81
2229817	270677	BURNHAM ;0R	CE	255109	17MUNSTER	NIPS	1	AEP_P1-2_#695A	operation	1441.0	100.05	100.21	DC	27.05
2229712	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	AEP_P1-2_#695A	operation	1399.0	114.12	114.3	DC	27.97
2229775	270728	E FRANKFO; B	CE	270766	GOODINGS ;3B	CE	1	COMED_P1-2_345-L94507_B-S	operation	1726.0	105.33	106.71	DC	23.82
1542933	270771	GREENACRE; T	CE	243229	05OLIVE	AEP	1	AEP_P1-2_#695A	operation	971.0	124.6	124.75	DC	18.1
2229624	270886	ST JOHN ; T	CE	255104	17GREEN_ACRE	NIPS	1	AEP_P1-2_#695A	operation	1091.0	132.84	132.99	DC	19.85
2229809	270926	WILTON ; B	CE	275232	WILTON ;3M	CE	1	COMED_P1-2_765-L11216_-S	operation	1379.0	102.26	102.38	DC	21.62
2229783	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P1-2_765-L11216_-S	operation	1379.0	104.85	104.98	DC	22.66
2229582	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	AEP_P1-2_#695A	operation	1399.0	159.32	159.48	DC	27.64
2229583	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	Base Case	operation	1091.0	131.3	132.07	DC	18.45
1542839	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	AEP_P1-2_#695A	operation	971.0	137.39	137.61	DC	21.92
2229562	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P1-2_345-L8014_-S-B	operation	1528.0	165.46	167.26	DC	27.42
2229567	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	Base Case	operation	1364.0	149.5	151.55	DC	27.94
2229556	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P1-2_345-L8014_-S-B	operation	1528.0	171.89	173.69	DC	27.42
2229561	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	Base Case	operation	1364.0	159.4	161.45	DC	27.94
7079615	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P1-2_#695A	operation	1409.0	117.24	117.78	DC	16.69
2229811	940630	AE2-050 TAP	CE	270728	E FRANKFO; B	CE	1	COMED_P1-2_345-L11212_B-S-A	operation	1528.0	100.22	102.43	DC	33.56

16 System Reinforcements

ID	Index	Facility	Upgrade Description	Cost
2229343,2229342,2229345,2229344	7	E FRANKFO; B 345.0 kV - CRETE EC ;BP 345.0 kV Ckt 1	ce-014 (301) : L6607 SSTE rating is 1483 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade will be to reconductor the line. A preliminary estimate is \$10.3 M with an estimated construction timeline of 30 months. Upon completion of the upgrades the rating will be 1334/1726/1837/2084 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$10,300,000 Time Estimate : 30.0 Months	\$10,300,000
2229244,2229245,2229246,2229247	9	ST JOHN ; T 345.0 kV - 17GREEN_ACRE 345.0 kV Ckt 1	<u>COMED</u> ce-011 (297) : L6617 SSTE is 1134 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade is sag mitigation of the line. A preliminary estimate is \$3.1 M with a estimated construction timeline of 30 months. Upon completion of this upgrade the new ratings will be 1091/1399/1483/1674 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$3,100,000 Time Estimate : 30.0 Months <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Project Type : FAC Cost : \$0 Time Estimate : N/A Months	\$3,100,000
2229175	14	WILTON ;3M 345.0 kV - WILTON ; 765.0 kV Ckt 1	n5145 (292) : PJM Network Upgrade (n5145): Reconfigure Wilton 765kV bus thereby allowing for 765kV L11216 (currently on Bus 6) to be relocated to Bus 8. Along with this line relocation, installation of 2-765kV BT CBs (6-8 & 8-2). Project Type : CON Cost : \$11,000,000 Time Estimate : 36-40 Months	\$11,000,000
2229177	10	WILTON ; B 345.0 kV - WILTON ;3M 345.0 kV Ckt 1	n5145 (292) : PJM Network Upgrade (n5145): Reconfigure Wilton 765kV bus thereby allowing for 765kV L11216 (currently on Bus 6) to be relocated to Bus 8. Along with this line relocation, installation of 2-765kV BT CBs (6-8 & 8-2). Project Type : CON Cost : \$11,000,000 Time Estimate : 36-40 Months	\$11,000,000
2229179	11	WILTON ; R 345.0 kV - WILTON ;4M 345.0 kV Ckt 1	n5145 (292) : PJM Network Upgrade (n5145): Reconfigure Wilton 765kV bus thereby allowing for 765kV L11216 (currently on Bus 6) to be relocated to Bus 8. Along with this line relocation, installation of 2-765kV BT CBs (6-8 & 8-2). Project Type : CON Cost : \$11,000,000 Time Estimate : 36-40 Months	\$11,000,000

ID	Index	Facility	Upgrade Description	Cost
2229444	6	BURNHAM ;OR 345.0 kV - 17MUNSTER 345.0 kV Ckt 1	<u>COMED</u> ce-015 (302) : L17703 SSTE rating is 1251 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade will be to mitigate the sag on the line. A preliminary estimate for the upgrade is \$2.7 M with a estimated construction timeline of 30 months. The new line rating upon completion of the upgrade will be 1201/1479/1568/1768 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$2,700,000 Time Estimate : 30.0 Months <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Project Type : FAC Cost : \$0 Time Estimate : N/A Months	\$2,700,000
1542058,1542059,1542061,1542060,1542057	13	UNIV PK N;RP 345.0 kV - 05OLIVE 345.0 kV Ckt 1	<u>AEP</u> AEP_AE1_REF_r0001 (120) : A Sag Study will be required on the 40.64 miles of ACSR/PE 1414 62/19 conductor to mitigate the overload. The new ratings after sag study will be: S/N: 971 MVA, S/E: 1419 MVA, Depending on the sag study results, the cost for this upgrade is expected to be between \$162,560 (no remediation required, just sag study) and \$81.28 million (complete line Reconductor/rebuild). Time Estimate: a) Sag Study: 6-12 months b) Rebuild: The standard time required for construction differs from state to state. An approximate construction time would be 24 to 36 months after signing an interconnection agreement. Project Type : FAC Cost : \$162,560 Time Estimate : 6-12 Months AEP_AE1_REF_r0002 (121) : Replace 5 Jumpers (Sub cond 2156 ACSR 84/19 STD at Olive station, estimated cost : \$175,000 Project Type : FAC Cost : \$175,000 Time Estimate : 6-12 Months <u>COMED</u> ce-001 (278) : AEP owns limit on L97008. CE has a sag limit on 2 types of conductors as well. CE would need to address sag limit of 2 types of conductors to reach required rating. A preliminary estimate for sag mitigation is \$21.4M with an estimated construction timeline of 30 months. Upon completion of the sag mitigation the new ratings will become 1091/1399/1483/1674 MVA SN/SLTE/SSTE/SLD. Project Type : FAC Cost : \$21,400,000 Time Estimate : 30.0 Months	\$21,737,560

ID	Index	Facility	Upgrade Description	Cost
2229846,2229847	17	AD2-137 TAP 345.0 kV - WILTON ; B 345.0 kV Ckt 1	ce-019 (308) : L11212 SLD & ALDR ratings are 2221 MVA & 2554MVA respectively. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade will be to re-conductor the line, upgrade station conductor at both terminals, upgrade 2-345kV circuit breakers at Wilton Center. A preliminary estimate for the upgrades is \$ 43.2 M with a estimated construction timeline of 36 months. Upon completion of the upgrades the rating swill be 1912/1912/1912/2390/2749 MVA (SN/SLTE/SSTE/SLD/ALDR). Project Type : FAC Cost : \$43,200,000 Time Estimate : 36.0 Months	\$43,200,000
2229195,2229196,22 29197,2229198	12	CRETE EC ;BP 345.0 kV - 17STJOHN 345.0 kV Ckt 1	<u>COMED</u> ce-009 (293) : L94507 SSTE rating is 1483 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade will be to reconductor the line, upgrade station conductor and upgrade a relay package. A preliminary cost estimate is \$14.9 M with an estimated construction timeline of 30 months. Upon complation of this upgrade the new ratings will be 1754/2246/2297/2488 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$14,900,000 Time Estimate : 30.0 Months <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Project Type : FAC Cost : \$0 Time Estimate : N/A Months	\$14,900,000
2229851,2229852	16	AD1-100 TAP 345.0 kV - AD2-137 TAP 345.0 kV Ckt 1	ce-019 (308) : L11212 SLD & ALDR ratings are 2221 MVA & 2554MVA respectively. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade will be to re-conductor the line, upgrade station conductor at both terminals, upgrade 2-345kV circuit breakers at Wilton Center. A preliminary estimate for the upgrades is \$ 43.2 M with a estimated construction timeline of 36 months. Upon completion of the upgrades the rating swill be 1912/1912/1912/2390/2749 MVA (SN/SLTE/SSTE/SLD/ALDR). Project Type : FAC Cost : \$43,200,000 Time Estimate : 36.0 Months	\$43,200,000

ID	Index	Facility	Upgrade Description	Cost
1542326,1542327,1542324,1542325	1	05ELDERBRYSS 345.0 kV - AE1-089 TAP 345.0 kV Ckt 1	AEP_AE1_REF_r0021 (135) : A Sag Study will be required on the 7.2 miles of ACSR ~ 954 ~ 45/7 ~ RAIL - Conductor section 1 conductor to mitigate the overload. The new ratings after sag study will be: S/N: 1409 MVA, S/E: 1888 MVA, Depending on the sag study results, the cost for this upgrade is expected to be between \$28,800 (no remediation required, just sag study) and \$14.4million (complete line Reconductor/rebuild). Time Estimate: a) Sag Study: 6-12 months b) Rebuild: The standard time required for construction differs from state to state. An approximate construction time would be 24 to 36 months after signing an interconnection agreement. Project Type : FAC Cost : \$28,000 Time Estimate : 6-12 Months	\$28,000
2229371	2	17GREEN_ACRE 345.0 kV - GREENACRE; T 345.0 kV Ckt 1	<u>COMED</u> ce-011 (297) : L6617 SSTE is 1134 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade is sag mitigation of the line. A preliminary estimate is \$3.1 M with a estimated construction timeline of 30 months. Upon completion of this upgrade the new ratings will be 1091/1399/1483/1674 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$3,100,000 Time Estimate : 30.0 Months <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Project Type : FAC Cost : \$0 Time Estimate : N/A Months	\$3,100,000
1543537,1543538	5	WILTON ; 765.0 kV - 05DUMONT 765.0 kV Ckt 1	AEPI0001a (80) : Replace Dumont Circuit Breaker B1 [Breaker (3000A) Non oil - Dumont] Project Type : FAC Cost : \$3,000,000 Time Estimate : 12-18 Months <u>1543537,1543538</u> No upgrade is required. Line L11215. Line sag SLD= 4802 MVA, ALDR = 5522 MVA.	\$3,000,000

ID	Index	Facility	Upgrade Description	Cost
1541920	4	17STILLWELL 345.0 kV - 05DUMONT 345.0 kV Ckt 1	<u>AEP</u> n4790 (150) : PJM Network Upgrade n4790. Replace Dumont substation 2500A wavetrap. The network project had a projected in-service date of 06/01/2019 and an estimated cost of \$200,000. Cost : \$0 n5769.1 (151) : PJM Network Upgrade n5769.1. Perform engineering study for CT limits, and relay compliance trip limits at Dumont substation. The network project has a projected in-service date of 06/01/2021 and an estimated cost of \$25,000. Cost : \$0 n5769.2 (152) : PJM Network Upgrade n5769.2. Replace two Dumont 3000A Non-Oil breakers. The network project has a projected in-service date of 06/01/2021 and an estimated cost of \$2,000,000. Cost : \$0 n5769.3 (153) : PJM Network Upgrade n5769.3. Replace 11 jumpers/risers at Dumont substation. The network project has a projected in-service date of 06/01/2021 and an estimated cost of \$275,000. Cost : \$0 AEP_AD2_REF_r0001 (154) : Replace 4 Dumont switches (3000 A). Estimated cost is \$2,400,000. Cost : \$0 AEP_AD2_REF_r0002 (155) : An engineering study will need to be conducted to determine if the Dumont Relay Compliance Trip limit settings can be adjusted. Estimated Cost to perform setting changes: \$25,000. New relay packages will be required if the settings cannot be adjusted, Estimated Cost for relay package: \$600,000. Cost : \$0 <u>For all AEP reinforcements on the Stillwell-Dumont 345 kV line:</u> Cost allocation will be performed in the Impact Study phase. Queue Project AE2-049 presently does not receive cost allocation for this upgrade. Note 1: As changes to the interconnection process occur, such as prior queued projects withdrawing from the queue, reducing in size, etc, Queue Project AE2-049 could receive cost allocation. Note 2: Although Queue Project AE2-049 may not have cost responsibility for this upgrade, Queue Project AE2-049 may need this upgrade in-service to be deliverable to the PJM system. If Queue Project AE2-049 comes into service prior to completion of the upgrade, Queue Project AE2-049 will need an interim study. <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Cost : \$0	\$0

ID	Index	Facility	Upgrade Description	Cost
2229181	15	WILTON ;4M 345.0 kV - WILTON ; 765.0 kV Ckt 1	n5145 (292) : PJM Network Upgrade (n5145): Reconfigure Wilton 765kV bus thereby allowing for 765kV L11216 (currently on Bus 6) to be relocated to Bus 8. Along with this line relocation, installation of 2-765kV BT CBs (6-8 & 8-2). Project Type : CON Cost : \$11,000,000 Time Estimate : 36-40 Months	\$11,000,000
7078669	18	AE1-089 TAP 345.0 kV - 05DUMONT 345.0 kV Ckt 1	AEP_AE1_REF_r0040: 1) A Sag Study will be required on the 7.0 miles of conductor to mitigate the overload. The new ratings after sag study will be: S/N: 1409 MVA, S/E: 1888 MVA, Depending on the sag study results, the cost for this upgrade is expected to be between \$28,000(no remediation required, just sag study) and \$14.0 million (complete line Reconductor/rebuild). Time Estimate: a) Sag Study: 6-12 months b) Rebuild: The standard time required for construction differs from state to state. An approximate construction time would be 24 to 36 months after signing an interconnection agreement. Project Type : FAC Cost : \$28,000 Time Estimate : 6-12 Months	\$28,000
2229239,2229240,22 29242,2229241	3	17STJOHN 345.0 kV - ST JOHN ; T 345.0 kV Ckt 1	<u>COMED</u> ce-011 (297) : L6617 SSTE is 1134 MVA. The post contingency flow for this event exceeds the rating therefore an upgrade is required. The upgrade is sag mitigation of the line. A preliminary estimate is \$3.1 M with a estimated construction timeline of 30 months. Upon completion of this upgrade the new ratings will be 1091/1399/1483/1674 MVA (SN/SLTE/SSTE/SLD). Project Type : FAC Cost : \$3,100,000 Time Estimate : 30.0 Months <u>NIPS</u> NonPJMArea (759) : The external (i.e. Non-PJM) Transmission Owner, NIPS, will not evaluate this violation until the impact study phase. Project Type : FAC Cost : \$0 Time Estimate : N/A Months	\$3,100,000

ID	Index	Facility	Upgrade Description	Cost
1542191	8	GREENACRE; T 345.0 kV - 05OLIVE 345.0 kV Ckt 1	<u>AEP</u> AEP_AE1_REF_r0005 (123) : Replace ACSR/PE 1414 62/19 - Conductor Section 1. A Sag Study will be required on the 40.64 miles of conductor to mitigate the overload. The new ratings after sag study will be: S/N: 971 MVA, S/E: 1419 MVA, Depending on the sag study results, the cost for this upgrade is expected to be between \$162,560 (no remediation required, just sag study) and \$81.28 million (complete line Reconductor/rebuild). Time Estimate: a) Sag Study: 6-12 months b) Rebuild: The standard time required for construction differs from state to state. An approximate construction time would be 24 to 36 months after signing an interconnection agreement. Project Type : FAC Cost : \$162,560 Time Estimate : 6-12 Months <u>COMED</u> ce-002 (279) : AEP owns limit on L6615. CE and NIPSCO have a sag limit as well that would need to be addressed. CE SSTE rating is 1134 MVA. A preliminary estimate for sag mitigation is \$13.9M with an estimated construction timeline of 30 months. Upon completion of the sag mitigation the new ratings will become 1091/1399/1483/1674 MVA SN/SLTE/SSTE/SLD. Project Type : FAC Cost : \$13,900,000 Time Estimate : 30.0 Months	\$14,062,560
			TOTAL COST	\$124,056,120

If “No Reinforcement Needed. Not a valid violation” was provided as the Upgrade Description for a facility in the System Reinforcements table then that facility met one of the following conditions:

- The loading on the facility at your queue position was less than 100%; therefore, the facility is not yet overloaded, but may be overloaded by end of the AE2 queue.
- The TO reviewed their ratings on the facility and determined that the current rating was greater than the rating in PJM’s model. This new rating was greater than the loading at your queue position making the violation invalid.
- The TO reviewed the contingency and determined that contingency was not valid; therefore the violation is invalid. Any contingency corrections will be assessed and corrected in the AE2 impact study phase.

17 Flow Gate Details

The following appendices contain additional information about each flowgate presented in the body of the report. For each appendix, a description of the flowgate and its contingency was included for convenience. However, the intent of the appendix section is to provide more information on which projects/generators have contributions to the flowgate in question. Although this information is not used "as is" for cost allocation purposes, it can be used to gage other generators impact. It should be noted the generator contributions presented in the appendices sections are full contributions, whereas in the body of the report, those contributions take into consideration the commercial probability of each project.

17.1 Index 1

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1542324	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	121.77	122.01	DC	15.14

Bus #	Bus	MW Impact
247900	05FR-11G E	6.83
247901	05FR-12G E	6.72
247902	05FR-21G E	7.18
247903	05FR-22G E	6.87
247904	05FR-3G E	13.92
247905	05FR-4G E	10.47
247906	05MDL-1G E	15.59
247907	05MDL-2G E	7.73
247912	05MDL-3G E	8.08
247913	05MDL-4G E	7.81
247943	T-127 E	7.81
270859	PWR VTR EC;R	7.08
274722	S-055 E	6.52
274809	UNIV PK N;5U	0.64
274811	UNIV PK N;7U	0.64
274812	UNIV PK N;8U	0.64
274814	UNIV PK N;0U	0.64
274815	UNIV PK N;XU	0.64
274888	PILOT HIL;1E	10.28
275149	KEMPTON ;1E	10.28
290021	O50 E	11.42
290051	GSG-6; E	6.14
290108	LEEDK;1U E	14.18
293061	N-015 E	8.92
293644	O22 E1	5.91
293645	O22 E2	11.47
294392	P-010 E	11.33
295109	WESTBROOK E	3.29
909145	X2-052	28.77
914641	Y2-103	26.09
915011	Y3-013 1	2.17
915021	Y3-013 2	2.17
915031	Y3-013 3	2.17
916221	Z1-073 E	3.17
916502	Z1-106 E1	0.73
916504	Z1-106 E2	0.73
916512	Z1-107 E	1.49
916522	Z1-108 E	1.44
917711	Z2-114 C	0.05
917712	Z2-114 E	0.39
918052	AA1-018 E	9.77

Bus #	Bus	MW Impact
920272	AA2-123 E	1.43
924471	AB2-096	24.78
925302	AB2-191 E	0.81
926311	AC1-109 1	1.1
926321	AC1-109 2	1.1
926331	AC1-110 1	1.09
926341	AC1-110 2	1.09
926351	AC1-111 1	0.44
926361	AC1-111 2	0.44
926371	AC1-111 3	0.44
926381	AC1-111 4	0.44
926391	AC1-111 5	0.44
926401	AC1-111 6	0.44
926431	AC1-114	1.4
927091	AC1-204 1	41.76
927101	AC1-204 2	41.76
927451	AC1-142A 1	2.41
927461	AC1-142A 2	2.41
927511	AC1-113 1	0.7
927521	AC1-113 2	0.7
930042	AB1-006 E	16.99
930391	AB1-080	1.7
930481	AB1-089	38.61
930501	AB1-091 O1	40.0
930741	AB1-122 1O1	41.84
930751	AB1-122 2O1	42.51
932601	AC2-080 C O1	3.72
932602	AC2-080 E O1	24.87
932881	AC2-115 1	1.4
932891	AC2-115 2	1.4
932921	AC2-116	0.49
932931	AC2-117	5.16
933411	AC2-154 C	1.4
933412	AC2-154 E	2.28
933431	AC2-156 C O1	0.55
933432	AC2-156 E O1	0.9
933911	AD1-013 C	1.08
933912	AD1-013 E	1.73
933931	AD1-016 C	0.54
933932	AD1-016 E	0.88
934101	AD1-039 1	4.1
934111	AD1-039 2	4.17
934401	AD1-064 C O1	1.87
934402	AD1-064 E O1	8.77
934431	AD1-067 C	0.08
934432	AD1-067 E	0.32
934701	AD1-098 C O1	4.04
934702	AD1-098 E O1	2.95
934721	AD1-100 C	11.08
934722	AD1-100 E	51.72
934871	AD1-116 C	0.57
934872	AD1-116 E	0.93

Bus #	Bus	MW Impact
934971	AD1-129 C	0.53
934972	AD1-129 E	0.35
935001	AD1-133 C O1	11.14
935002	AD1-133 E O1	7.43
935271	AD1-137 C	5.67
935272	AD1-137 E	37.94
936291	AD2-038 C O1	1.4
936292	AD2-038 E O1	9.4
936371	AD2-047 C O1	1.25
936372	AD2-047 E O1	13.44
936461	AD2-060	1.47
936511	AD2-066 C O1	4.97
936512	AD2-066 E O1	3.31
936781	AD2-101 C	2.47
936782	AD2-101 E	11.55
937001	AD2-134 C	1.61
937002	AD2-134 E	6.63
937031	AD2-137 C O1	1.91
937032	AD2-137 E O1	8.97
937041	AD2-138 C	5.03
937042	AD2-138 E	23.55
937051	AD2-140 C O1	1.91
937052	AD2-140 E O1	8.96
937061	AD2-141 C O1	1.9
937062	AD2-141 E O1	8.97
937071	AD2-142 C O1	3.83
937072	AD2-142 E O1	17.91
937121	AD2-148 C O1	1.92
937122	AD2-148 E O1	8.99
937131	AD2-149 C O1	1.92
937132	AD2-149 E O1	8.99
937141	AD2-150 C O1	1.92
937142	AD2-150 E O1	8.99
937181	AD2-155 C O1	1.92
937182	AD2-155 E O1	8.99
937321	AD2-175 C	8.94
937322	AD2-175 E	5.96
937331	AD2-176 C O1	4.28
937332	AD2-176 E O1	2.85
937401	AD2-194 1	4.49
937411	AD2-194 2	4.49
938012	AE1-002 E O1	3.84
938511	AE1-070 1	5.28
938521	AE1-070 2	4.83
938851	AE1-113 C O1	5.17
938852	AE1-113 E O1	16.24
939321	AE1-163 C O1	3.53
939322	AE1-163 E O1	21.69
939351	AE1-166 C O1	5.83
939352	AE1-166 E O1	5.39
939401	AE1-172 C O1	3.7
939402	AE1-172 E O1	17.32

Bus #	Bus	MW Impact
939641	AE1-194 C	5.59
939642	AE1-194 E	37.41
939651	AE1-195 C	5.59
939652	AE1-195 E	37.41
939691	AE1-199	1.4
939701	AE1-201 C	1.17
939702	AE1-201 E	0.26
939732	AE1-204 E	0.17
939861	AE1-222 1	46.21
939871	AE1-222 2	46.95
939921	AE1-228 C O1	5.9
939922	AE1-228 E O1	3.93
940101	AE1-252 C O1	6.31
940102	AE1-252 E O1	4.2
940262	AE2-008 BAT	34.37
940581	AE2-045 C O1	12.66
940582	AE2-045 E O1	17.38
940621	AE2-049 C O1	5.07
940622	AE2-049 E O1	3.38
940631	AE2-050 C O1	6.95
940632	AE2-050 E O1	4.63
940752	AE2-062 E	0.07
940762	AE2-063 E	0.07
941131	AE2-107 C	4.26
941132	AE2-107 E	2.84
941551	AE2-152 C	7.48
941552	AE2-152 E	3.74
941561	AE2-153 C O1	2.67
941562	AE2-153 E O1	12.48
941571	AE2-154 C	3.17
941572	AE2-154 E	21.24
942421	AE2-255 C O1	1.78
942422	AE2-255 E O1	5.35
942651	AE2-281 C	0.5
942652	AE2-281 E	3.1
942881	AE2-307 C	12.74
942882	AE2-307 E	4.63
942911	AE2-310 C	4.93
942912	AE2-310 E	1.33
942991	AE2-321 C O1	4.77
942992	AE2-321 E O1	2.35
943121	AE2-341 C	7.34
943122	AE2-341 E	3.61
CARR	CARR	0.6
CATAWBA	CATAWBA	0.06
CBM-S1	CBM-S1	4.5
CBM-W1	CBM-W1	19.69
CBM-W2	CBM-W2	68.05
CIN	CIN	6.99
G-007	G-007	1.67
HAMLET	HAMLET	0.18
IPL	IPL	3.23

Bus #	Bus	MW Impact
LGEE	LGEE	0.71
MEC	MEC	25.2
O-066	O-066	10.74
RENSSELAER	RENSSELAER	0.48
WEC	WEC	4.68
Z1-043	Z1-043	17.58

17.2 Index 2

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC/DC	MW IMPACT
2229371	255104	17GREEN_ACR E	NIPS	270771	GREENACR E; T	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	111.95	112.08	DC	17.86

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	8.05
274722	S-055 E	7.51
274751	CRETE EC ;1U	1.53
274752	CRETE EC ;2U	1.53
274753	CRETE EC ;3U	1.53
274754	CRETE EC ;4U	1.53
274788	SE CHICAG;5U	3.6
274789	SE CHICAG;6U	3.6
274790	SE CHICAG;7U	3.6
274791	SE CHICAG;8U	3.6
274792	SE CHICAG;9U	3.65
274793	SE CHICAG;0U	3.65
274794	SE CHICAG;1U	3.65
274795	SE CHICAG;2U	3.65
274859	EASYR;U1 E	7.29
274860	EASYR;U2 E	7.29
274888	PILOT HIL;1E	12.38
274890	CAYUG;1U E	8.9
274891	CAYUG;2U E	8.9
275149	KEMPTON ;1E	12.38
290021	O50 E	12.96
290051	GSG-6; E	6.93
290108	LEEDK;1U E	16.12
293061	N-015 E	10.22
293516	O-009 E1	2.6
293517	O-009 E2	1.32
293518	O-009 E3	1.45
293644	O22 E1	7.23
293645	O22 E2	14.04
293715	O-029 E	6.46
293716	O-029 E	3.54
293717	O-029 E	3.26
294392	P-010 E	12.98
294763	P-046 E	6.22
295109	WESTBROOK E	3.71
295111	SUBLETTE E	1.72
910542	X3-005 E	0.52
914641	Y2-103	30.04
915011	Y3-013 1	2.5
915021	Y3-013 2	2.5
915031	Y3-013 3	2.5
916221	Z1-073 E	3.58

Bus #	Bus	MW Impact
916502	Z1-106 E1	0.84
916504	Z1-106 E2	0.84
916512	Z1-107 E	1.71
916522	Z1-108 E	1.66
918052	AA1-018 E	10.6
919221	AA1-146	11.65
919581	AA2-030	11.65
920272	AA2-123 E	1.63
924471	AB2-096	28.16
925161	AB2-173	2.08
925302	AB2-191 E	0.92
926311	AC1-109 1	1.27
926321	AC1-109 2	1.27
926331	AC1-110 1	1.26
926341	AC1-110 2	1.26
926351	AC1-111 1	0.51
926361	AC1-111 2	0.51
926371	AC1-111 3	0.51
926381	AC1-111 4	0.51
926391	AC1-111 5	0.51
926401	AC1-111 6	0.51
926431	AC1-114	1.58
926821	AC1-168 C O1	0.76
926822	AC1-168 E O1	5.07
927091	AC1-204 1	48.7
927101	AC1-204 2	48.66
927451	AC1-142A 1	2.83
927461	AC1-142A 2	2.83
927511	AC1-113 1	0.79
927521	AC1-113 2	0.79
927531	AC1-185 1	0.46
927541	AC1-185 2	0.46
927551	AC1-185 3	0.46
927561	AC1-185 4	0.46
927571	AC1-185 5	0.46
927581	AC1-185 6	0.46
927591	AC1-185 7	0.46
927601	AC1-185 8	0.46
930481	AB1-089	43.69
930501	AB1-091 O1	49.08
930741	AB1-122 1O1	47.51
930751	AB1-122 2O1	49.68
932881	AC2-115 1	1.58
932891	AC2-115 2	1.58
932921	AC2-116	0.55
933341	AC2-147 C	0.58
933342	AC2-147 E	0.94
933411	AC2-154 C	1.68
933412	AC2-154 E	2.74
933431	AC2-156 C O1	0.63
933432	AC2-156 E O1	1.04
933911	AD1-013 C	1.22

Bus #	Bus	MW Impact
933912	AD1-013 E	1.95
933931	AD1-016 C	0.62
933932	AD1-016 E	1.01
934101	AD1-039 1	4.66
934111	AD1-039 2	4.87
934401	AD1-064 C O1	2.13
934402	AD1-064 E O1	9.97
934431	AD1-067 C	0.09
934432	AD1-067 E	0.37
934651	AD1-096 C	0.59
934652	AD1-096 E	0.97
934701	AD1-098 C O1	4.56
934702	AD1-098 E O1	3.33
934721	AD1-100 C	12.92
934722	AD1-100 E	60.3
934871	AD1-116 C	0.62
934872	AD1-116 E	1.01
934971	AD1-129 C	0.6
934972	AD1-129 E	0.4
935001	AD1-133 C O1	13.71
935002	AD1-133 E O1	9.14
936291	AD2-038 C O1	1.54
936292	AD2-038 E O1	10.3
936371	AD2-047 C O1	1.5
936372	AD2-047 E O1	16.18
936461	AD2-060	1.77
936511	AD2-066 C O1	5.55
936512	AD2-066 E O1	3.7
936781	AD2-101 C	3.17
936782	AD2-101 E	14.82
936791	AD2-102 C	7.99
936792	AD2-102 E	7.67
937001	AD2-134 C	1.81
937002	AD2-134 E	7.49
937031	AD2-137 C O1	2.3
937032	AD2-137 E O1	10.79
937051	AD2-140 C O1	2.32
937052	AD2-140 E O1	10.85
937061	AD2-141 C O1	2.3
937062	AD2-141 E O1	10.86
937071	AD2-142 C O1	4.64
937072	AD2-142 E O1	21.7
937121	AD2-148 C O1	2.36
937122	AD2-148 E O1	11.03
937131	AD2-149 C O1	2.36
937132	AD2-149 E O1	11.03
937141	AD2-150 C O1	2.36
937142	AD2-150 E O1	11.03
937181	AD2-155 C O1	2.36
937182	AD2-155 E O1	11.03
937311	AD2-172 C	1.63
937312	AD2-172 E	2.26

Bus #	Bus	MW Impact
937321	AD2-175 C	10.97
937322	AD2-175 E	7.32
937331	AD2-176 C O1	4.88
937332	AD2-176 E O1	3.25
937401	AD2-194 1	5.24
937411	AD2-194 2	5.23
938012	AE1-002 E O1	4.63
938511	AE1-070 1	6.15
938521	AE1-070 2	5.63
938851	AE1-113 C O1	5.87
938852	AE1-113 E O1	18.44
938861	AE1-114 C O1	2.38
938862	AE1-114 E O1	9.11
939051	AE1-134 1	0.9
939061	AE1-134 2	0.9
939321	AE1-163 C O1	3.87
939322	AE1-163 E O1	23.76
939351	AE1-166 C O1	6.83
939352	AE1-166 E O1	6.3
939401	AE1-172 C O1	4.09
939402	AE1-172 E O1	19.14
939641	AE1-194 C	10.88
939642	AE1-194 E	72.79
939651	AE1-195 C	10.88
939652	AE1-195 E	72.79
939691	AE1-199	1.59
939701	AE1-201 C	1.33
939702	AE1-201 E	0.29
939732	AE1-204 E	0.2
939861	AE1-222 1	52.47
939871	AE1-222 2	54.86
939921	AE1-228 C O1	6.67
939922	AE1-228 E O1	4.44
940101	AE1-252 C O1	6.97
940102	AE1-252 E O1	4.65
940501	AE2-035 C	1.63
940502	AE2-035 E	2.26
940621	AE2-049 C O1	6.08
940622	AE2-049 E O1	4.05
940631	AE2-050 C O1	8.29
940632	AE2-050 E O1	5.53
940752	AE2-062 E	0.09
940762	AE2-063 E	0.09
940881	AE2-077 C	2.09
940882	AE2-077 E	3.42
941131	AE2-107 C	4.85
941132	AE2-107 E	3.23
941551	AE2-152 C	8.75
941552	AE2-152 E	4.38
941561	AE2-153 C O1	3.14
941562	AE2-153 E O1	14.71
942421	AE2-255 C O1	2.03

Bus #	Bus	MW Impact
942422	AE2-255 E O1	6.08
942651	AE2-281 C	0.55
942652	AE2-281 E	3.39
942881	AE2-307 C	15.2
942882	AE2-307 E	5.53
942911	AE2-310 C	5.9
942912	AE2-310 E	1.59
942991	AE2-321 C O1	5.44
942992	AE2-321 E O1	2.68
943121	AE2-341 C	8.47
943122	AE2-341 E	4.16
951721	J643	15.48
952581	J740 C	3.4
952582	J740 E	18.4
953871	J847	8.37
BLUEG	BLUEG	2.92
CANNELTON	CANNELTON	0.01
CARR	CARR	0.5
CATAWBA	CATAWBA	0.17
CBM-S1	CBM-S1	1.3
CBM-W1	CBM-W1	20.03
CBM-W2	CBM-W2	38.32
CHEOAH	CHEOAH	0.0
CIN	CIN	0.09
G-007	G-007	1.39
HAMLET	HAMLET	0.33
MEC	MEC	24.99
O-066	O-066	8.94
RENSSELAER	RENSSELAER	0.4
SANTEETLA	SANTEETLA	0.0
TRIMBLE	TRIMBLE	0.35
WEC	WEC	5.32
Z1-043	Z1-043	18.79

17.3 Index 3

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229242	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_112-65-BT3-4__	breaker	1091.0	132.85	133.0	DC	19.85

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.0
274654	BRAIDWOOD;1U	15.1
274655	BRAIDWOOD;2U	14.45
274687	WILL CNTY;4U	6.37
274704	KENDALL ;1C	2.23
274705	KENDALL ;1S	1.49
274706	KENDALL ;2C	2.23
274707	KENDALL ;2S	1.49
274722	S-055 E	8.42
274751	CRETE EC ;1U	2.67
274752	CRETE EC ;2U	2.67
274753	CRETE EC ;3U	2.67
274754	CRETE EC ;4U	2.67
274859	EASYR;U1 E	8.13
274860	EASYR;U2 E	8.13
274861	TOP CROP ;1U	0.26
274862	TOP CROP ;2U	0.5
274888	PILOT HIL;1E	12.78
275149	KEMPTON ;1E	12.78
290021	O50 E	14.61
290051	GSG-6; E	7.74
290108	LEEDK;1U E	17.99
293061	N-015 E	11.56
293644	O22 E1	8.49
293645	O22 E2	16.47
294392	P-010 E	14.68
294763	P-046 E	6.95
295109	WESTBROOK E	4.14
295111	SUBLETTE E	1.91
914641	Y2-103	33.66
915011	Y3-013 1	2.81
915021	Y3-013 2	2.81
915031	Y3-013 3	2.81
916221	Z1-073 E	3.99
916502	Z1-106 E1	0.94
916504	Z1-106 E2	0.94
916512	Z1-107 E	1.85
916522	Z1-108 E	1.85
918052	AA1-018 E	11.61
919581	AA2-030	10.03
920272	AA2-123 E	1.82

Bus #	Bus	MW Impact
924471	AB2-096	31.49
925161	AB2-173	2.32
925302	AB2-191 E	1.02
926311	AC1-109 1	1.41
926321	AC1-109 2	1.41
926331	AC1-110 1	1.41
926341	AC1-110 2	1.41
926351	AC1-111 1	0.57
926361	AC1-111 2	0.57
926371	AC1-111 3	0.57
926381	AC1-111 4	0.57
926391	AC1-111 5	0.57
926401	AC1-111 6	0.57
926431	AC1-114	1.77
927091	AC1-204 1	55.1
927101	AC1-204 2	55.02
927451	AC1-142A 1	3.19
927461	AC1-142A 2	3.19
927511	AC1-113 1	0.88
927521	AC1-113 2	0.88
927531	AC1-185 1	0.51
927541	AC1-185 2	0.51
927551	AC1-185 3	0.51
927561	AC1-185 4	0.51
927571	AC1-185 5	0.51
927581	AC1-185 6	0.51
927591	AC1-185 7	0.51
927601	AC1-185 8	0.51
930481	AB1-089	48.82
930501	AB1-091 O1	50.48
930741	AB1-122 1O1	52.93
930751	AB1-122 2O1	56.18
932881	AC2-115 1	1.77
932891	AC2-115 2	1.77
932921	AC2-116	0.62
933341	AC2-147 C	0.64
933342	AC2-147 E	1.05
933411	AC2-154 C	1.73
933412	AC2-154 E	2.83
933431	AC2-156 C O1	0.71
933432	AC2-156 E O1	1.15
933911	AD1-013 C	1.36
933912	AD1-013 E	2.18
933931	AD1-016 C	0.69
933932	AD1-016 E	1.13
934101	AD1-039 1	5.19
934111	AD1-039 2	5.51
934401	AD1-064 C O1	2.38
934402	AD1-064 E O1	11.15
934431	AD1-067 C	0.1
934432	AD1-067 E	0.41
934651	AD1-096 C	0.66

Bus #	Bus	MW Impact
934652	AD1-096 E	1.08
934701	AD1-098 C O1	5.09
934702	AD1-098 E O1	3.72
934721	AD1-100 C	14.25
934722	AD1-100 E	66.49
934871	AD1-116 C	0.68
934872	AD1-116 E	1.1
934971	AD1-129 C	0.67
934972	AD1-129 E	0.45
935001	AD1-133 C O1	15.14
935002	AD1-133 E O1	10.09
936291	AD2-038 C O1	1.71
936292	AD2-038 E O1	11.43
936371	AD2-047 C O1	1.55
936372	AD2-047 E O1	16.7
936461	AD2-060	1.83
936511	AD2-066 C O1	6.17
936512	AD2-066 E O1	4.12
936781	AD2-101 C	3.08
936782	AD2-101 E	14.43
936791	AD2-102 C	8.92
936792	AD2-102 E	8.57
937001	AD2-134 C	2.02
937002	AD2-134 E	8.36
937031	AD2-137 C O1	2.44
937032	AD2-137 E O1	11.44
937051	AD2-140 C O1	2.44
937052	AD2-140 E O1	11.44
937061	AD2-141 C O1	2.43
937062	AD2-141 E O1	11.45
937071	AD2-142 C O1	4.89
937072	AD2-142 E O1	22.88
937121	AD2-148 C O1	2.42
937122	AD2-148 E O1	11.35
937131	AD2-149 C O1	2.42
937132	AD2-149 E O1	11.35
937141	AD2-150 C O1	2.42
937142	AD2-150 E O1	11.35
937181	AD2-155 C O1	2.42
937182	AD2-155 E O1	11.35
937311	AD2-172 C	1.82
937312	AD2-172 E	2.52
937321	AD2-175 C	11.29
937322	AD2-175 E	7.53
937331	AD2-176 C O1	5.46
937332	AD2-176 E O1	3.64
937401	AD2-194 1	5.92
937411	AD2-194 2	5.92
938012	AE1-002 E O1	4.91
938511	AE1-070 1	6.96
938521	AE1-070 2	6.36
938851	AE1-113 C O1	6.61

Bus #	Bus	MW Impact
938852	AE1-113 E O1	20.79
938861	AE1-114 C O1	2.66
938862	AE1-114 E O1	10.17
939051	AE1-134 1	1.01
939061	AE1-134 2	1.01
939321	AE1-163 C O1	4.29
939322	AE1-163 E O1	26.35
939351	AE1-166 C O1	7.59
939352	AE1-166 E O1	7.0
939401	AE1-172 C O1	4.47
939402	AE1-172 E O1	20.92
939641	AE1-194 C	18.94
939642	AE1-194 E	126.78
939651	AE1-195 C	18.94
939652	AE1-195 E	126.78
939691	AE1-199	1.77
939701	AE1-201 C	1.49
939702	AE1-201 E	0.33
939732	AE1-204 E	0.22
939861	AE1-222 1	58.46
939871	AE1-222 2	62.04
939921	AE1-228 C O1	7.44
939922	AE1-228 E O1	4.96
940101	AE1-252 C O1	7.62
940102	AE1-252 E O1	5.08
940501	AE2-035 C	1.82
940502	AE2-035 E	2.52
940621	AE2-049 C O1	6.33
940622	AE2-049 E O1	4.22
940631	AE2-050 C O1	9.84
940632	AE2-050 E O1	6.56
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.34
940882	AE2-077 E	3.82
941131	AE2-107 C	5.42
941132	AE2-107 E	3.61
941551	AE2-152 C	9.73
941552	AE2-152 E	4.86
941561	AE2-153 C O1	3.49
941562	AE2-153 E O1	16.36
942421	AE2-255 C O1	2.28
942422	AE2-255 E O1	6.85
942651	AE2-281 C	0.61
942652	AE2-281 E	3.76
942881	AE2-307 C	18.05
942882	AE2-307 E	6.56
942911	AE2-310 C	6.14
942912	AE2-310 E	1.66
942991	AE2-321 C O1	6.08
942992	AE2-321 E O1	3.0
943121	AE2-341 C	9.44

Bus #	Bus	MW Impact
943122	AE2-341 E	4.64
BLUEG	BLUEG	5.15
CALDERWOOD	CALDERWOOD	0.1
CANNELTON	CANNELTON	0.11
CARR	CARR	0.57
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	0.68
CBM-W1	CBM-W1	20.0
CBM-W2	CBM-W2	36.78
CHEOAH	CHEOAH	0.1
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.15
G-007	G-007	1.6
GIBSON	GIBSON	0.07
HAMLET	HAMLET	0.45
MEC	MEC	27.44
O-066	O-066	10.24
RENSSELAER	RENSSELAER	0.45
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.6
WEC	WEC	5.95
Z1-043	Z1-043	20.9

17.4 Index 4

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC D C	MW IMPAC T
1541920	255113	17STILLWEL L	NIPS	243219	05DUMON T	AEP	1	AEP_P4_#2978_05DUMON T 765_B	breaker	1409.0	173.14	173.3	DC	30.78

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	13.9
274722	S-055 E	12.93
274724	RIVER EC ;11	3.77
274788	SE CHICAG;5U	7.41
274789	SE CHICAG;6U	7.41
274790	SE CHICAG;7U	7.41
274791	SE CHICAG;8U	7.41
274792	SE CHICAG;9U	7.31
274793	SE CHICAG;0U	7.31
274794	SE CHICAG;1U	7.31
274795	SE CHICAG;2U	7.31
274832	U4-027	12.43
274859	EASYR;U1 E	12.65
274860	EASYR;U2 E	12.65
274888	PILOT HIL;1E	22.27
274890	CAYUG;1U E	15.74
274891	CAYUG;2U E	15.74
275149	KEMPTON ;1E	22.27
290021	O50 E	22.28
290051	GSG-6; E	12.01
290108	LEEDK;1U E	27.88
293061	N-015 E	17.51
293516	O-009 E1	10.43
293517	O-009 E2	5.3
293518	O-009 E3	5.84
293644	O22 E1	11.93
293645	O22 E2	23.17
293715	O-029 E	11.25
293716	O-029 E	6.17
293717	O-029 E	5.67
293771	O-035 E	7.35
294392	P-010 E	22.24
294763	P-046 E	10.78
295109	WESTBROOK E	6.43
295111	SUBLETTE E	2.98
910542	X3-005 E	1.0
914641	Y2-103	51.72
915011	Y3-013 1	4.31
915021	Y3-013 2	4.31
915031	Y3-013 3	4.31
916211	Z1-072 E	5.56
916221	Z1-073 E	6.19

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.45
916504	Z1-106 E2	1.45
916512	Z1-107 E	3.03
916522	Z1-108 E	2.86
918052	AA1-018 E	18.71
919221	AA1-146	20.25
919581	AA2-030	20.25
920272	AA2-123 E	2.81
924471	AB2-096	48.66
925161	AB2-173	3.61
925302	AB2-191 E	1.59
926311	AC1-109 1	2.19
926321	AC1-109 2	2.19
926331	AC1-110 1	2.18
926341	AC1-110 2	2.18
926351	AC1-111 1	0.87
926361	AC1-111 2	0.87
926371	AC1-111 3	0.87
926381	AC1-111 4	0.87
926391	AC1-111 5	0.87
926401	AC1-111 6	0.87
926431	AC1-114	2.74
926821	AC1-168 C O1	1.32
926822	AC1-168 E O1	8.84
927091	AC1-204 1	83.15
927101	AC1-204 2	83.12
927201	AC1-214 C O1	2.36
927202	AC1-214 E O1	7.5
927451	AC1-142A 1	4.83
927461	AC1-142A 2	4.83
927511	AC1-113 1	1.37
927521	AC1-113 2	1.37
927531	AC1-185 1	0.79
927541	AC1-185 2	0.79
927551	AC1-185 3	0.79
927561	AC1-185 4	0.79
927571	AC1-185 5	0.79
927581	AC1-185 6	0.79
927591	AC1-185 7	0.79
927601	AC1-185 8	0.79
930481	AB1-089	75.56
930501	AB1-091 O1	88.11
930741	AB1-122 1O1	82.31
930751	AB1-122 2O1	84.84
932881	AC2-115 1	2.74
932891	AC2-115 2	2.74
932921	AC2-116	0.96
932931	AC2-117	5.8
933341	AC2-147 C	1.0
933342	AC2-147 E	1.64
933411	AC2-154 C	3.02
933412	AC2-154 E	4.93

Bus #	Bus	MW Impact
933431	AC2-156 C O1	1.1
933432	AC2-156 E O1	1.79
933911	AD1-013 C	2.11
933912	AD1-013 E	3.38
933931	AD1-016 C	1.07
933932	AD1-016 E	1.74
934101	AD1-039 1	8.07
934111	AD1-039 2	8.31
934401	AD1-064 C O1	3.68
934402	AD1-064 E O1	17.23
934431	AD1-067 C	0.15
934432	AD1-067 E	0.63
934651	AD1-096 C	1.03
934652	AD1-096 E	1.67
934701	AD1-098 C O1	7.9
934702	AD1-098 E O1	5.77
934721	AD1-100 C	22.42
934722	AD1-100 E	104.62
934871	AD1-116 C	1.09
934872	AD1-116 E	1.78
934971	AD1-129 C	1.04
934972	AD1-129 E	0.69
935001	AD1-133 C O1	24.03
935002	AD1-133 E O1	16.02
936291	AD2-038 C O1	2.69
936292	AD2-038 E O1	18.0
936371	AD2-047 C O1	2.7
936372	AD2-047 E O1	29.11
936461	AD2-060	3.18
936511	AD2-066 C O1	9.66
936512	AD2-066 E O1	6.44
936781	AD2-101 C	5.89
936782	AD2-101 E	27.59
936791	AD2-102 C	13.83
936792	AD2-102 E	13.28
937001	AD2-134 C	3.14
937002	AD2-134 E	12.96
937031	AD2-137 C O1	4.07
937032	AD2-137 E O1	19.06
937051	AD2-140 C O1	4.11
937052	AD2-140 E O1	19.23
937061	AD2-141 C O1	4.08
937062	AD2-141 E O1	19.25
937071	AD2-142 C O1	8.21
937072	AD2-142 E O1	38.45
937121	AD2-148 C O1	4.23
937122	AD2-148 E O1	19.8
937131	AD2-149 C O1	4.23
937132	AD2-149 E O1	19.8
937141	AD2-150 C O1	4.23
937142	AD2-150 E O1	19.8
937181	AD2-155 C O1	4.23

Bus #	Bus	MW Impact
937182	AD2-155 E O1	19.8
937311	AD2-172 C	2.83
937312	AD2-172 E	3.91
937321	AD2-175 C	19.7
937322	AD2-175 E	13.13
937331	AD2-176 C O1	8.42
937332	AD2-176 E O1	5.62
937401	AD2-194 1	8.94
937411	AD2-194 2	8.94
937531	AD2-214 C	5.09
937532	AD2-214 E	2.39
938012	AE1-002 E O1	8.17
938511	AE1-070 1	10.51
938521	AE1-070 2	9.61
938851	AE1-113 C O1	10.08
938852	AE1-113 E O1	31.69
938861	AE1-114 C O1	4.14
938862	AE1-114 E O1	15.81
939051	AE1-134 1	1.57
939061	AE1-134 2	1.57
939321	AE1-163 C O1	6.76
939322	AE1-163 E O1	41.51
939351	AE1-166 C O1	11.78
939352	AE1-166 E O1	10.87
939401	AE1-172 C O1	7.2
939402	AE1-172 E O1	33.69
939641	AE1-194 C	10.23
939642	AE1-194 E	68.46
939651	AE1-195 C	10.23
939652	AE1-195 E	68.46
939681	AE1-198 C O1	23.4
939682	AE1-198 E O1	19.88
939691	AE1-199	2.74
939701	AE1-201 C	2.3
939702	AE1-201 E	0.51
939732	AE1-204 E	0.34
939861	AE1-222 1	90.89
939871	AE1-222 2	93.69
939921	AE1-228 C O1	11.54
939922	AE1-228 E O1	7.7
940101	AE1-252 C O1	12.26
940102	AE1-252 E O1	8.18
940501	AE2-035 C	2.83
940502	AE2-035 E	3.91
940621	AE2-049 C O1	10.89
940622	AE2-049 E O1	7.26
940631	AE2-050 C O1	13.62
940632	AE2-050 E O1	9.08
940752	AE2-062 E	0.15
940762	AE2-063 E	0.15
940881	AE2-077 C	3.62
940882	AE2-077 E	5.91

Bus #	Bus	MW Impact
941131	AE2-107 C	8.39
941132	AE2-107 E	5.59
941551	AE2-152 C	15.1
941552	AE2-152 E	7.55
941561	AE2-153 C O1	5.42
941562	AE2-153 E O1	25.36
942421	AE2-255 C O1	3.48
942422	AE2-255 E O1	10.44
942651	AE2-281 C	0.97
942652	AE2-281 E	5.93
942881	AE2-307 C	24.97
942882	AE2-307 E	9.08
942911	AE2-310 C	10.57
942912	AE2-310 E	2.86
942991	AE2-321 C O1	9.39
942992	AE2-321 E O1	4.62
943121	AE2-341 C	14.63
943122	AE2-341 E	7.18
951721	J643	25.68
952581	J740 C	4.29
952582	J740 E	23.24
953871	J847	13.08
954751	J351	434.36
BLUEG	BLUEG	1.17
CARR	CARR	0.91
CATAWBA	CATAWBA	0.23
CBM-S1	CBM-S1	3.86
CBM-W1	CBM-W1	35.93
CBM-W2	CBM-W2	81.92
CIN	CIN	3.25
G-007	G-007	2.53
HAMLET	HAMLET	0.49
IPL	IPL	1.09
MEC	MEC	44.6
O-066	O-066	16.24
RENSSELAER	RENSSELAER	0.72
TRIMBLE	TRIMBLE	0.18
WEC	WEC	9.18
Z1-043	Z1-043	32.87

17.5 Index 5

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1543537	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L94507_B-S+_345-L97008_R-S	tower	4105.0	107.08	107.19	DC	65.94

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	32.1
274722	S-055 E	29.48
274772	LINCOLN ;3U	3.73
274773	LINCOLN ;4U	3.73
274774	LINCOLN ;5U	3.73
274775	LINCOLN ;6U	3.73
274776	LINCOLN ;7U	3.73
274777	LINCOLN ;8U	3.73
274832	U4-027	27.98
274859	EASYR;U1 E	29.06
274860	EASYR;U2 E	29.06
274888	PILOT HIL;1E	44.2
274890	CAYUG;1U E	35.98
274891	CAYUG;2U E	35.98
275149	KEMPTON ;1E	44.2
290021	O50 E	49.12
290051	GSG-6; E	28.02
290108	LEEDK;1U E	65.42
293061	N-015 E	41.13
293516	O-009 E1	23.73
293517	O-009 E2	12.05
293518	O-009 E3	13.28
293644	O22 E1	25.25
293645	O22 E2	49.01
293715	O-029 E	25.71
293716	O-029 E	14.1
293717	O-029 E	12.96
293771	O-035 E	16.45
294392	P-010 E	52.23
294763	P-046 E	24.82
295109	WESTBROOK E	15.0
295111	SUBLETTE E	6.85
296125	R-030 C3	6.6
296128	R-030 E3	26.39
296271	R-030 C2	6.52
296272	R-030 E2	26.07
296308	R-030 C1	6.52
296309	R-030 E1	26.07
910542	X3-005 E	1.57
914641	Y2-103	117.92

Bus #	Bus	MW Impact
915011	Y3-013 1	9.83
915021	Y3-013 2	9.83
915031	Y3-013 3	9.83
916211	Z1-072 E	12.45
916221	Z1-073 E	14.46
916502	Z1-106 E1	3.4
916504	Z1-106 E2	3.4
916512	Z1-107 E	6.51
916522	Z1-108 E	6.61
918052	AA1-018 E	40.31
919221	AA1-146	46.38
919581	AA2-030	46.38
920272	AA2-123 E	6.49
924471	AB2-096	112.35
925161	AB2-173	8.27
925302	AB2-191 E	3.71
926311	AC1-109 1	5.2
926321	AC1-109 2	5.2
926331	AC1-110 1	5.11
926341	AC1-110 2	5.11
926351	AC1-111 1	2.06
926361	AC1-111 2	2.06
926371	AC1-111 3	2.06
926381	AC1-111 4	2.06
926391	AC1-111 5	2.06
926401	AC1-111 6	2.06
926431	AC1-114	6.31
926821	AC1-168 C O1	2.97
926822	AC1-168 E O1	19.96
927091	AC1-204 1	183.86
927101	AC1-204 2	183.9
927201	AC1-214 C O1	5.28
927202	AC1-214 E O1	16.78
927451	AC1-142A 1	10.58
927461	AC1-142A 2	10.58
927511	AC1-113 1	3.15
927521	AC1-113 2	3.15
927531	AC1-185 1	1.82
927541	AC1-185 2	1.82
927551	AC1-185 3	1.82
927561	AC1-185 4	1.82
927571	AC1-185 5	1.82
927581	AC1-185 6	1.82
927591	AC1-185 7	1.82
927601	AC1-185 8	1.82
930481	AB1-089	174.75
930501	AB1-091 O1	173.56
930741	AB1-122 1O1	194.52
930751	AB1-122 2O1	188.25
932881	AC2-115 1	6.31
932891	AC2-115 2	6.31
932921	AC2-116	2.21

Bus #	Bus	MW Impact
932931	AC2-117	14.91
933341	AC2-147 C	2.31
933342	AC2-147 E	3.76
933411	AC2-154 C	6.0
933412	AC2-154 E	9.79
933431	AC2-156 C O1	2.63
933432	AC2-156 E O1	4.29
933911	AD1-013 C	4.93
933912	AD1-013 E	7.88
933931	AD1-016 C	2.47
933932	AD1-016 E	4.02
934101	AD1-039 1	19.06
934111	AD1-039 2	18.45
934401	AD1-064 C O1	8.54
934402	AD1-064 E O1	39.99
934431	AD1-067 C	0.35
934432	AD1-067 E	1.48
934651	AD1-096 C	2.36
934652	AD1-096 E	3.85
934701	AD1-098 C O1	18.42
934702	AD1-098 E O1	13.45
934721	AD1-100 C	50.93
934722	AD1-100 E	237.66
934871	AD1-116 C	2.35
934872	AD1-116 E	3.83
934971	AD1-129 C	2.4
934972	AD1-129 E	1.6
935001	AD1-133 C O1	55.82
935002	AD1-133 E O1	37.21
936291	AD2-038 C O1	5.84
936292	AD2-038 E O1	39.1
936371	AD2-047 C O1	5.37
936372	AD2-047 E O1	57.77
936461	AD2-060	6.31
936511	AD2-066 C O1	21.42
936512	AD2-066 E O1	14.28
936781	AD2-101 C	10.65
936782	AD2-101 E	49.86
936791	AD2-102 C	31.81
936792	AD2-102 E	30.56
937001	AD2-134 C	7.32
937002	AD2-134 E	30.26
937031	AD2-137 C O1	10.24
937032	AD2-137 E O1	47.92
937051	AD2-140 C O1	10.48
937052	AD2-140 E O1	49.08
937061	AD2-141 C O1	10.42
937062	AD2-141 E O1	49.14
937071	AD2-142 C O1	20.97
937072	AD2-142 E O1	98.16
937121	AD2-148 C O1	8.33
937122	AD2-148 E O1	39.01

Bus #	Bus	MW Impact
937131	AD2-149 C O1	8.33
937132	AD2-149 E O1	39.01
937141	AD2-150 C O1	8.33
937142	AD2-150 E O1	39.01
937181	AD2-155 C O1	8.33
937182	AD2-155 E O1	39.01
937311	AD2-172 C	6.51
937312	AD2-172 E	9.0
937321	AD2-175 C	38.82
937322	AD2-175 E	25.88
937331	AD2-176 C O1	19.48
937332	AD2-176 E O1	12.98
937401	AD2-194 1	19.77
937411	AD2-194 2	19.78
937531	AD2-214 C	11.57
937532	AD2-214 E	5.45
938012	AE1-002 E O1	20.55
938511	AE1-070 1	23.23
938521	AE1-070 2	21.26
938851	AE1-113 C O1	22.23
938852	AE1-113 E O1	69.88
938861	AE1-114 C O1	9.51
938862	AE1-114 E O1	36.36
939051	AE1-134 1	3.6
939061	AE1-134 2	3.6
939321	AE1-163 C O1	14.68
939322	AE1-163 E O1	90.19
939351	AE1-166 C O1	26.21
939352	AE1-166 E O1	24.2
939401	AE1-172 C O1	16.53
939402	AE1-172 E O1	77.39
939641	AE1-194 C	21.06
939642	AE1-194 E	140.92
939651	AE1-195 C	21.06
939652	AE1-195 E	140.92
939691	AE1-199	6.41
939701	AE1-201 C	5.32
939702	AE1-201 E	1.17
939732	AE1-204 E	0.77
939741	AE1-205 C O1	23.23
939742	AE1-205 E O1	32.07
939861	AE1-222 1	214.82
939871	AE1-222 2	207.89
939921	AE1-228 C O1	26.96
939922	AE1-228 E O1	17.97
940101	AE1-252 C O1	28.18
940102	AE1-252 E O1	18.78
940501	AE2-035 C	6.51
940502	AE2-035 E	9.0
940621	AE2-049 C O1	21.85
940622	AE2-049 E O1	14.57
940631	AE2-050 C O1	30.19

Bus #	Bus	MW Impact
940632	AE2-050 E O1	20.13
940752	AE2-062 E	0.33
940762	AE2-063 E	0.33
940881	AE2-077 C	8.36
940882	AE2-077 E	13.63
941131	AE2-107 C	19.71
941132	AE2-107 E	13.14
941551	AE2-152 C	33.61
941552	AE2-152 E	16.8
941561	AE2-153 C O1	11.6
941562	AE2-153 E O1	54.33
942421	AE2-255 C O1	7.68
942422	AE2-255 E O1	23.03
942651	AE2-281 C	2.1
942652	AE2-281 E	12.89
942881	AE2-307 C	55.35
942882	AE2-307 E	20.13
942911	AE2-310 C	21.22
942912	AE2-310 E	5.73
942991	AE2-321 C O1	21.71
942992	AE2-321 E O1	10.69
943121	AE2-341 C	35.31
943122	AE2-341 E	17.34
BLUEG	BLUEG	17.18
CALDERWOOD	CALDERWOOD	0.27
CANNELTON	CANNELTON	0.28
CARR	CARR	2.0
CATAWBA	CATAWBA	0.82
CBM-S1	CBM-S1	3.15
CBM-W1	CBM-W1	76.97
CBM-W2	CBM-W2	139.71
CHEOAH	CHEOAH	0.28
CHILHOWEE	CHILHOWEE	0.08
ELMERSMITH	ELMERSMITH	0.31
G-007	G-007	5.61
GIBSON	GIBSON	0.1
HAMLET	HAMLET	1.54
MEC	MEC	97.87
O-066	O-066	35.97
RENSSELAER	RENSSELAER	1.58
SANTEETLA	SANTEETLA	0.09
TRIMBLE	TRIMBLE	2.03
WEC	WEC	20.89
Z1-043	Z1-043	73.67

17.6 Index 6

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC D C	MW IMPAC T
222944 4	27067 7	BURNHAM ;OR	CE	25510 9	17MUNSTER	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1441.0	100.78	100.93	DC	26.85

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	11.72
274722	S-055 E	10.94
274723	RIVER EC ;12	3.43
274792	SE CHICAG;9U	6.24
274793	SE CHICAG;0U	6.24
274794	SE CHICAG;1U	6.24
274795	SE CHICAG;2U	6.24
274826	FSK ;BP	1.82
274832	U4-027	10.29
274859	EASYS;U1 E	10.59
274860	EASYS;U2 E	10.59
274888	PILOT HIL;1E	20.45
274890	CAYUG;1U E	13.37
274891	CAYUG;2U E	13.37
275149	KEMPTON ;1E	20.45
290021	O50 E	18.53
290051	GSG-6; E	10.11
290108	LEEDK;1U E	23.53
293061	N-015 E	14.79
293516	O-009 E1	8.68
293517	O-009 E2	4.41
293518	O-009 E3	4.86
293644	O22 E1	9.25
293645	O22 E2	17.95
293715	O-029 E	9.38
293716	O-029 E	5.14
293717	O-029 E	4.73
293771	O-035 E	6.07
294392	P-010 E	18.79
294763	P-046 E	9.05
295109	WESTBROOK E	5.41
295111	SUBLETTE E	2.49
296125	R-030 C3	3.42
296128	R-030 E3	13.68
296271	R-030 C2	3.38
296272	R-030 E2	13.51
296308	R-030 C1	3.38
296309	R-030 E1	13.51
910541	X3-005 C	0.07
910542	X3-005 E	0.91
914641	Y2-103	43.74
915011	Y3-013 1	3.65

Bus #	Bus	MW Impact
915021	Y3-013 2	3.65
915031	Y3-013 3	3.65
916211	Z1-072 E	4.6
916221	Z1-073 E	5.22
916502	Z1-106 E1	1.23
916504	Z1-106 E2	1.23
916512	Z1-107 E	2.58
916522	Z1-108 E	2.42
917502	Z2-087 E	7.1
918052	AA1-018 E	16.78
919221	AA1-146	16.9
919581	AA2-030	16.9
920272	AA2-123 E	2.37
924471	AB2-096	41.03
925161	AB2-173	3.01
925302	AB2-191 E	1.34
926311	AC1-109 1	1.86
926321	AC1-109 2	1.86
926331	AC1-110 1	1.85
926341	AC1-110 2	1.85
926351	AC1-111 1	0.74
926361	AC1-111 2	0.74
926371	AC1-111 3	0.74
926381	AC1-111 4	0.74
926391	AC1-111 5	0.74
926401	AC1-111 6	0.74
926431	AC1-114	2.3
926821	AC1-168 C O1	1.09
926822	AC1-168 E O1	7.34
927091	AC1-204 1	69.96
927101	AC1-204 2	70.02
927201	AC1-214 C O1	1.95
927202	AC1-214 E O1	6.2
927451	AC1-142A 1	4.09
927461	AC1-142A 2	4.08
927511	AC1-113 1	1.15
927521	AC1-113 2	1.15
927531	AC1-185 1	0.66
927541	AC1-185 2	0.66
927551	AC1-185 3	0.66
927561	AC1-185 4	0.66
927571	AC1-185 5	0.66
927581	AC1-185 6	0.66
927591	AC1-185 7	0.66
927601	AC1-185 8	0.66
930481	AB1-089	63.61
930501	AB1-091 O1	82.15
930741	AB1-122 1O1	69.9
930751	AB1-122 2O1	70.86
932881	AC2-115 1	2.3
932891	AC2-115 2	2.3
932921	AC2-116	0.81

Bus #	Bus	MW Impact
932931	AC2-117	5.29
933341	AC2-147 C	0.84
933342	AC2-147 E	1.37
933411	AC2-154 C	2.77
933412	AC2-154 E	4.53
933431	AC2-156 C O1	0.93
933432	AC2-156 E O1	1.52
933911	AD1-013 C	1.78
933912	AD1-013 E	2.84
933931	AD1-016 C	0.9
933932	AD1-016 E	1.47
934101	AD1-039 1	6.85
934111	AD1-039 2	6.94
934401	AD1-064 C O1	3.1
934402	AD1-064 E O1	14.53
934431	AD1-067 C	0.13
934432	AD1-067 E	0.53
934651	AD1-096 C	0.86
934652	AD1-096 E	1.4
934701	AD1-098 C O1	6.65
934702	AD1-098 E O1	4.86
934721	AD1-100 C	19.51
934722	AD1-100 E	91.04
934871	AD1-116 C	0.98
934872	AD1-116 E	1.59
934971	AD1-129 C	0.88
934972	AD1-129 E	0.58
935001	AD1-133 C O1	20.26
935002	AD1-133 E O1	13.5
936291	AD2-038 C O1	2.32
936292	AD2-038 E O1	15.55
936371	AD2-047 C O1	2.48
936372	AD2-047 E O1	26.73
936461	AD2-060	2.92
936511	AD2-066 C O1	8.12
936512	AD2-066 E O1	5.42
936781	AD2-101 C	4.74
936782	AD2-101 E	22.18
936791	AD2-102 C	11.62
936792	AD2-102 E	11.17
937001	AD2-134 C	2.64
937002	AD2-134 E	10.91
937031	AD2-137 C O1	3.66
937032	AD2-137 E O1	17.14
937051	AD2-140 C O1	3.71
937052	AD2-140 E O1	17.39
937061	AD2-141 C O1	3.69
937062	AD2-141 E O1	17.41
937071	AD2-142 C O1	7.43
937072	AD2-142 E O1	34.78
937121	AD2-148 C O1	3.93
937122	AD2-148 E O1	18.4

Bus #	Bus	MW Impact
937131	AD2-149 C O1	3.93
937132	AD2-149 E O1	18.4
937141	AD2-150 C O1	3.93
937142	AD2-150 E O1	18.4
937181	AD2-155 C O1	3.93
937182	AD2-155 E O1	18.4
937311	AD2-172 C	2.38
937312	AD2-172 E	3.28
937321	AD2-175 C	18.31
937322	AD2-175 E	12.21
937331	AD2-176 C O1	7.11
937332	AD2-176 E O1	4.74
937401	AD2-194 1	7.52
937411	AD2-194 2	7.53
937531	AD2-214 C	4.23
937532	AD2-214 E	1.99
938012	AE1-002 E O1	7.35
938511	AE1-070 1	8.84
938521	AE1-070 2	8.09
938851	AE1-113 C O1	8.39
938852	AE1-113 E O1	26.36
938861	AE1-114 C O1	3.47
938862	AE1-114 E O1	13.25
939051	AE1-134 1	1.31
939061	AE1-134 2	1.31
939321	AE1-163 C O1	5.84
939322	AE1-163 E O1	35.87
939351	AE1-166 C O1	10.21
939352	AE1-166 E O1	9.43
939401	AE1-172 C O1	6.17
939402	AE1-172 E O1	28.89
939691	AE1-199	2.31
939701	AE1-201 C	1.94
939702	AE1-201 E	0.43
939732	AE1-204 E	0.28
939741	AE1-205 C O1	8.55
939742	AE1-205 E O1	11.81
939861	AE1-222 1	77.19
939871	AE1-222 2	78.26
939921	AE1-228 C O1	9.72
939922	AE1-228 E O1	6.48
940101	AE1-252 C O1	10.52
940102	AE1-252 E O1	7.01
940501	AE2-035 C	2.38
940502	AE2-035 E	3.28
940621	AE2-049 C O1	9.92
940622	AE2-049 E O1	6.61
940631	AE2-050 C O1	11.06
940632	AE2-050 E O1	7.37
940752	AE2-062 E	0.13
940762	AE2-063 E	0.13
940881	AE2-077 C	3.05

Bus #	Bus	MW Impact
940882	AE2-077 E	4.97
941131	AE2-107 C	7.08
941132	AE2-107 E	4.72
941551	AE2-152 C	13.1
941552	AE2-152 E	6.55
941561	AE2-153 C O1	4.72
941562	AE2-153 E O1	22.12
942111	AE2-223 C	1.98
942112	AE2-223 E	13.26
942421	AE2-255 C O1	2.9
942422	AE2-255 E O1	8.69
942651	AE2-281 C	0.83
942652	AE2-281 E	5.12
942881	AE2-307 C	20.28
942882	AE2-307 E	7.37
942911	AE2-310 C	9.63
942912	AE2-310 E	2.6
942991	AE2-321 C O1	7.92
942992	AE2-321 E O1	3.9
943121	AE2-341 C	12.44
943122	AE2-341 E	6.11
BLUEG	BLUEG	5.58
CALDERWOOD	CALDERWOOD	0.07
CANNELTON	CANNELTON	0.09
CARR	CARR	0.74
CATAWBA	CATAWBA	0.28
CBM-S1	CBM-S1	1.35
CBM-W1	CBM-W1	23.91
CBM-W2	CBM-W2	51.55
CHEOAH	CHEOAH	0.07
CHILHOWEE	CHILHOWEE	0.02
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.05
GIBSON	GIBSON	0.04
HAMLET	HAMLET	0.53
MEC	MEC	35.99
O-066	O-066	13.18
RENSSELAER	RENSSELAER	0.58
SANTEETLA	SANTEETLA	0.02
TRIMBLE	TRIMBLE	0.66
WEC	WEC	7.73
Z1-043	Z1-043	27.21

17.7 Index 7

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229345	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	COMED_P4_112-65-BT3-4__	breaker	1399.0	114.16	114.34	DC	27.96

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	12.76
274654	BRAIDWOOD;1U	21.73
274655	BRAIDWOOD;2U	20.79
274660	LASCO STA;1U	19.85
274661	LASCO STA;2U	19.89
274675	JOLIET 29;7U	8.97
274676	JOLIET 29;8U	8.97
274687	WILL CNTY;4U	9.06
274704	KENDALL ;1C	3.19
274705	KENDALL ;1S	2.13
274706	KENDALL ;2C	3.19
274707	KENDALL ;2S	2.13
274722	S-055 E	11.95
274736	ELWOOD EC;9P	2.57
274859	EASYR;U1 E	11.54
274860	EASYR;U2 E	11.54
274861	TOP CROP ;1U	0.38
274862	TOP CROP ;2U	0.73
274888	PILOT HIL;1E	17.16
275149	KEMPTON ;1E	17.16
290021	O50 E	20.84
290051	GSG-6; E	10.97
290108	LEEDK;1U E	25.51
293061	N-015 E	16.48
293516	O-009 E1	6.05
293517	O-009 E2	3.07
293518	O-009 E3	3.39
293644	O22 E1	12.37
293645	O22 E2	24.01
293715	O-029 E	10.23
293716	O-029 E	5.61
293717	O-029 E	5.15
294392	P-010 E	20.93
294763	P-046 E	9.86
295109	WESTBROOK E	5.87
295111	SUBLETTE E	2.72
914641	Y2-103	47.78
915011	Y3-013 1	3.98
915021	Y3-013 2	3.98
915031	Y3-013 3	3.98
916221	Z1-073 E	5.66

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.33
916504	Z1-106 E2	1.33
916512	Z1-107 E	2.56
916522	Z1-108 E	2.63
918052	AA1-018 E	16.24
919221	AA1-146	18.43
919581	AA2-030	18.43
920272	AA2-123 E	2.58
924471	AB2-096	44.68
925161	AB2-173	3.29
925302	AB2-191 E	1.45
926311	AC1-109 1	2.0
926321	AC1-109 2	2.0
926331	AC1-110 1	2.01
926341	AC1-110 2	2.01
926351	AC1-111 1	0.8
926361	AC1-111 2	0.8
926371	AC1-111 3	0.8
926381	AC1-111 4	0.8
926391	AC1-111 5	0.8
926401	AC1-111 6	0.8
926431	AC1-114	2.51
926821	AC1-168 C O1	1.2
926822	AC1-168 E O1	8.04
927091	AC1-204 1	78.55
927101	AC1-204 2	78.42
927451	AC1-142A 1	4.55
927461	AC1-142A 2	4.55
927511	AC1-113 1	1.25
927521	AC1-113 2	1.25
927531	AC1-185 1	0.72
927541	AC1-185 2	0.72
927551	AC1-185 3	0.72
927561	AC1-185 4	0.72
927571	AC1-185 5	0.72
927581	AC1-185 6	0.72
927591	AC1-185 7	0.72
927601	AC1-185 8	0.72
930481	AB1-089	69.28
930501	AB1-091 O1	67.62
930741	AB1-122 1O1	74.91
930751	AB1-122 2O1	80.1
932881	AC2-115 1	2.51
932891	AC2-115 2	2.51
932921	AC2-116	0.88
933341	AC2-147 C	0.92
933342	AC2-147 E	1.49
933411	AC2-154 C	2.33
933412	AC2-154 E	3.8
933431	AC2-156 C O1	1.0
933432	AC2-156 E O1	1.63
933911	AD1-013 C	1.93

Bus #	Bus	MW Impact
933912	AD1-013 E	3.09
933931	AD1-016 C	0.98
933932	AD1-016 E	1.6
934101	AD1-039 1	7.34
934111	AD1-039 2	7.85
934401	AD1-064 C O1	3.38
934402	AD1-064 E O1	15.82
934431	AD1-067 C	0.14
934432	AD1-067 E	0.58
934651	AD1-096 C	0.94
934652	AD1-096 E	1.53
934701	AD1-098 C O1	7.22
934702	AD1-098 E O1	5.27
934721	AD1-100 C	19.99
934722	AD1-100 E	93.28
934871	AD1-116 C	0.95
934872	AD1-116 E	1.54
934971	AD1-129 C	0.95
934972	AD1-129 E	0.64
935001	AD1-133 C O1	21.37
935002	AD1-133 E O1	14.25
936291	AD2-038 C O1	2.41
936292	AD2-038 E O1	16.13
936371	AD2-047 C O1	2.08
936372	AD2-047 E O1	22.44
936461	AD2-060	2.45
936511	AD2-066 C O1	8.73
936512	AD2-066 E O1	5.82
936791	AD2-102 C	12.66
936792	AD2-102 E	12.17
937001	AD2-134 C	2.87
937002	AD2-134 E	11.85
937031	AD2-137 C O1	3.34
937032	AD2-137 E O1	15.65
937051	AD2-140 C O1	3.33
937052	AD2-140 E O1	15.57
937061	AD2-141 C O1	3.31
937062	AD2-141 E O1	15.59
937071	AD2-142 C O1	6.65
937072	AD2-142 E O1	31.14
937121	AD2-148 C O1	3.25
937122	AD2-148 E O1	15.2
937131	AD2-149 C O1	3.25
937132	AD2-149 E O1	15.2
937141	AD2-150 C O1	3.25
937142	AD2-150 E O1	15.2
937181	AD2-155 C O1	3.25
937182	AD2-155 E O1	15.2
937311	AD2-172 C	2.59
937312	AD2-172 E	3.57
937321	AD2-175 C	15.13
937322	AD2-175 E	10.08

Bus #	Bus	MW Impact
937331	AD2-176 C O1	7.74
937332	AD2-176 E O1	5.16
937401	AD2-194 1	8.45
937411	AD2-194 2	8.43
938012	AE1-002 E O1	6.71
938511	AE1-070 1	9.93
938521	AE1-070 2	9.07
938851	AE1-113 C O1	9.43
938852	AE1-113 E O1	29.64
938861	AE1-114 C O1	3.78
938862	AE1-114 E O1	14.44
939051	AE1-134 1	1.43
939061	AE1-134 2	1.43
939321	AE1-163 C O1	6.06
939322	AE1-163 E O1	37.2
939351	AE1-166 C O1	10.69
939352	AE1-166 E O1	9.87
939401	AE1-172 C O1	6.26
939402	AE1-172 E O1	29.29
939691	AE1-199	2.51
939701	AE1-201 C	2.12
939702	AE1-201 E	0.46
939732	AE1-204 E	0.31
939861	AE1-222 1	82.73
939871	AE1-222 2	88.46
939921	AE1-228 C O1	10.55
939922	AE1-228 E O1	7.03
940101	AE1-252 C O1	10.67
940102	AE1-252 E O1	7.11
940501	AE2-035 C	2.59
940502	AE2-035 E	3.57
940621	AE2-049 C O1	8.55
940622	AE2-049 E O1	5.7
940631	AE2-050 C O1	14.4
940632	AE2-050 E O1	9.6
940752	AE2-062 E	0.14
940762	AE2-063 E	0.14
940881	AE2-077 C	3.32
940882	AE2-077 E	5.42
941131	AE2-107 C	7.68
941132	AE2-107 E	5.12
941551	AE2-152 C	13.71
941552	AE2-152 E	6.85
941561	AE2-153 C O1	4.92
941562	AE2-153 E O1	23.04
942421	AE2-255 C O1	3.26
942422	AE2-255 E O1	9.77
942651	AE2-281 C	0.87
942652	AE2-281 E	5.31
942881	AE2-307 C	26.41
942882	AE2-307 E	9.6
942911	AE2-310 C	8.3

Bus #	Bus	MW Impact
942912	AE2-310 E	2.24
942991	AE2-321 C O1	8.63
942992	AE2-321 E O1	4.25
943121	AE2-341 C	13.36
943122	AE2-341 E	6.56
BLUEG	BLUEG	6.81
CALDERWOOD	CALDERWOOD	0.08
CANNELTON	CANNELTON	0.14
CARR	CARR	0.75
CATAWBA	CATAWBA	0.29
CBM-S1	CBM-S1	1.26
CBM-W1	CBM-W1	26.85
CBM-W2	CBM-W2	53.48
CHEOAH	CHEOAH	0.09
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.17
G-007	G-007	2.1
GIBSON	GIBSON	0.08
HAMLET	HAMLET	0.56
MEC	MEC	39.06
O-066	O-066	13.46
RENSSELAER	RENSSELAER	0.59
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.8
WEC	WEC	8.44
Z1-043	Z1-043	29.69

17.8 Index 8

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC D C	MW IMPACT
154219 1	27077 1	GREENACRE ;T	CE	24322 9	05OLIV E	AEP	1	AEP_P4_#2978_05DUMON T 765_B	breaker	971.0	125.77	125.92	DC	17.86

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	8.05
274722	S-055 E	7.51
274751	CRETE EC ;1U	1.53
274752	CRETE EC ;2U	1.53
274753	CRETE EC ;3U	1.53
274754	CRETE EC ;4U	1.53
274788	SE CHICAG;5U	3.6
274789	SE CHICAG;6U	3.6
274790	SE CHICAG;7U	3.6
274791	SE CHICAG;8U	3.6
274792	SE CHICAG;9U	3.65
274793	SE CHICAG;0U	3.65
274794	SE CHICAG;1U	3.65
274795	SE CHICAG;2U	3.65
274859	EASYR;U1 E	7.29
274860	EASYR;U2 E	7.29
274888	PILOT HIL;1E	12.38
274890	CAYUG;1U E	8.9
274891	CAYUG;2U E	8.9
275149	KEMPTON ;1E	12.38
290021	O50 E	12.96
290051	GSG-6; E	6.93
290108	LEEDK;1U E	16.12
293061	N-015 E	10.22
293516	O-009 E1	2.6
293517	O-009 E2	1.32
293518	O-009 E3	1.45
293644	O22 E1	7.23
293645	O22 E2	14.04
293715	O-029 E	6.46
293716	O-029 E	3.54
293717	O-029 E	3.26
294392	P-010 E	12.98
294763	P-046 E	6.22
295109	WESTBROOK E	3.71
295111	SUBLETTE E	1.72
910542	X3-005 E	0.52
914641	Y2-103	30.04
915011	Y3-013 1	2.5
915021	Y3-013 2	2.5
915031	Y3-013 3	2.5
916221	Z1-073 E	3.58

Bus #	Bus	MW Impact
916502	Z1-106 E1	0.84
916504	Z1-106 E2	0.84
916512	Z1-107 E	1.71
916522	Z1-108 E	1.66
918052	AA1-018 E	10.6
919221	AA1-146	11.65
919581	AA2-030	11.65
920272	AA2-123 E	1.63
924471	AB2-096	28.16
925161	AB2-173	2.08
925302	AB2-191 E	0.92
926311	AC1-109 1	1.27
926321	AC1-109 2	1.27
926331	AC1-110 1	1.26
926341	AC1-110 2	1.26
926351	AC1-111 1	0.51
926361	AC1-111 2	0.51
926371	AC1-111 3	0.51
926381	AC1-111 4	0.51
926391	AC1-111 5	0.51
926401	AC1-111 6	0.51
926431	AC1-114	1.58
926821	AC1-168 C O1	0.76
926822	AC1-168 E O1	5.07
927091	AC1-204 1	48.7
927101	AC1-204 2	48.66
927451	AC1-142A 1	2.83
927461	AC1-142A 2	2.83
927511	AC1-113 1	0.79
927521	AC1-113 2	0.79
927531	AC1-185 1	0.46
927541	AC1-185 2	0.46
927551	AC1-185 3	0.46
927561	AC1-185 4	0.46
927571	AC1-185 5	0.46
927581	AC1-185 6	0.46
927591	AC1-185 7	0.46
927601	AC1-185 8	0.46
930481	AB1-089	43.69
930501	AB1-091 O1	49.08
930741	AB1-122 1O1	47.51
930751	AB1-122 2O1	49.68
932881	AC2-115 1	1.58
932891	AC2-115 2	1.58
932921	AC2-116	0.55
933341	AC2-147 C	0.58
933342	AC2-147 E	0.94
933411	AC2-154 C	1.68
933412	AC2-154 E	2.74
933431	AC2-156 C O1	0.63
933432	AC2-156 E O1	1.04
933911	AD1-013 C	1.22

Bus #	Bus	MW Impact
933912	AD1-013 E	1.95
933931	AD1-016 C	0.62
933932	AD1-016 E	1.01
934101	AD1-039 1	4.66
934111	AD1-039 2	4.87
934401	AD1-064 C O1	2.13
934402	AD1-064 E O1	9.97
934431	AD1-067 C	0.09
934432	AD1-067 E	0.37
934651	AD1-096 C	0.59
934652	AD1-096 E	0.97
934701	AD1-098 C O1	4.56
934702	AD1-098 E O1	3.33
934721	AD1-100 C	12.92
934722	AD1-100 E	60.3
934871	AD1-116 C	0.62
934872	AD1-116 E	1.01
934971	AD1-129 C	0.6
934972	AD1-129 E	0.4
935001	AD1-133 C O1	13.71
935002	AD1-133 E O1	9.14
936291	AD2-038 C O1	1.54
936292	AD2-038 E O1	10.3
936371	AD2-047 C O1	1.5
936372	AD2-047 E O1	16.18
936461	AD2-060	1.77
936511	AD2-066 C O1	5.55
936512	AD2-066 E O1	3.7
936781	AD2-101 C	3.17
936782	AD2-101 E	14.82
936791	AD2-102 C	7.99
936792	AD2-102 E	7.67
937001	AD2-134 C	1.81
937002	AD2-134 E	7.49
937031	AD2-137 C O1	2.3
937032	AD2-137 E O1	10.79
937051	AD2-140 C O1	2.32
937052	AD2-140 E O1	10.85
937061	AD2-141 C O1	2.3
937062	AD2-141 E O1	10.86
937071	AD2-142 C O1	4.64
937072	AD2-142 E O1	21.7
937121	AD2-148 C O1	2.36
937122	AD2-148 E O1	11.03
937131	AD2-149 C O1	2.36
937132	AD2-149 E O1	11.03
937141	AD2-150 C O1	2.36
937142	AD2-150 E O1	11.03
937181	AD2-155 C O1	2.36
937182	AD2-155 E O1	11.03
937311	AD2-172 C	1.63
937312	AD2-172 E	2.26

Bus #	Bus	MW Impact
937321	AD2-175 C	10.97
937322	AD2-175 E	7.32
937331	AD2-176 C O1	4.88
937332	AD2-176 E O1	3.25
937401	AD2-194 1	5.24
937411	AD2-194 2	5.23
938012	AE1-002 E O1	4.63
938511	AE1-070 1	6.15
938521	AE1-070 2	5.63
938851	AE1-113 C O1	5.87
938852	AE1-113 E O1	18.44
938861	AE1-114 C O1	2.38
938862	AE1-114 E O1	9.11
939051	AE1-134 1	0.9
939061	AE1-134 2	0.9
939321	AE1-163 C O1	3.87
939322	AE1-163 E O1	23.76
939351	AE1-166 C O1	6.83
939352	AE1-166 E O1	6.3
939401	AE1-172 C O1	4.09
939402	AE1-172 E O1	19.14
939641	AE1-194 C	10.88
939642	AE1-194 E	72.79
939651	AE1-195 C	10.88
939652	AE1-195 E	72.79
939691	AE1-199	1.59
939701	AE1-201 C	1.33
939702	AE1-201 E	0.29
939732	AE1-204 E	0.2
939861	AE1-222 1	52.47
939871	AE1-222 2	54.86
939921	AE1-228 C O1	6.67
939922	AE1-228 E O1	4.44
940101	AE1-252 C O1	6.97
940102	AE1-252 E O1	4.65
940501	AE2-035 C	1.63
940502	AE2-035 E	2.26
940621	AE2-049 C O1	6.08
940622	AE2-049 E O1	4.05
940631	AE2-050 C O1	8.29
940632	AE2-050 E O1	5.53
940752	AE2-062 E	0.09
940762	AE2-063 E	0.09
940881	AE2-077 C	2.09
940882	AE2-077 E	3.42
941131	AE2-107 C	4.85
941132	AE2-107 E	3.23
941551	AE2-152 C	8.75
941552	AE2-152 E	4.38
941561	AE2-153 C O1	3.14
941562	AE2-153 E O1	14.71
942421	AE2-255 C O1	2.03

Bus #	Bus	MW Impact
942422	AE2-255 E O1	6.08
942651	AE2-281 C	0.55
942652	AE2-281 E	3.39
942881	AE2-307 C	15.2
942882	AE2-307 E	5.53
942911	AE2-310 C	5.9
942912	AE2-310 E	1.59
942991	AE2-321 C O1	5.44
942992	AE2-321 E O1	2.68
943121	AE2-341 C	8.47
943122	AE2-341 E	4.16
951721	J643	15.48
952581	J740 C	3.4
952582	J740 E	18.4
953871	J847	8.37
BLUEG	BLUEG	2.92
CANNELTON	CANNELTON	0.01
CARR	CARR	0.5
CATAWBA	CATAWBA	0.17
CBM-S1	CBM-S1	1.3
CBM-W1	CBM-W1	20.03
CBM-W2	CBM-W2	38.32
CHEOAH	CHEOAH	0.0
CIN	CIN	0.09
G-007	G-007	1.39
HAMLET	HAMLET	0.33
MEC	MEC	24.99
O-066	O-066	8.94
RENSSELAER	RENSSELAER	0.4
SANTEETLA	SANTEETLA	0.0
TRIMBLE	TRIMBLE	0.35
WEC	WEC	5.32
Z1-043	Z1-043	18.79

17.9 Index 9

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229247	270886	ST JOHN ; T	CE	255104	17GREEN_ACRE	NIPS	1	COMED_P4_112-65-BT3-4__	breaker	1091.0	132.85	133.0	DC	19.85

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.0
274654	BRAIDWOOD;1U	15.1
274655	BRAIDWOOD;2U	14.45
274687	WILL CNTY;4U	6.37
274704	KENDALL ;1C	2.23
274705	KENDALL ;1S	1.49
274706	KENDALL ;2C	2.23
274707	KENDALL ;2S	1.49
274722	S-055 E	8.42
274751	CRETE EC ;1U	2.67
274752	CRETE EC ;2U	2.67
274753	CRETE EC ;3U	2.67
274754	CRETE EC ;4U	2.67
274859	EASYR;U1 E	8.13
274860	EASYR;U2 E	8.13
274861	TOP CROP ;1U	0.26
274862	TOP CROP ;2U	0.5
274888	PILOT HIL;1E	12.78
275149	KEMPTON ;1E	12.78
290021	O50 E	14.61
290051	GSG-6; E	7.74
290108	LEEDK;1U E	17.99
293061	N-015 E	11.56
293644	O22 E1	8.49
293645	O22 E2	16.47
294392	P-010 E	14.68
294763	P-046 E	6.95
295109	WESTBROOK E	4.14
295111	SUBLETTE E	1.91
914641	Y2-103	33.66
915011	Y3-013 1	2.81
915021	Y3-013 2	2.81
915031	Y3-013 3	2.81
916221	Z1-073 E	3.99
916502	Z1-106 E1	0.94
916504	Z1-106 E2	0.94
916512	Z1-107 E	1.85
916522	Z1-108 E	1.85
918052	AA1-018 E	11.61
919581	AA2-030	10.03
920272	AA2-123 E	1.82

Bus #	Bus	MW Impact
924471	AB2-096	31.49
925161	AB2-173	2.32
925302	AB2-191 E	1.02
926311	AC1-109 1	1.41
926321	AC1-109 2	1.41
926331	AC1-110 1	1.41
926341	AC1-110 2	1.41
926351	AC1-111 1	0.57
926361	AC1-111 2	0.57
926371	AC1-111 3	0.57
926381	AC1-111 4	0.57
926391	AC1-111 5	0.57
926401	AC1-111 6	0.57
926431	AC1-114	1.77
927091	AC1-204 1	55.1
927101	AC1-204 2	55.02
927451	AC1-142A 1	3.19
927461	AC1-142A 2	3.19
927511	AC1-113 1	0.88
927521	AC1-113 2	0.88
927531	AC1-185 1	0.51
927541	AC1-185 2	0.51
927551	AC1-185 3	0.51
927561	AC1-185 4	0.51
927571	AC1-185 5	0.51
927581	AC1-185 6	0.51
927591	AC1-185 7	0.51
927601	AC1-185 8	0.51
930481	AB1-089	48.82
930501	AB1-091 O1	50.48
930741	AB1-122 1O1	52.93
930751	AB1-122 2O1	56.18
932881	AC2-115 1	1.77
932891	AC2-115 2	1.77
932921	AC2-116	0.62
933341	AC2-147 C	0.64
933342	AC2-147 E	1.05
933411	AC2-154 C	1.73
933412	AC2-154 E	2.83
933431	AC2-156 C O1	0.71
933432	AC2-156 E O1	1.15
933911	AD1-013 C	1.36
933912	AD1-013 E	2.18
933931	AD1-016 C	0.69
933932	AD1-016 E	1.13
934101	AD1-039 1	5.19
934111	AD1-039 2	5.51
934401	AD1-064 C O1	2.38
934402	AD1-064 E O1	11.15
934431	AD1-067 C	0.1
934432	AD1-067 E	0.41
934651	AD1-096 C	0.66

Bus #	Bus	MW Impact
934652	AD1-096 E	1.08
934701	AD1-098 C O1	5.09
934702	AD1-098 E O1	3.72
934721	AD1-100 C	14.25
934722	AD1-100 E	66.49
934871	AD1-116 C	0.68
934872	AD1-116 E	1.1
934971	AD1-129 C	0.67
934972	AD1-129 E	0.45
935001	AD1-133 C O1	15.14
935002	AD1-133 E O1	10.09
936291	AD2-038 C O1	1.71
936292	AD2-038 E O1	11.43
936371	AD2-047 C O1	1.55
936372	AD2-047 E O1	16.7
936461	AD2-060	1.83
936511	AD2-066 C O1	6.17
936512	AD2-066 E O1	4.12
936781	AD2-101 C	3.08
936782	AD2-101 E	14.43
936791	AD2-102 C	8.92
936792	AD2-102 E	8.57
937001	AD2-134 C	2.02
937002	AD2-134 E	8.36
937031	AD2-137 C O1	2.44
937032	AD2-137 E O1	11.44
937051	AD2-140 C O1	2.44
937052	AD2-140 E O1	11.44
937061	AD2-141 C O1	2.43
937062	AD2-141 E O1	11.45
937071	AD2-142 C O1	4.89
937072	AD2-142 E O1	22.88
937121	AD2-148 C O1	2.42
937122	AD2-148 E O1	11.35
937131	AD2-149 C O1	2.42
937132	AD2-149 E O1	11.35
937141	AD2-150 C O1	2.42
937142	AD2-150 E O1	11.35
937181	AD2-155 C O1	2.42
937182	AD2-155 E O1	11.35
937311	AD2-172 C	1.82
937312	AD2-172 E	2.52
937321	AD2-175 C	11.29
937322	AD2-175 E	7.53
937331	AD2-176 C O1	5.46
937332	AD2-176 E O1	3.64
937401	AD2-194 1	5.92
937411	AD2-194 2	5.92
938012	AE1-002 E O1	4.91
938511	AE1-070 1	6.96
938521	AE1-070 2	6.36
938851	AE1-113 C O1	6.61

Bus #	Bus	MW Impact
938852	AE1-113 E O1	20.79
938861	AE1-114 C O1	2.66
938862	AE1-114 E O1	10.17
939051	AE1-134 1	1.01
939061	AE1-134 2	1.01
939321	AE1-163 C O1	4.29
939322	AE1-163 E O1	26.35
939351	AE1-166 C O1	7.59
939352	AE1-166 E O1	7.0
939401	AE1-172 C O1	4.47
939402	AE1-172 E O1	20.92
939641	AE1-194 C	18.94
939642	AE1-194 E	126.78
939651	AE1-195 C	18.94
939652	AE1-195 E	126.78
939691	AE1-199	1.77
939701	AE1-201 C	1.49
939702	AE1-201 E	0.33
939732	AE1-204 E	0.22
939861	AE1-222 1	58.46
939871	AE1-222 2	62.04
939921	AE1-228 C O1	7.44
939922	AE1-228 E O1	4.96
940101	AE1-252 C O1	7.62
940102	AE1-252 E O1	5.08
940501	AE2-035 C	1.82
940502	AE2-035 E	2.52
940621	AE2-049 C O1	6.33
940622	AE2-049 E O1	4.22
940631	AE2-050 C O1	9.84
940632	AE2-050 E O1	6.56
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.34
940882	AE2-077 E	3.82
941131	AE2-107 C	5.42
941132	AE2-107 E	3.61
941551	AE2-152 C	9.73
941552	AE2-152 E	4.86
941561	AE2-153 C O1	3.49
941562	AE2-153 E O1	16.36
942421	AE2-255 C O1	2.28
942422	AE2-255 E O1	6.85
942651	AE2-281 C	0.61
942652	AE2-281 E	3.76
942881	AE2-307 C	18.05
942882	AE2-307 E	6.56
942911	AE2-310 C	6.14
942912	AE2-310 E	1.66
942991	AE2-321 C O1	6.08
942992	AE2-321 E O1	3.0
943121	AE2-341 C	9.44

Bus #	Bus	MW Impact
943122	AE2-341 E	4.64
BLUEG	BLUEG	5.15
CALDERWOOD	CALDERWOOD	0.1
CANNELTON	CANNELTON	0.11
CARR	CARR	0.57
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	0.68
CBM-W1	CBM-W1	20.0
CBM-W2	CBM-W2	36.78
CHEOAH	CHEOAH	0.1
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.15
G-007	G-007	1.6
GIBSON	GIBSON	0.07
HAMLET	HAMLET	0.45
MEC	MEC	27.44
O-066	O-066	10.24
RENSSELAER	RENSSELAER	0.45
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.6
WEC	WEC	5.95
Z1-043	Z1-043	20.9

17.10 Index 10

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229177	270926	WILTON ;B	CE	275232	WILTON ;3M	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.88	163.06	DC	34.43

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	14.78
274722	S-055 E	13.73
274772	LINCOLN ;3U	2.67
274773	LINCOLN ;4U	2.67
274774	LINCOLN ;5U	2.67
274775	LINCOLN ;6U	2.67
274776	LINCOLN ;7U	2.67
274777	LINCOLN ;8U	2.67
274788	SE CHICAG;5U	5.44
274789	SE CHICAG;6U	5.44
274790	SE CHICAG;7U	5.44
274791	SE CHICAG;8U	5.44
274792	SE CHICAG;9U	5.4
274793	SE CHICAG;0U	5.4
274794	SE CHICAG;1U	5.4
274795	SE CHICAG;2U	5.4
274859	EASYR;U1 E	13.43
274860	EASYR;U2 E	13.43
274888	PILOT HIL;1E	23.57
274890	CAYUG;1U E	20.22
274891	CAYUG;2U E	20.22
275149	KEMPTON ;1E	23.57
290021	O50 E	23.7
290051	GSG-6; E	12.77
290108	LEEDK;1U E	29.68
293061	N-015 E	19.41
293644	O22 E1	12.53
293645	O22 E2	24.32
294392	P-010 E	24.65
294763	P-046 E	11.45
295109	WESTBROOK E	6.84
295111	SUBLETTE E	3.17
296125	R-030 C3	4.97
296128	R-030 E3	19.89
296271	R-030 C2	4.91
296272	R-030 E2	19.65
296308	R-030 C1	4.91
296309	R-030 E1	19.65
910542	X3-005 E	0.89
914641	Y2-103	54.9
915011	Y3-013 1	4.58
915021	Y3-013 2	4.58

Bus #	Bus	MW Impact
915031	Y3-013 3	4.58
916221	Z1-073 E	6.59
916502	Z1-106 E1	1.54
916504	Z1-106 E2	1.54
916512	Z1-107 E	3.16
916522	Z1-108 E	3.04
917502	Z2-087 E	25.7
918052	AA1-018 E	20.09
919581	AA2-030	18.9
920272	AA2-123 E	2.98
924041	AB2-047 C O1	4.74
924042	AB2-047 E O1	31.72
924471	AB2-096	51.72
925161	AB2-173	3.83
925302	AB2-191 E	1.69
926311	AC1-109 1	2.34
926321	AC1-109 2	2.34
926331	AC1-110 1	2.32
926341	AC1-110 2	2.32
926351	AC1-111 1	0.93
926361	AC1-111 2	0.93
926371	AC1-111 3	0.93
926381	AC1-111 4	0.93
926391	AC1-111 5	0.93
926401	AC1-111 6	0.93
926431	AC1-114	2.91
926821	AC1-168 C O1	1.43
926822	AC1-168 E O1	9.57
927091	AC1-204 1	88.75
927101	AC1-204 2	88.75
927451	AC1-142A 1	5.11
927461	AC1-142A 2	5.11
927511	AC1-113 1	1.45
927521	AC1-113 2	1.45
927531	AC1-185 1	0.84
927541	AC1-185 2	0.84
927551	AC1-185 3	0.84
927561	AC1-185 4	0.84
927571	AC1-185 5	0.84
927581	AC1-185 6	0.84
927591	AC1-185 7	0.84
927601	AC1-185 8	0.84
930481	AB1-089	80.32
930501	AB1-091 O1	93.8
930741	AB1-122 1O1	89.17
930751	AB1-122 2O1	90.13
932881	AC2-115 1	2.91
932891	AC2-115 2	2.91
932921	AC2-116	1.02
932931	AC2-117	6.51
933341	AC2-147 C	1.07
933342	AC2-147 E	1.74

Bus #	Bus	MW Impact
933411	AC2-154 C	3.2
933412	AC2-154 E	5.22
933431	AC2-156 C O1	1.17
933432	AC2-156 E O1	1.91
933911	AD1-013 C	2.25
933912	AD1-013 E	3.59
933931	AD1-016 C	1.13
933932	AD1-016 E	1.85
934101	AD1-039 1	8.74
934111	AD1-039 2	8.83
934401	AD1-064 C O1	3.91
934402	AD1-064 E O1	18.33
934431	AD1-067 C	0.16
934432	AD1-067 E	0.67
934651	AD1-096 C	1.09
934652	AD1-096 E	1.78
934701	AD1-098 C O1	8.41
934702	AD1-098 E O1	6.14
934721	AD1-100 C	29.39
934722	AD1-100 E	137.14
934871	AD1-116 C	1.17
934872	AD1-116 E	1.91
934971	AD1-129 C	1.1
934972	AD1-129 E	0.74
935001	AD1-133 C O1	27.36
935002	AD1-133 E O1	18.24
936291	AD2-038 C O1	2.88
936292	AD2-038 E O1	19.25
936371	AD2-047 C O1	2.86
936372	AD2-047 E O1	30.81
936461	AD2-060	3.37
936511	AD2-066 C O1	10.34
936512	AD2-066 E O1	6.89
936781	AD2-101 C	5.82
936782	AD2-101 E	27.26
936791	AD2-102 C	14.68
936792	AD2-102 E	14.11
937001	AD2-134 C	3.34
937002	AD2-134 E	13.79
937031	AD2-137 C O1	7.17
937032	AD2-137 E O1	33.55
937051	AD2-140 C O1	7.53
937052	AD2-140 E O1	35.24
937061	AD2-141 C O1	7.48
937062	AD2-141 E O1	35.28
937071	AD2-142 C O1	15.05
937072	AD2-142 E O1	70.47
937121	AD2-148 C O1	4.5
937122	AD2-148 E O1	21.09
937131	AD2-149 C O1	4.5
937132	AD2-149 E O1	21.09
937141	AD2-150 C O1	4.5

Bus #	Bus	MW Impact
937142	AD2-150 E O1	21.09
937181	AD2-155 C O1	4.5
937182	AD2-155 E O1	21.09
937311	AD2-172 C	3.01
937312	AD2-172 E	4.15
937321	AD2-175 C	20.99
937322	AD2-175 E	13.99
937331	AD2-176 C O1	8.96
937332	AD2-176 E O1	5.97
937401	AD2-194 1	9.54
937411	AD2-194 2	9.54
938012	AE1-002 E O1	14.38
938511	AE1-070 1	11.21
938521	AE1-070 2	10.26
938851	AE1-113 C O1	10.72
938852	AE1-113 E O1	33.71
938861	AE1-114 C O1	4.39
938862	AE1-114 E O1	16.8
939051	AE1-134 1	1.67
939061	AE1-134 2	1.67
939321	AE1-163 C O1	7.23
939322	AE1-163 E O1	44.39
939351	AE1-166 C O1	14.5
939352	AE1-166 E O1	13.38
939401	AE1-172 C O1	9.5
939402	AE1-172 E O1	44.49
939691	AE1-199	2.92
939701	AE1-201 C	2.45
939702	AE1-201 E	0.54
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.45
939742	AE1-205 E O1	17.19
939861	AE1-222 1	98.48
939871	AE1-222 2	99.53
939921	AE1-228 C O1	12.28
939922	AE1-228 E O1	8.19
940101	AE1-252 C O1	16.2
940102	AE1-252 E O1	10.8
940501	AE2-035 C	3.01
940502	AE2-035 E	4.15
940621	AE2-049 C O1	11.53
940622	AE2-049 E O1	7.69
940631	AE2-050 C O1	15.38
940632	AE2-050 E O1	10.26
940752	AE2-062 E	0.16
940762	AE2-063 E	0.16
940881	AE2-077 C	3.85
940882	AE2-077 E	6.28
941131	AE2-107 C	8.93
941132	AE2-107 E	5.96
941551	AE2-152 C	18.59
941552	AE2-152 E	9.29

Bus #	Bus	MW Impact
941561	AE2-153 C O1	6.06
941562	AE2-153 E O1	28.37
941731	AE2-173	7.31
942111	AE2-223 C	2.88
942112	AE2-223 E	19.28
942421	AE2-255 C O1	3.7
942422	AE2-255 E O1	11.11
942651	AE2-281 C	1.03
942652	AE2-281 E	6.34
942881	AE2-307 C	28.2
942882	AE2-307 E	10.26
942911	AE2-310 C	11.2
942912	AE2-310 E	3.02
942991	AE2-321 C O1	9.98
942992	AE2-321 E O1	4.92
943121	AE2-341 C	15.61
943122	AE2-341 E	7.67
BLUEG	BLUEG	8.02
CALDERWOOD	CALDERWOOD	0.11
CANNELTON	CANNELTON	0.1
CARR	CARR	0.97
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.72
CBM-W1	CBM-W1	37.33
CBM-W2	CBM-W2	70.69
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.73
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.74
MEC	MEC	46.43
O-066	O-066	17.5
RENSSELAER	RENSSELAER	0.77
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.95
WEC	WEC	9.73
Z1-043	Z1-043	35.42

17.11 Index 11

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229179	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.6	162.81	DC	35.14

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	15.09
274722	S-055 E	14.02
274772	LINCOLN ;3U	2.74
274773	LINCOLN ;4U	2.74
274774	LINCOLN ;5U	2.74
274775	LINCOLN ;6U	2.74
274776	LINCOLN ;7U	2.74
274777	LINCOLN ;8U	2.74
274788	SE CHICAG;5U	5.56
274789	SE CHICAG;6U	5.56
274790	SE CHICAG;7U	5.56
274791	SE CHICAG;8U	5.56
274792	SE CHICAG;9U	5.52
274793	SE CHICAG;0U	5.52
274794	SE CHICAG;1U	5.52
274795	SE CHICAG;2U	5.52
274859	EASYR;U1 E	13.72
274860	EASYR;U2 E	13.72
274888	PILOT HIL;1E	24.06
274890	CAYUG;1U E	20.62
274891	CAYUG;2U E	20.62
275149	KEMPTON ;1E	24.06
290021	O50 E	24.2
290051	GSG-6; E	13.05
290108	LEEDK;1U E	30.31
293061	N-015 E	19.81
293516	O-009 E1	2.14
293517	O-009 E2	1.09
293518	O-009 E3	1.2
293644	O22 E1	12.79
293645	O22 E2	24.83
293715	O-029 E	12.21
293716	O-029 E	6.69
293717	O-029 E	6.15
294392	P-010 E	25.16
294763	P-046 E	11.69
295109	WESTBROOK E	6.98
295111	SUBLETTE E	3.24
296125	R-030 C3	5.07
296128	R-030 E3	20.29
296271	R-030 C2	5.01
296272	R-030 E2	20.05

Bus #	Bus	MW Impact
296308	R-030 C1	5.01
296309	R-030 E1	20.05
910542	X3-005 E	0.91
914641	Y2-103	56.07
915011	Y3-013 1	4.67
915021	Y3-013 2	4.67
915031	Y3-013 3	4.67
916221	Z1-073 E	6.73
916502	Z1-106 E1	1.58
916504	Z1-106 E2	1.58
916512	Z1-107 E	3.23
916522	Z1-108 E	3.1
917502	Z2-087 E	26.22
918052	AA1-018 E	20.53
919221	AA1-146	21.95
919581	AA2-030	21.95
920272	AA2-123 E	3.05
924041	AB2-047 C O1	4.84
924042	AB2-047 E O1	32.36
924471	AB2-096	52.83
925161	AB2-173	3.91
925302	AB2-191 E	1.73
926311	AC1-109 1	2.39
926321	AC1-109 2	2.39
926331	AC1-110 1	2.37
926341	AC1-110 2	2.37
926351	AC1-111 1	0.95
926361	AC1-111 2	0.95
926371	AC1-111 3	0.95
926381	AC1-111 4	0.95
926391	AC1-111 5	0.95
926401	AC1-111 6	0.95
926431	AC1-114	2.97
926821	AC1-168 C O1	1.46
926822	AC1-168 E O1	9.77
927091	AC1-204 1	90.65
927101	AC1-204 2	90.65
927451	AC1-142A 1	5.22
927461	AC1-142A 2	5.22
927511	AC1-113 1	1.48
927521	AC1-113 2	1.48
927531	AC1-185 1	0.86
927541	AC1-185 2	0.86
927551	AC1-185 3	0.86
927561	AC1-185 4	0.86
927571	AC1-185 5	0.86
927581	AC1-185 6	0.86
927591	AC1-185 7	0.86
927601	AC1-185 8	0.86
930481	AB1-089	82.03
930501	AB1-091 O1	95.74
930741	AB1-122 1O1	91.06

Bus #	Bus	MW Impact
930751	AB1-122 2O1	92.05
932881	AC2-115 1	2.97
932891	AC2-115 2	2.97
932921	AC2-116	1.04
932931	AC2-117	6.65
933341	AC2-147 C	1.09
933342	AC2-147 E	1.78
933411	AC2-154 C	3.27
933412	AC2-154 E	5.33
933431	AC2-156 C O1	1.19
933432	AC2-156 E O1	1.95
933911	AD1-013 C	2.3
933912	AD1-013 E	3.67
933931	AD1-016 C	1.16
933932	AD1-016 E	1.89
934101	AD1-039 1	8.92
934111	AD1-039 2	9.02
934401	AD1-064 C O1	4.0
934402	AD1-064 E O1	18.72
934431	AD1-067 C	0.16
934432	AD1-067 E	0.69
934651	AD1-096 C	1.11
934652	AD1-096 E	1.81
934701	AD1-098 C O1	8.59
934702	AD1-098 E O1	6.27
934721	AD1-100 C	29.97
934722	AD1-100 E	139.86
934871	AD1-116 C	1.2
934872	AD1-116 E	1.95
934971	AD1-129 C	1.13
934972	AD1-129 E	0.75
935001	AD1-133 C O1	27.93
935002	AD1-133 E O1	18.62
936291	AD2-038 C O1	2.94
936292	AD2-038 E O1	19.66
936371	AD2-047 C O1	2.92
936372	AD2-047 E O1	31.45
936461	AD2-060	3.44
936511	AD2-066 C O1	10.56
936512	AD2-066 E O1	7.04
936781	AD2-101 C	5.94
936782	AD2-101 E	27.82
936791	AD2-102 C	14.99
936792	AD2-102 E	14.41
937001	AD2-134 C	3.41
937002	AD2-134 E	14.09
937031	AD2-137 C O1	7.3
937032	AD2-137 E O1	34.17
937051	AD2-140 C O1	7.67
937052	AD2-140 E O1	35.89
937061	AD2-141 C O1	7.62
937062	AD2-141 E O1	35.93

Bus #	Bus	MW Impact
937071	AD2-142 C O1	15.33
937072	AD2-142 E O1	71.78
937121	AD2-148 C O1	4.6
937122	AD2-148 E O1	21.53
937131	AD2-149 C O1	4.6
937132	AD2-149 E O1	21.53
937141	AD2-150 C O1	4.6
937142	AD2-150 E O1	21.53
937181	AD2-155 C O1	4.6
937182	AD2-155 E O1	21.53
937311	AD2-172 C	3.07
937312	AD2-172 E	4.24
937321	AD2-175 C	21.42
937322	AD2-175 E	14.28
937331	AD2-176 C O1	9.15
937332	AD2-176 E O1	6.1
937401	AD2-194 1	9.75
937411	AD2-194 2	9.75
938012	AE1-002 E O1	14.65
938511	AE1-070 1	11.45
938521	AE1-070 2	10.48
938851	AE1-113 C O1	10.95
938852	AE1-113 E O1	34.43
938861	AE1-114 C O1	4.49
938862	AE1-114 E O1	17.15
939051	AE1-134 1	1.71
939061	AE1-134 2	1.71
939321	AE1-163 C O1	7.38
939322	AE1-163 E O1	45.35
939351	AE1-166 C O1	14.79
939352	AE1-166 E O1	13.65
939401	AE1-172 C O1	9.69
939402	AE1-172 E O1	45.37
939691	AE1-199	2.98
939701	AE1-201 C	2.5
939702	AE1-201 E	0.55
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.7
939742	AE1-205 E O1	17.54
939861	AE1-222 1	100.56
939871	AE1-222 2	101.65
939921	AE1-228 C O1	12.54
939922	AE1-228 E O1	8.36
940101	AE1-252 C O1	16.52
940102	AE1-252 E O1	11.01
940501	AE2-035 C	3.07
940502	AE2-035 E	4.24
940621	AE2-049 C O1	11.77
940622	AE2-049 E O1	7.85
940631	AE2-050 C O1	15.7
940632	AE2-050 E O1	10.47
940752	AE2-062 E	0.16

Bus #	Bus	MW Impact
940762	AE2-063 E	0.16
940881	AE2-077 C	3.93
940882	AE2-077 E	6.42
941131	AE2-107 C	9.12
941132	AE2-107 E	6.08
941551	AE2-152 C	18.96
941552	AE2-152 E	9.48
941561	AE2-153 C O1	6.18
941562	AE2-153 E O1	28.96
941731	AE2-173	7.45
942111	AE2-223 C	2.94
942112	AE2-223 E	19.67
942421	AE2-255 C O1	3.78
942422	AE2-255 E O1	11.34
942651	AE2-281 C	1.05
942652	AE2-281 E	6.48
942881	AE2-307 C	28.78
942882	AE2-307 E	10.47
942911	AE2-310 C	11.43
942912	AE2-310 E	3.09
942991	AE2-321 C O1	10.2
942992	AE2-321 E O1	5.02
943121	AE2-341 C	15.94
943122	AE2-341 E	7.83
BLUEG	BLUEG	8.2
CALDERWOOD	CALDERWOOD	0.12
CANNELTON	CANNELTON	0.1
CARR	CARR	0.99
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.75
CBM-W1	CBM-W1	38.13
CBM-W2	CBM-W2	72.15
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.04
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.79
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.76
MEC	MEC	47.41
O-066	O-066	17.87
RENSSELAER	RENSSELAER	0.78
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.98
WEC	WEC	9.93
Z1-043	Z1-043	36.17

17.12 Index 12

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229195	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1399.0	159.86	160.02	DC	27.49

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	12.53
274654	BRAIDWOOD;1U	21.38
274655	BRAIDWOOD;2U	20.45
274661	LASCO STA;2U	19.55
274687	WILL CNTY;4U	8.91
274704	KENDALL ;1C	3.14
274705	KENDALL ;1S	2.09
274706	KENDALL ;2C	3.14
274707	KENDALL ;2S	2.09
274722	S-055 E	11.73
274751	CRETE EC ;1U	4.56
274752	CRETE EC ;2U	4.56
274753	CRETE EC ;3U	4.56
274754	CRETE EC ;4U	4.56
274859	EASYR;U1 E	11.33
274860	EASYR;U2 E	11.33
274861	TOP CROP ;1U	0.37
274862	TOP CROP ;2U	0.72
274888	PILOT HIL;1E	16.83
275149	KEMPTON ;1E	16.83
290021	O50 E	20.48
290051	GSG-6; E	10.77
290108	LEEDK;1U E	25.04
293061	N-015 E	16.19
293644	O22 E1	12.18
293645	O22 E2	23.65
294392	P-010 E	20.57
294763	P-046 E	9.68
295109	WESTBROOK E	5.77
295111	SUBLETTE E	2.67
914641	Y2-103	46.93
915011	Y3-013 1	3.91
915021	Y3-013 2	3.91
915031	Y3-013 3	3.91
916221	Z1-073 E	5.56
916502	Z1-106 E1	1.31
916504	Z1-106 E2	1.31
916512	Z1-107 E	2.51
916522	Z1-108 E	2.58
918052	AA1-018 E	15.94
920272	AA2-123 E	2.53
924471	AB2-096	43.87

Bus #	Bus	MW Impact
925302	AB2-191 E	1.43
926311	AC1-109 1	1.97
926321	AC1-109 2	1.97
926331	AC1-110 1	1.97
926341	AC1-110 2	1.97
926351	AC1-111 1	0.79
926361	AC1-111 2	0.79
926371	AC1-111 3	0.79
926381	AC1-111 4	0.79
926391	AC1-111 5	0.79
926401	AC1-111 6	0.79
926431	AC1-114	2.46
926821	AC1-168 C O1	0.17
926822	AC1-168 E O1	1.16
927091	AC1-204 1	77.22
927101	AC1-204 2	77.09
927451	AC1-142A 1	4.47
927461	AC1-142A 2	4.47
927511	AC1-113 1	1.23
927521	AC1-113 2	1.23
927531	AC1-185 1	0.71
927541	AC1-185 2	0.71
927551	AC1-185 3	0.71
927561	AC1-185 4	0.71
927571	AC1-185 5	0.71
927581	AC1-185 6	0.71
927591	AC1-185 7	0.71
927601	AC1-185 8	0.71
930481	AB1-089	68.02
930501	AB1-091 O1	66.31
930741	AB1-122 1O1	73.55
930751	AB1-122 2O1	78.73
932881	AC2-115 1	2.46
932891	AC2-115 2	2.46
932921	AC2-116	0.86
933341	AC2-147 C	0.9
933342	AC2-147 E	1.47
933411	AC2-154 C	2.28
933412	AC2-154 E	3.73
933431	AC2-156 C O1	0.98
933432	AC2-156 E O1	1.6
933911	AD1-013 C	1.9
933912	AD1-013 E	3.03
933931	AD1-016 C	0.96
933932	AD1-016 E	1.57
934101	AD1-039 1	7.21
934111	AD1-039 2	7.72
934401	AD1-064 C O1	3.32
934402	AD1-064 E O1	15.53
934431	AD1-067 C	0.14
934432	AD1-067 E	0.57
934651	AD1-096 C	0.92

Bus #	Bus	MW Impact
934652	AD1-096 E	1.5
934701	AD1-098 C O1	7.09
934702	AD1-098 E O1	5.17
934721	AD1-100 C	19.66
934722	AD1-100 E	91.74
934871	AD1-116 C	0.93
934872	AD1-116 E	1.51
934971	AD1-129 C	0.94
934972	AD1-129 E	0.62
935001	AD1-133 C O1	20.98
935002	AD1-133 E O1	13.99
936291	AD2-038 C O1	2.37
936292	AD2-038 E O1	15.84
936371	AD2-047 C O1	2.04
936372	AD2-047 E O1	22.0
936461	AD2-060	2.4
936511	AD2-066 C O1	8.58
936512	AD2-066 E O1	5.72
936791	AD2-102 C	12.43
936792	AD2-102 E	11.95
937001	AD2-134 C	2.82
937002	AD2-134 E	11.63
937031	AD2-137 C O1	3.29
937032	AD2-137 E O1	15.4
937051	AD2-140 C O1	3.27
937052	AD2-140 E O1	15.33
937061	AD2-141 C O1	3.26
937062	AD2-141 E O1	15.35
937071	AD2-142 C O1	6.55
937072	AD2-142 E O1	30.66
937121	AD2-148 C O1	3.18
937122	AD2-148 E O1	14.9
937131	AD2-149 C O1	3.18
937132	AD2-149 E O1	14.9
937141	AD2-150 C O1	3.18
937142	AD2-150 E O1	14.9
937181	AD2-155 C O1	3.18
937182	AD2-155 E O1	14.9
937311	AD2-172 C	2.54
937312	AD2-172 E	3.51
937321	AD2-175 C	14.83
937322	AD2-175 E	9.89
937331	AD2-176 C O1	7.6
937332	AD2-176 E O1	5.07
937401	AD2-194 1	8.3
937411	AD2-194 2	8.29
938012	AE1-002 E O1	6.6
938511	AE1-070 1	9.76
938521	AE1-070 2	8.91
938851	AE1-113 C O1	9.27
938852	AE1-113 E O1	29.13
938861	AE1-114 C O1	3.71

Bus #	Bus	MW Impact
938862	AE1-114 E O1	14.18
939321	AE1-163 C O1	5.95
939322	AE1-163 E O1	36.54
939351	AE1-166 C O1	10.51
939352	AE1-166 E O1	9.71
939401	AE1-172 C O1	6.15
939402	AE1-172 E O1	28.8
939641	AE1-194 C	32.36
939642	AE1-194 E	216.57
939651	AE1-195 C	32.36
939652	AE1-195 E	216.57
939691	AE1-199	2.46
939701	AE1-201 C	2.08
939702	AE1-201 E	0.46
939732	AE1-204 E	0.31
939861	AE1-222 1	81.22
939871	AE1-222 2	86.95
939921	AE1-228 C O1	10.36
939922	AE1-228 E O1	6.9
940101	AE1-252 C O1	10.49
940102	AE1-252 E O1	6.99
940501	AE2-035 C	2.54
940502	AE2-035 E	3.51
940621	AE2-049 C O1	8.38
940622	AE2-049 E O1	5.59
940631	AE2-050 C O1	14.19
940632	AE2-050 E O1	9.46
940752	AE2-062 E	0.14
940762	AE2-063 E	0.14
940881	AE2-077 C	3.26
940882	AE2-077 E	5.32
941131	AE2-107 C	7.54
941132	AE2-107 E	5.03
941551	AE2-152 C	13.48
941552	AE2-152 E	6.74
941561	AE2-153 C O1	4.84
941562	AE2-153 E O1	22.65
942421	AE2-255 C O1	3.2
942422	AE2-255 E O1	9.6
942651	AE2-281 C	0.85
942652	AE2-281 E	5.22
942881	AE2-307 C	26.01
942882	AE2-307 E	9.46
942911	AE2-310 C	8.14
942912	AE2-310 E	2.2
942991	AE2-321 C O1	8.47
942992	AE2-321 E O1	4.17
943121	AE2-341 C	13.12
943122	AE2-341 E	6.44
BLUEG	BLUEG	6.84
CALDERWOOD	CALDERWOOD	0.14
CANNELTON	CANNELTON	0.15

Bus #	Bus	MW Impact
CARR	CARR	0.81
CATAWBA	CATAWBA	0.34
CBM-S1	CBM-S1	1.0
CBM-W1	CBM-W1	25.5
CBM-W2	CBM-W2	51.38
CHEOAH	CHEOAH	0.14
CHILHOWEE	CHILHOWEE	0.04
ELMERSMITH	ELMERSMITH	0.19
G-007	G-007	2.26
GIBSON	GIBSON	0.09
HAMLET	HAMLET	0.63
MEC	MEC	38.28
O-066	O-066	14.53
RENSSELAER	RENSSELAER	0.64
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.8
WEC	WEC	8.29
Z1-043	Z1-043	29.16

17.13 Index 13

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1542057	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	138.54	138.75	DC	21.72

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.77
274722	S-055 E	9.13
274808	UNIV PK N;4U	1.28
274809	UNIV PK N;5U	1.28
274811	UNIV PK N;7U	1.28
274812	UNIV PK N;8U	1.28
274814	UNIV PK N;0U	1.28
274815	UNIV PK N;XU	1.28
274832	U4-027	8.59
274859	EASYR;U1 E	8.82
274860	EASYR;U2 E	8.82
274888	PILOT HIL;1E	14.83
274890	CAYUG;1U E	10.67
274891	CAYUG;2U E	10.67
275149	KEMPTON ;1E	14.83
290021	O50 E	15.58
290051	GSG-6; E	8.41
290108	LEEDK;1U E	19.56
293061	N-015 E	12.57
293516	O-009 E1	7.24
293517	O-009 E2	3.68
293518	O-009 E3	4.05
293644	O22 E1	7.86
293645	O22 E2	15.26
293715	O-029 E	7.82
293716	O-029 E	4.29
293717	O-029 E	3.94
293771	O-035 E	5.08
294392	P-010 E	15.97
294401	BSHIL;1U E	6.79
294410	BSHIL;2U E	6.79
294763	P-046 E	7.54
295109	WESTBROOK E	4.5
295111	SUBLETTE E	2.08
910542	X3-005 E	0.51
914641	Y2-103	36.51
915011	Y3-013 1	3.04
915021	Y3-013 2	3.04
915031	Y3-013 3	3.04
916211	Z1-072 E	3.84
916221	Z1-073 E	4.34

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.02
916504	Z1-106 E2	1.02
916512	Z1-107 E	2.17
916522	Z1-108 E	2.01
918052	AA1-018 E	14.26
919221	AA1-146	14.08
919581	AA2-030	14.08
919621	AA2-039 C	1.65
919622	AA2-039 E	11.07
920272	AA2-123 E	1.98
924471	AB2-096	34.19
925161	AB2-173	2.51
925302	AB2-191 E	1.11
925581	AC1-033 C	1.11
925582	AC1-033 E	7.44
926311	AC1-109 1	1.55
926321	AC1-109 2	1.55
926331	AC1-110 1	1.53
926341	AC1-110 2	1.53
926351	AC1-111 1	0.62
926361	AC1-111 2	0.62
926371	AC1-111 3	0.62
926381	AC1-111 4	0.62
926391	AC1-111 5	0.62
926401	AC1-111 6	0.62
926431	AC1-114	1.92
926821	AC1-168 C O1	0.92
926822	AC1-168 E O1	6.16
927091	AC1-204 1	59.04
927101	AC1-204 2	59.09
927201	AC1-214 C O1	1.63
927202	AC1-214 E O1	5.18
927451	AC1-142A 1	3.45
927461	AC1-142A 2	3.44
927511	AC1-113 1	0.96
927521	AC1-113 2	0.96
927531	AC1-185 1	0.55
927541	AC1-185 2	0.55
927551	AC1-185 3	0.55
927561	AC1-185 4	0.55
927571	AC1-185 5	0.55
927581	AC1-185 6	0.55
927591	AC1-185 7	0.55
927601	AC1-185 8	0.55
930481	AB1-089	52.99
930501	AB1-091 O1	57.0
930741	AB1-122 1O1	58.08
930751	AB1-122 2O1	59.55
932881	AC2-115 1	1.92
932891	AC2-115 2	1.92
932921	AC2-116	0.67
932931	AC2-117	10.38

Bus #	Bus	MW Impact
933341	AC2-147 C	0.7
933342	AC2-147 E	1.14
933411	AC2-154 C	2.01
933412	AC2-154 E	3.28
933431	AC2-156 C O1	0.77
933432	AC2-156 E O1	1.26
933911	AD1-013 C	1.48
933912	AD1-013 E	2.37
933931	AD1-016 C	0.75
933932	AD1-016 E	1.22
934051	AD1-031 C O1	2.26
934052	AD1-031 E O1	3.68
934101	AD1-039 1	5.69
934111	AD1-039 2	5.84
934401	AD1-064 C O1	2.59
934402	AD1-064 E O1	12.1
934431	AD1-067 C	0.11
934432	AD1-067 E	0.44
934651	AD1-096 C	0.72
934652	AD1-096 E	1.17
934701	AD1-098 C O1	5.53
934702	AD1-098 E O1	4.04
934721	AD1-100 C	15.54
934722	AD1-100 E	72.54
934871	AD1-116 C	0.83
934872	AD1-116 E	1.36
934971	AD1-129 C	0.73
934972	AD1-129 E	0.49
935001	AD1-133 C O1	16.63
935002	AD1-133 E O1	11.09
936291	AD2-038 C O1	1.97
936292	AD2-038 E O1	13.16
936371	AD2-047 C O1	1.8
936372	AD2-047 E O1	19.38
936461	AD2-060	2.12
936511	AD2-066 C O1	6.81
936512	AD2-066 E O1	4.54
936781	AD2-101 C	3.5
936782	AD2-101 E	16.38
936791	AD2-102 C	9.68
936792	AD2-102 E	9.3
937001	AD2-134 C	2.2
937002	AD2-134 E	9.08
937031	AD2-137 C O1	2.69
937032	AD2-137 E O1	12.58
937051	AD2-140 C O1	2.69
937052	AD2-140 E O1	12.58
937061	AD2-141 C O1	2.67
937062	AD2-141 E O1	12.6
937071	AD2-142 C O1	5.38
937072	AD2-142 E O1	25.17
937121	AD2-148 C O1	2.74

Bus #	Bus	MW Impact
937122	AD2-148 E O1	12.81
937131	AD2-149 C O1	2.74
937132	AD2-149 E O1	12.81
937141	AD2-150 C O1	2.74
937142	AD2-150 E O1	12.81
937181	AD2-155 C O1	2.74
937182	AD2-155 E O1	12.81
937311	AD2-172 C	1.98
937312	AD2-172 E	2.73
937321	AD2-175 C	12.74
937322	AD2-175 E	8.5
937331	AD2-176 C O1	5.92
937332	AD2-176 E O1	3.95
937401	AD2-194 1	6.35
937411	AD2-194 2	6.35
937531	AD2-214 C	3.52
937532	AD2-214 E	1.66
938012	AE1-002 E O1	5.39
938511	AE1-070 1	7.46
938521	AE1-070 2	6.83
938851	AE1-113 C O1	7.05
938852	AE1-113 E O1	22.17
938861	AE1-114 C O1	2.89
938862	AE1-114 E O1	11.04
939051	AE1-134 1	1.09
939061	AE1-134 2	1.09
939321	AE1-163 C O1	4.94
939322	AE1-163 E O1	30.35
939351	AE1-166 C O1	8.26
939352	AE1-166 E O1	7.63
939401	AE1-172 C O1	4.9
939402	AE1-172 E O1	22.92
939631	AE1-193 C O1	5.51
939632	AE1-193 E O1	36.9
939681	AE1-198 C O1	16.37
939682	AE1-198 E O1	13.91
939691	AE1-199	1.92
939701	AE1-201 C	1.62
939702	AE1-201 E	0.36
939732	AE1-204 E	0.24
939861	AE1-222 1	64.14
939871	AE1-222 2	65.77
939921	AE1-228 C O1	8.09
939922	AE1-228 E O1	5.39
940101	AE1-252 C O1	8.34
940102	AE1-252 E O1	5.56
940501	AE2-035 C	1.98
940502	AE2-035 E	2.73
940621	AE2-049 C O1	7.3
940622	AE2-049 E O1	4.87
940631	AE2-050 C O1	9.78
940632	AE2-050 E O1	6.52

Bus #	Bus	MW Impact
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.54
940882	AE2-077 E	4.14
941131	AE2-107 C	5.89
941132	AE2-107 E	3.93
941551	AE2-152 C	10.59
941552	AE2-152 E	5.3
941561	AE2-153 C O1	3.82
941562	AE2-153 E O1	17.9
942421	AE2-255 C O1	2.44
942422	AE2-255 E O1	7.3
942651	AE2-281 C	0.71
942652	AE2-281 E	4.34
942881	AE2-307 C	17.93
942882	AE2-307 E	6.52
942911	AE2-310 C	7.09
942912	AE2-310 E	1.92
942991	AE2-321 C O1	6.6
942992	AE2-321 E O1	3.25
943121	AE2-341 C	10.31
943122	AE2-341 E	5.06
990901	L-005 E	8.02
BLUEG	BLUEG	4.52
CALDERWOOD	CALDERWOOD	0.06
CANNELTON	CANNELTON	0.07
CARR	CARR	0.62
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	1.13
CBM-W1	CBM-W1	21.91
CBM-W2	CBM-W2	42.89
CHEOAH	CHEOAH	0.06
CHILHOWEE	CHILHOWEE	0.02
ELMERSMITH	ELMERSMITH	0.07
G-007	G-007	1.74
GIBSON	GIBSON	0.03
HAMLET	HAMLET	0.45
MEC	MEC	29.98
O-066	O-066	11.15
RENSSELAER	RENSSELAER	0.49
SANTEETLA	SANTEETLA	0.02
TRIMBLE	TRIMBLE	0.53
WEC	WEC	6.45
Z1-043	Z1-043	22.8

17.14 Index 14

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229175	275232	WILTON ;3M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.88	163.06	DC	34.43

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	14.78
274722	S-055 E	13.73
274772	LINCOLN ;3U	2.67
274773	LINCOLN ;4U	2.67
274774	LINCOLN ;5U	2.67
274775	LINCOLN ;6U	2.67
274776	LINCOLN ;7U	2.67
274777	LINCOLN ;8U	2.67
274788	SE CHICAG;5U	5.44
274789	SE CHICAG;6U	5.44
274790	SE CHICAG;7U	5.44
274791	SE CHICAG;8U	5.44
274792	SE CHICAG;9U	5.4
274793	SE CHICAG;0U	5.4
274794	SE CHICAG;1U	5.4
274795	SE CHICAG;2U	5.4
274859	EASYR;U1 E	13.43
274860	EASYR;U2 E	13.43
274888	PILOT HIL;1E	23.57
274890	CAYUG;1U E	20.22
274891	CAYUG;2U E	20.22
275149	KEMPTON ;1E	23.57
290021	O50 E	23.7
290051	GSG-6; E	12.77
290108	LEEDK;1U E	29.68
293061	N-015 E	19.41
293644	O22 E1	12.53
293645	O22 E2	24.32
294392	P-010 E	24.65
294763	P-046 E	11.45
295109	WESTBROOK E	6.84
295111	SUBLETTE E	3.17
296125	R-030 C3	4.97
296128	R-030 E3	19.89
296271	R-030 C2	4.91
296272	R-030 E2	19.65
296308	R-030 C1	4.91
296309	R-030 E1	19.65
910542	X3-005 E	0.89
914641	Y2-103	54.9
915011	Y3-013 1	4.58
915021	Y3-013 2	4.58

Bus #	Bus	MW Impact
915031	Y3-013 3	4.58
916221	Z1-073 E	6.59
916502	Z1-106 E1	1.54
916504	Z1-106 E2	1.54
916512	Z1-107 E	3.16
916522	Z1-108 E	3.04
917502	Z2-087 E	25.7
918052	AA1-018 E	20.09
919581	AA2-030	18.9
920272	AA2-123 E	2.98
924041	AB2-047 C O1	4.74
924042	AB2-047 E O1	31.72
924471	AB2-096	51.72
925161	AB2-173	3.83
925302	AB2-191 E	1.69
926311	AC1-109 1	2.34
926321	AC1-109 2	2.34
926331	AC1-110 1	2.32
926341	AC1-110 2	2.32
926351	AC1-111 1	0.93
926361	AC1-111 2	0.93
926371	AC1-111 3	0.93
926381	AC1-111 4	0.93
926391	AC1-111 5	0.93
926401	AC1-111 6	0.93
926431	AC1-114	2.91
926821	AC1-168 C O1	1.43
926822	AC1-168 E O1	9.57
927091	AC1-204 1	88.75
927101	AC1-204 2	88.75
927451	AC1-142A 1	5.11
927461	AC1-142A 2	5.11
927511	AC1-113 1	1.45
927521	AC1-113 2	1.45
927531	AC1-185 1	0.84
927541	AC1-185 2	0.84
927551	AC1-185 3	0.84
927561	AC1-185 4	0.84
927571	AC1-185 5	0.84
927581	AC1-185 6	0.84
927591	AC1-185 7	0.84
927601	AC1-185 8	0.84
930481	AB1-089	80.32
930501	AB1-091 O1	93.8
930741	AB1-122 1O1	89.17
930751	AB1-122 2O1	90.13
932881	AC2-115 1	2.91
932891	AC2-115 2	2.91
932921	AC2-116	1.02
932931	AC2-117	6.51
933341	AC2-147 C	1.07
933342	AC2-147 E	1.74

Bus #	Bus	MW Impact
933411	AC2-154 C	3.2
933412	AC2-154 E	5.22
933431	AC2-156 C O1	1.17
933432	AC2-156 E O1	1.91
933911	AD1-013 C	2.25
933912	AD1-013 E	3.59
933931	AD1-016 C	1.13
933932	AD1-016 E	1.85
934101	AD1-039 1	8.74
934111	AD1-039 2	8.83
934401	AD1-064 C O1	3.91
934402	AD1-064 E O1	18.33
934431	AD1-067 C	0.16
934432	AD1-067 E	0.67
934651	AD1-096 C	1.09
934652	AD1-096 E	1.78
934701	AD1-098 C O1	8.41
934702	AD1-098 E O1	6.14
934721	AD1-100 C	29.39
934722	AD1-100 E	137.14
934871	AD1-116 C	1.17
934872	AD1-116 E	1.91
934971	AD1-129 C	1.1
934972	AD1-129 E	0.74
935001	AD1-133 C O1	27.36
935002	AD1-133 E O1	18.24
936291	AD2-038 C O1	2.88
936292	AD2-038 E O1	19.25
936371	AD2-047 C O1	2.86
936372	AD2-047 E O1	30.81
936461	AD2-060	3.37
936511	AD2-066 C O1	10.34
936512	AD2-066 E O1	6.89
936781	AD2-101 C	5.82
936782	AD2-101 E	27.26
936791	AD2-102 C	14.68
936792	AD2-102 E	14.11
937001	AD2-134 C	3.34
937002	AD2-134 E	13.79
937031	AD2-137 C O1	7.17
937032	AD2-137 E O1	33.55
937051	AD2-140 C O1	7.53
937052	AD2-140 E O1	35.24
937061	AD2-141 C O1	7.48
937062	AD2-141 E O1	35.28
937071	AD2-142 C O1	15.05
937072	AD2-142 E O1	70.47
937121	AD2-148 C O1	4.5
937122	AD2-148 E O1	21.09
937131	AD2-149 C O1	4.5
937132	AD2-149 E O1	21.09
937141	AD2-150 C O1	4.5

Bus #	Bus	MW Impact
937142	AD2-150 E O1	21.09
937181	AD2-155 C O1	4.5
937182	AD2-155 E O1	21.09
937311	AD2-172 C	3.01
937312	AD2-172 E	4.15
937321	AD2-175 C	20.99
937322	AD2-175 E	13.99
937331	AD2-176 C O1	8.96
937332	AD2-176 E O1	5.97
937401	AD2-194 1	9.54
937411	AD2-194 2	9.54
938012	AE1-002 E O1	14.38
938511	AE1-070 1	11.21
938521	AE1-070 2	10.26
938851	AE1-113 C O1	10.72
938852	AE1-113 E O1	33.71
938861	AE1-114 C O1	4.39
938862	AE1-114 E O1	16.8
939051	AE1-134 1	1.67
939061	AE1-134 2	1.67
939321	AE1-163 C O1	7.23
939322	AE1-163 E O1	44.39
939351	AE1-166 C O1	14.5
939352	AE1-166 E O1	13.38
939401	AE1-172 C O1	9.5
939402	AE1-172 E O1	44.49
939691	AE1-199	2.92
939701	AE1-201 C	2.45
939702	AE1-201 E	0.54
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.45
939742	AE1-205 E O1	17.19
939861	AE1-222 1	98.48
939871	AE1-222 2	99.53
939921	AE1-228 C O1	12.28
939922	AE1-228 E O1	8.19
940101	AE1-252 C O1	16.2
940102	AE1-252 E O1	10.8
940501	AE2-035 C	3.01
940502	AE2-035 E	4.15
940621	AE2-049 C O1	11.53
940622	AE2-049 E O1	7.69
940631	AE2-050 C O1	15.38
940632	AE2-050 E O1	10.26
940752	AE2-062 E	0.16
940762	AE2-063 E	0.16
940881	AE2-077 C	3.85
940882	AE2-077 E	6.28
941131	AE2-107 C	8.93
941132	AE2-107 E	5.96
941551	AE2-152 C	18.59
941552	AE2-152 E	9.29

Bus #	Bus	MW Impact
941561	AE2-153 C O1	6.06
941562	AE2-153 E O1	28.37
941731	AE2-173	7.31
942111	AE2-223 C	2.88
942112	AE2-223 E	19.28
942421	AE2-255 C O1	3.7
942422	AE2-255 E O1	11.11
942651	AE2-281 C	1.03
942652	AE2-281 E	6.34
942881	AE2-307 C	28.2
942882	AE2-307 E	10.26
942911	AE2-310 C	11.2
942912	AE2-310 E	3.02
942991	AE2-321 C O1	9.98
942992	AE2-321 E O1	4.92
943121	AE2-341 C	15.61
943122	AE2-341 E	7.67
BLUEG	BLUEG	8.02
CALDERWOOD	CALDERWOOD	0.11
CANNELTON	CANNELTON	0.1
CARR	CARR	0.97
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.72
CBM-W1	CBM-W1	37.33
CBM-W2	CBM-W2	70.69
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.73
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.74
MEC	MEC	46.43
O-066	O-066	17.5
RENSSELAER	RENSSELAER	0.77
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.95
WEC	WEC	9.73
Z1-043	Z1-043	35.42

17.15 Index 15

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229181	275233	WILTON ;4M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.6	162.81	DC	35.14

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	15.09
274722	S-055 E	14.02
274772	LINCOLN ;3U	2.74
274773	LINCOLN ;4U	2.74
274774	LINCOLN ;5U	2.74
274775	LINCOLN ;6U	2.74
274776	LINCOLN ;7U	2.74
274777	LINCOLN ;8U	2.74
274788	SE CHICAG;5U	5.56
274789	SE CHICAG;6U	5.56
274790	SE CHICAG;7U	5.56
274791	SE CHICAG;8U	5.56
274792	SE CHICAG;9U	5.52
274793	SE CHICAG;0U	5.52
274794	SE CHICAG;1U	5.52
274795	SE CHICAG;2U	5.52
274859	EASYR;U1 E	13.72
274860	EASYR;U2 E	13.72
274888	PILOT HIL;1E	24.06
274890	CAYUG;1U E	20.62
274891	CAYUG;2U E	20.62
275149	KEMPTON ;1E	24.06
290021	O50 E	24.2
290051	GSG-6; E	13.05
290108	LEEDK;1U E	30.31
293061	N-015 E	19.81
293516	O-009 E1	2.14
293517	O-009 E2	1.09
293518	O-009 E3	1.2
293644	O22 E1	12.79
293645	O22 E2	24.83
293715	O-029 E	12.21
293716	O-029 E	6.69
293717	O-029 E	6.15
294392	P-010 E	25.16
294763	P-046 E	11.69
295109	WESTBROOK E	6.98
295111	SUBLETTE E	3.24
296125	R-030 C3	5.07
296128	R-030 E3	20.29
296271	R-030 C2	5.01
296272	R-030 E2	20.05

Bus #	Bus	MW Impact
296308	R-030 C1	5.01
296309	R-030 E1	20.05
910542	X3-005 E	0.91
914641	Y2-103	56.07
915011	Y3-013 1	4.67
915021	Y3-013 2	4.67
915031	Y3-013 3	4.67
916221	Z1-073 E	6.73
916502	Z1-106 E1	1.58
916504	Z1-106 E2	1.58
916512	Z1-107 E	3.23
916522	Z1-108 E	3.1
917502	Z2-087 E	26.22
918052	AA1-018 E	20.53
919221	AA1-146	21.95
919581	AA2-030	21.95
920272	AA2-123 E	3.05
924041	AB2-047 C O1	4.84
924042	AB2-047 E O1	32.36
924471	AB2-096	52.83
925161	AB2-173	3.91
925302	AB2-191 E	1.73
926311	AC1-109 1	2.39
926321	AC1-109 2	2.39
926331	AC1-110 1	2.37
926341	AC1-110 2	2.37
926351	AC1-111 1	0.95
926361	AC1-111 2	0.95
926371	AC1-111 3	0.95
926381	AC1-111 4	0.95
926391	AC1-111 5	0.95
926401	AC1-111 6	0.95
926431	AC1-114	2.97
926821	AC1-168 C O1	1.46
926822	AC1-168 E O1	9.77
927091	AC1-204 1	90.65
927101	AC1-204 2	90.65
927451	AC1-142A 1	5.22
927461	AC1-142A 2	5.22
927511	AC1-113 1	1.48
927521	AC1-113 2	1.48
927531	AC1-185 1	0.86
927541	AC1-185 2	0.86
927551	AC1-185 3	0.86
927561	AC1-185 4	0.86
927571	AC1-185 5	0.86
927581	AC1-185 6	0.86
927591	AC1-185 7	0.86
927601	AC1-185 8	0.86
930481	AB1-089	82.03
930501	AB1-091 O1	95.74
930741	AB1-122 1O1	91.06

Bus #	Bus	MW Impact
930751	AB1-122 2O1	92.05
932881	AC2-115 1	2.97
932891	AC2-115 2	2.97
932921	AC2-116	1.04
932931	AC2-117	6.65
933341	AC2-147 C	1.09
933342	AC2-147 E	1.78
933411	AC2-154 C	3.27
933412	AC2-154 E	5.33
933431	AC2-156 C O1	1.19
933432	AC2-156 E O1	1.95
933911	AD1-013 C	2.3
933912	AD1-013 E	3.67
933931	AD1-016 C	1.16
933932	AD1-016 E	1.89
934101	AD1-039 1	8.92
934111	AD1-039 2	9.02
934401	AD1-064 C O1	4.0
934402	AD1-064 E O1	18.72
934431	AD1-067 C	0.16
934432	AD1-067 E	0.69
934651	AD1-096 C	1.11
934652	AD1-096 E	1.81
934701	AD1-098 C O1	8.59
934702	AD1-098 E O1	6.27
934721	AD1-100 C	29.97
934722	AD1-100 E	139.86
934871	AD1-116 C	1.2
934872	AD1-116 E	1.95
934971	AD1-129 C	1.13
934972	AD1-129 E	0.75
935001	AD1-133 C O1	27.93
935002	AD1-133 E O1	18.62
936291	AD2-038 C O1	2.94
936292	AD2-038 E O1	19.66
936371	AD2-047 C O1	2.92
936372	AD2-047 E O1	31.45
936461	AD2-060	3.44
936511	AD2-066 C O1	10.56
936512	AD2-066 E O1	7.04
936781	AD2-101 C	5.94
936782	AD2-101 E	27.82
936791	AD2-102 C	14.99
936792	AD2-102 E	14.41
937001	AD2-134 C	3.41
937002	AD2-134 E	14.09
937031	AD2-137 C O1	7.3
937032	AD2-137 E O1	34.17
937051	AD2-140 C O1	7.67
937052	AD2-140 E O1	35.89
937061	AD2-141 C O1	7.62
937062	AD2-141 E O1	35.93

Bus #	Bus	MW Impact
937071	AD2-142 C O1	15.33
937072	AD2-142 E O1	71.78
937121	AD2-148 C O1	4.6
937122	AD2-148 E O1	21.53
937131	AD2-149 C O1	4.6
937132	AD2-149 E O1	21.53
937141	AD2-150 C O1	4.6
937142	AD2-150 E O1	21.53
937181	AD2-155 C O1	4.6
937182	AD2-155 E O1	21.53
937311	AD2-172 C	3.07
937312	AD2-172 E	4.24
937321	AD2-175 C	21.42
937322	AD2-175 E	14.28
937331	AD2-176 C O1	9.15
937332	AD2-176 E O1	6.1
937401	AD2-194 1	9.75
937411	AD2-194 2	9.75
938012	AE1-002 E O1	14.65
938511	AE1-070 1	11.45
938521	AE1-070 2	10.48
938851	AE1-113 C O1	10.95
938852	AE1-113 E O1	34.43
938861	AE1-114 C O1	4.49
938862	AE1-114 E O1	17.15
939051	AE1-134 1	1.71
939061	AE1-134 2	1.71
939321	AE1-163 C O1	7.38
939322	AE1-163 E O1	45.35
939351	AE1-166 C O1	14.79
939352	AE1-166 E O1	13.65
939401	AE1-172 C O1	9.69
939402	AE1-172 E O1	45.37
939691	AE1-199	2.98
939701	AE1-201 C	2.5
939702	AE1-201 E	0.55
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.7
939742	AE1-205 E O1	17.54
939861	AE1-222 1	100.56
939871	AE1-222 2	101.65
939921	AE1-228 C O1	12.54
939922	AE1-228 E O1	8.36
940101	AE1-252 C O1	16.52
940102	AE1-252 E O1	11.01
940501	AE2-035 C	3.07
940502	AE2-035 E	4.24
940621	AE2-049 C O1	11.77
940622	AE2-049 E O1	7.85
940631	AE2-050 C O1	15.7
940632	AE2-050 E O1	10.47
940752	AE2-062 E	0.16

Bus #	Bus	MW Impact
940762	AE2-063 E	0.16
940881	AE2-077 C	3.93
940882	AE2-077 E	6.42
941131	AE2-107 C	9.12
941132	AE2-107 E	6.08
941551	AE2-152 C	18.96
941552	AE2-152 E	9.48
941561	AE2-153 C O1	6.18
941562	AE2-153 E O1	28.96
941731	AE2-173	7.45
942111	AE2-223 C	2.94
942112	AE2-223 E	19.67
942421	AE2-255 C O1	3.78
942422	AE2-255 E O1	11.34
942651	AE2-281 C	1.05
942652	AE2-281 E	6.48
942881	AE2-307 C	28.78
942882	AE2-307 E	10.47
942911	AE2-310 C	11.43
942912	AE2-310 E	3.09
942991	AE2-321 C O1	10.2
942992	AE2-321 E O1	5.02
943121	AE2-341 C	15.94
943122	AE2-341 E	7.83
BLUEG	BLUEG	8.2
CALDERWOOD	CALDERWOOD	0.12
CANNELTON	CANNELTON	0.1
CARR	CARR	0.99
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.75
CBM-W1	CBM-W1	38.13
CBM-W2	CBM-W2	72.15
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.04
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.79
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.76
MEC	MEC	47.41
O-066	O-066	17.87
RENSSELAER	RENSSELAER	0.78
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.98
WEC	WEC	9.93
Z1-043	Z1-043	36.17

17.16 Index 16

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229851	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L2001__B-S_+_345-L2003__R-S-B	tower	1846.0	147.48	149.77	DC	42.11

Bus #	Bus	MW Impact
274654	BRAIDWOOD;1U	33.97
274655	BRAIDWOOD;2U	32.44
274660	LASCO STA;1U	21.33
274661	LASCO STA;2U	21.37
274847	GR RIDGE ;BU	0.46
274853	TWINGROVE;U1	0.72
274854	TWINGROVE;U2	0.72
274863	CAYUGA RI;1U	0.94
274864	CAYUGA RI;2U	0.94
274871	GR RIDGE ;2U	0.59
274881	PLEAS RDG;2U	0.62
274887	PILOT HIL;1U	0.62
274888	PILOT HIL;1E	20.33
274890	CAYUG;1U E	31.01
274891	CAYUG;2U E	31.01
275149	KEMPTON ;1E	20.33
276150	W2-048 E	1.39
290261	S-027 E	23.71
290265	S-028 E	23.71
293061	N-015 E	15.16
294392	P-010 E	19.26
296125	R-030 C3	6.08
296128	R-030 E3	24.33
296271	R-030 C2	6.01
296272	R-030 E2	24.04
296308	R-030 C1	6.01
296309	R-030 E1	24.04
905081	W4-005 C	0.7
905082	W4-005 E	38.29
909052	X2-022 E	19.29
917501	Z2-087 C	0.57
917502	Z2-087 E	31.42
924041	AB2-047 C O1	5.77
924042	AB2-047 E O1	38.6
924261	AB2-070 C O1	2.84
924262	AB2-070 E O1	18.99
925771	AC1-053 C	2.79
925772	AC1-053 E	18.64
926821	AC1-168 C O1	0.69
926822	AC1-168 E O1	4.62

Bus #	Bus	MW Impact
930501	AB1-091 O1	92.41
933411	AC2-154 C	2.76
933412	AC2-154 E	4.5
934721	AD1-100 C	51.69
934722	AD1-100 E	241.21
935001	AD1-133 C O1	18.06
935002	AD1-133 E O1	12.04
935141	AD1-148	5.04
936371	AD2-047 C O1	2.47
936372	AD2-047 E O1	26.58
936461	AD2-060	2.9
936771	AD2-100 C O1	10.69
936772	AD2-100 E O1	7.13
936781	AD2-101 C	3.9
936782	AD2-101 E	18.24
936972	AD2-131 E O1	2.25
937121	AD2-148 C O1	4.45
937122	AD2-148 E O1	20.84
937131	AD2-149 C O1	4.45
937132	AD2-149 E O1	20.84
937141	AD2-150 C O1	4.45
937142	AD2-150 E O1	20.84
937161	AD2-153 C O1	3.91
937162	AD2-153 E O1	18.29
937171	AD2-154 C O1	3.91
937172	AD2-154 E O1	18.29
937181	AD2-155 C O1	4.45
937182	AD2-155 E O1	20.84
937211	AD2-159 C	4.14
937212	AD2-159 E	19.37
937321	AD2-175 C	20.73
937322	AD2-175 E	13.82
938012	AE1-002 E O1	28.93
939351	AE1-166 C O1	22.6
939352	AE1-166 E O1	20.86
939401	AE1-172 C O1	15.93
939402	AE1-172 E O1	74.58
939741	AE1-205 C O1	15.3
939742	AE1-205 E O1	21.13
940101	AE1-252 C O1	27.15
940102	AE1-252 E O1	18.1
940621	AE2-049 C O1	9.11
940622	AE2-049 E O1	6.07
940631	AE2-050 C O1	20.86
940632	AE2-050 E O1	13.9
941551	AE2-152 C	28.97
941552	AE2-152 E	14.48
941561	AE2-153 C O1	7.41
941562	AE2-153 E O1	34.7
941731	AE2-173	8.89
942111	AE2-223 C	3.52
942112	AE2-223 E	23.57

Bus #	Bus	MW Impact
942481	AE2-261 C	13.71
942482	AE2-261 E	9.14
942881	AE2-307 C	38.24
942882	AE2-307 E	13.9
942911	AE2-310 C	8.85
942912	AE2-310 E	2.39
951741	J474 C	1.79
951742	J474 E	9.69
953741	J826 C	1.05
953742	J826 E	5.67
954181	J884	9.28
BLUEG	BLUEG	0.29
CARR	CARR	0.29
CATAWBA	CATAWBA	0.01
CBM-S1	CBM-S1	2.5
CBM-W1	CBM-W1	3.98
CBM-W2	CBM-W2	47.18
CIN	CIN	2.43
G-007	G-007	0.8
HAMLET	HAMLET	0.07
IPL	IPL	1.03
MEC	MEC	12.37
O-066	O-066	5.13
RENSSELAER	RENSSELAER	0.23
TRIMBLE	TRIMBLE	0.07
WEC	WEC	0.85
Z1-043	Z1-043	15.21

17.17 Index 17

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229846	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L2001__B-S+_345-L2003__R-S-B	tower	1846.0	155.43	157.72	DC	42.11

Bus #	Bus	MW Impact
274654	BRAIDWOOD;1U	33.97
274655	BRAIDWOOD;2U	32.44
274660	LASCO STA;1U	21.33
274661	LASCO STA;2U	21.37
274847	GR RIDGE ;BU	0.46
274853	TWINGROVE;U1	0.72
274854	TWINGROVE;U2	0.72
274863	CAYUGA RI;1U	0.94
274864	CAYUGA RI;2U	0.94
274871	GR RIDGE ;2U	0.59
274881	PLEAS RDG;2U	0.62
274887	PILOT HIL;1U	0.62
274888	PILOT HIL;1E	20.33
274890	CAYUG;1U E	31.01
274891	CAYUG;2U E	31.01
275149	KEMPTON ;1E	20.33
276150	W2-048 E	1.39
290261	S-027 E	23.71
290265	S-028 E	23.71
293061	N-015 E	15.16
294392	P-010 E	19.26
296125	R-030 C3	6.08
296128	R-030 E3	24.33
296271	R-030 C2	6.01
296272	R-030 E2	24.04
296308	R-030 C1	6.01
296309	R-030 E1	24.04
905081	W4-005 C	0.7
905082	W4-005 E	38.29
909052	X2-022 E	19.29
917501	Z2-087 C	0.57
917502	Z2-087 E	31.42
924041	AB2-047 C O1	5.77
924042	AB2-047 E O1	38.6
924261	AB2-070 C O1	2.84
924262	AB2-070 E O1	18.99
925771	AC1-053 C	2.79
925772	AC1-053 E	18.64
926821	AC1-168 C O1	0.69
926822	AC1-168 E O1	4.62

Bus #	Bus	MW Impact
930501	AB1-091 O1	92.41
933411	AC2-154 C	2.76
933412	AC2-154 E	4.5
934721	AD1-100 C	51.69
934722	AD1-100 E	241.21
935001	AD1-133 C O1	18.06
935002	AD1-133 E O1	12.04
935141	AD1-148	5.04
936371	AD2-047 C O1	2.47
936372	AD2-047 E O1	26.58
936461	AD2-060	2.9
936771	AD2-100 C O1	10.69
936772	AD2-100 E O1	7.13
936781	AD2-101 C	3.9
936782	AD2-101 E	18.24
936972	AD2-131 E O1	2.25
937031	AD2-137 C O1	18.76
937032	AD2-137 E O1	87.84
937121	AD2-148 C O1	4.45
937122	AD2-148 E O1	20.84
937131	AD2-149 C O1	4.45
937132	AD2-149 E O1	20.84
937141	AD2-150 C O1	4.45
937142	AD2-150 E O1	20.84
937161	AD2-153 C O1	3.91
937162	AD2-153 E O1	18.29
937171	AD2-154 C O1	3.91
937172	AD2-154 E O1	18.29
937181	AD2-155 C O1	4.45
937182	AD2-155 E O1	20.84
937211	AD2-159 C	4.14
937212	AD2-159 E	19.37
937321	AD2-175 C	20.73
937322	AD2-175 E	13.82
938012	AE1-002 E O1	71.07
939351	AE1-166 C O1	22.6
939352	AE1-166 E O1	20.86
939401	AE1-172 C O1	15.93
939402	AE1-172 E O1	74.58
939741	AE1-205 C O1	15.3
939742	AE1-205 E O1	21.13
940101	AE1-252 C O1	27.15
940102	AE1-252 E O1	18.1
940621	AE2-049 C O1	9.11
940622	AE2-049 E O1	6.07
940631	AE2-050 C O1	20.86
940632	AE2-050 E O1	13.9
941551	AE2-152 C	28.97
941552	AE2-152 E	14.48
941561	AE2-153 C O1	7.41
941562	AE2-153 E O1	34.7
941731	AE2-173	8.89

Bus #	Bus	MW Impact
942111	AE2-223 C	3.52
942112	AE2-223 E	23.57
942481	AE2-261 C	13.71
942482	AE2-261 E	9.14
942881	AE2-307 C	38.24
942882	AE2-307 E	13.9
942911	AE2-310 C	8.85
942912	AE2-310 E	2.39
951741	J474 C	1.79
951742	J474 E	9.69
953741	J826 C	1.05
953742	J826 E	5.67
954181	J884	9.28
BLUEG	BLUEG	0.29
CARR	CARR	0.29
CATAWBA	CATAWBA	0.01
CBM-S1	CBM-S1	2.5
CBM-W1	CBM-W1	3.98
CBM-W2	CBM-W2	47.18
CIN	CIN	2.43
G-007	G-007	0.8
HAMLET	HAMLET	0.07
IPL	IPL	1.03
MEC	MEC	12.37
O-066	O-066	5.13
RENSSELAER	RENSSELAER	0.23
TRIMBLE	TRIMBLE	0.07
WEC	WEC	0.85
Z1-043	Z1-043	15.21

17.18 Index 18

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
7078669	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	122.25	122.74	DC	15.14

Bus #	Bus	MW Impact
247900	05FR-11G E	6.83
247901	05FR-12G E	6.72
247902	05FR-21G E	7.18
247903	05FR-22G E	6.87
247904	05FR-3G E	13.92
247905	05FR-4G E	10.47
247906	05MDL-1G E	15.59
247907	05MDL-2G E	7.73
247912	05MDL-3G E	8.08
247913	05MDL-4G E	7.81
247943	T-127 E	7.81
274722	S-055 E	6.52
274809	UNIV PK N;5U	0.64
274811	UNIV PK N;7U	0.64
274812	UNIV PK N;8U	0.64
274814	UNIV PK N;0U	0.64
274815	UNIV PK N;XU	0.64
274888	PILOT HIL;1E	10.28
275149	KEMPTON ;1E	10.28
290021	O50 E	11.42
293061	N-015 E	8.92
293644	O22 E1	5.91
293645	O22 E2	11.47
294392	P-010 E	11.33
909145	X2-052	28.77
914641	Y2-103	26.09
915011	Y3-013 1	2.17
915021	Y3-013 2	2.17
915031	Y3-013 3	2.17
916502	Z1-106 E1	0.73
916504	Z1-106 E2	0.73
916512	Z1-107 E	1.49
916522	Z1-108 E	1.44
917711	Z2-114 C	0.05
917712	Z2-114 E	0.39
918052	AA1-018 E	9.77
920272	AA2-123 E	1.43
926311	AC1-109 1	1.1
926321	AC1-109 2	1.1
926331	AC1-110 1	1.09
926341	AC1-110 2	1.09

Bus #	Bus	MW Impact
926351	AC1-111 1	0.44
926361	AC1-111 2	0.44
926371	AC1-111 3	0.44
926381	AC1-111 4	0.44
926391	AC1-111 5	0.44
926401	AC1-111 6	0.44
927091	AC1-204 1	41.76
927101	AC1-204 2	41.76
927451	AC1-142A 1	2.41
927461	AC1-142A 2	2.41
930042	AB1-006 E	16.99
930391	AB1-080	1.7
930501	AB1-091 O1	40.0
930741	AB1-122 1O1	41.84
930751	AB1-122 2O1	42.51
932601	AC2-080 C O1	3.72
932602	AC2-080 E O1	24.87
932931	AC2-117	5.16
933411	AC2-154 C	1.4
933412	AC2-154 E	2.28
933431	AC2-156 C O1	0.55
933432	AC2-156 E O1	0.9
933931	AD1-016 C	0.54
933932	AD1-016 E	0.88
934101	AD1-039 1	4.1
934111	AD1-039 2	4.17
934721	AD1-100 C	11.08
934722	AD1-100 E	51.72
934871	AD1-116 C	0.57
934872	AD1-116 E	0.93
935271	AD1-137 C	5.67
935272	AD1-137 E	37.94
936291	AD2-038 C O1	1.4
936292	AD2-038 E O1	9.4
936371	AD2-047 C O1	1.25
936372	AD2-047 E O1	13.44
936461	AD2-060	1.47
936511	AD2-066 C O1	4.97
936512	AD2-066 E O1	3.31
937031	AD2-137 C O1	1.91
937032	AD2-137 E O1	8.97
937041	AD2-138 C	5.03
937042	AD2-138 E	23.55
937051	AD2-140 C O1	1.91
937052	AD2-140 E O1	8.96
937061	AD2-141 C O1	1.9
937062	AD2-141 E O1	8.97
937071	AD2-142 C O1	3.83
937072	AD2-142 E O1	17.91
937121	AD2-148 C O1	1.92
937122	AD2-148 E O1	8.99
937131	AD2-149 C O1	1.92

Bus #	Bus	MW Impact
937132	AD2-149 E O1	8.99
937141	AD2-150 C O1	1.92
937142	AD2-150 E O1	8.99
937181	AD2-155 C O1	1.92
937182	AD2-155 E O1	8.99
937321	AD2-175 C	8.94
937322	AD2-175 E	5.96
937331	AD2-176 C O1	4.28
937332	AD2-176 E O1	2.85
937401	AD2-194 1	4.49
937411	AD2-194 2	4.49
938012	AE1-002 E O1	3.84
938511	AE1-070 1	5.28
938521	AE1-070 2	4.83
938671	AE1-089 C	74.51
938672	AE1-089 E	102.29
938851	AE1-113 C O1	5.17
938852	AE1-113 E O1	16.24
939321	AE1-163 C O1	3.53
939322	AE1-163 E O1	21.69
939351	AE1-166 C O1	5.83
939352	AE1-166 E O1	5.39
939641	AE1-194 C	5.59
939642	AE1-194 E	37.41
939651	AE1-195 C	5.59
939652	AE1-195 E	37.41
939701	AE1-201 C	1.17
939702	AE1-201 E	0.26
939732	AE1-204 E	0.17
939861	AE1-222 1	46.21
939871	AE1-222 2	46.95
940261	AE2-008	45.68
940581	AE2-045 C O1	12.66
940582	AE2-045 E O1	17.38
940621	AE2-049 C O1	5.07
940622	AE2-049 E O1	3.38
940631	AE2-050 C O1	6.95
940632	AE2-050 E O1	4.63
940752	AE2-062 E	0.07
940762	AE2-063 E	0.07
941551	AE2-152 C	7.48
941552	AE2-152 E	3.74
941561	AE2-153 C O1	2.67
941562	AE2-153 E O1	12.48
941571	AE2-154 C	3.17
941572	AE2-154 E	21.24
942421	AE2-255 C O1	1.78
942422	AE2-255 E O1	5.35
942651	AE2-281 C	0.5
942652	AE2-281 E	3.1
942881	AE2-307 C	12.74
942882	AE2-307 E	4.63

Bus #	Bus	MW Impact
942911	AE2-310 C	4.93
942912	AE2-310 E	1.33
942991	AE2-321 C O1	4.77
942992	AE2-321 E O1	2.35
943121	AE2-341 C	7.34
943122	AE2-341 E	3.61
CARR	CARR	0.6
CATAWBA	CATAWBA	0.06
CBM-S1	CBM-S1	4.5
CBM-W1	CBM-W1	19.69
CBM-W2	CBM-W2	68.05
CIN	CIN	6.99
G-007	G-007	1.67
HAMLET	HAMLET	0.18
IPL	IPL	3.23
LGEE	LGEE	0.71
MEC	MEC	25.2
O-066	O-066	10.74
RENSSELAER	RENSSELAER	0.48
WEC	WEC	4.68
Z1-043	Z1-043	17.58

Affected Systems

18 Affected Systems

18.1 LG&E

LG&E Impacts to be determined during later study phases (as applicable).

18.2 MISO

MISO Impacts to be determined during later study phases (as applicable).

18.3 TVA

TVA Impacts to be determined during later study phases (as applicable).

18.4 Duke Energy Progress

Duke Energy Progress Impacts to be determined during later study phases (as applicable).

18.5 NYISO

NYISO Impacts to be determined during later study phases (as applicable).

Contingency Name	Contingency Definition
COMED_P7_345-L2001__B-S+_345-L2003__R-S-B	CONTINGENCY 'COMED_P7_345-L2001__B-S+_345-L2003__R-S-B' TRIP BRANCH FROM BUS 940630 TO BUS 270728 CKT 1 / AE2-050 TAP 345 E FRA; B 345 TRIP BRANCH FROM BUS 270728 TO BUS 270766 CKT 1 / E FRA; B 345 GOODI;3B 345 TRIP BRANCH FROM BUS 270728 TO BUS 274750 CKT 1 / E FRA; B 345 CRETE;BP 345 TRIP BRANCH FROM BUS 270671 TO BUS 270729 CKT 1 / BRAID; R 345 E FRA; R 345 END
COMED_P7_345-L6607__B-S+_345-L97008__R-S	CONTINGENCY 'COMED_P7_345-L6607__B-S+_345-L97008__R-S' TRIP BRANCH FROM BUS 270728 TO BUS 274750 CKT 1 / E FRANKFO; B 345 CRETE EC ;BP 345 TRIP BRANCH FROM BUS 274804 TO BUS 243229 CKT 1 / UNIV PK N;RP 345 05OLIVE 345 END
AEP_P1-2_#695A	CONTINGENCY 'AEP_P1-2_#695A' OPEN BRANCH FROM BUS 243206 TO BUS 270644 CKT 1 / 243206 05DUMONT 765 270644 WILTON ; 765 1 END
COMED_P7_345-L94507__B-S+_345-L97008__R-S	CONTINGENCY 'COMED_P7_345-L94507__B-S+_345-L97008__R-S' TRIP BRANCH FROM BUS 274750 TO BUS 255112 CKT 1 / CRETE;BP 345 17STJOHN 345 TRIP BRANCH FROM BUS 274804 TO BUS 243229 CKT 1 / UPNOR;RP 345 05OLIVE 345 END
COMED_P1-2_345-L8014__S-B	CONTINGENCY 'COMED_P1-2_345-L8014__S-B' TRIP BRANCH FROM BUS 935000 TO BUS 270717 CKT 1 / AD1-133 TAP 345 DRESDEN ; R 345 END
COMED_P7_345-L2001__B-S+_345-L2003__R-S-A	CONTINGENCY 'COMED_P7_345-L2001__B-S+_345-L2003__R-S-A' TRIP BRANCH FROM BUS 270670 TO BUS 940630 CKT 1 / BRAID; B 345 AE2-050 TAP 345 TRIP BRANCH FROM BUS 270671 TO BUS 270729 CKT 1 / BRAID; R 345 E FRA; R 345 END
COMED_P1-2_345-L11212__B-S-A	CONTINGENCY 'COMED_P1-2_345-L11212__B-S-A' TRIP BRANCH FROM BUS 270926 TO BUS 937030 CKT 1 / WILTO; B 345 AD2-137 TAP 345 END
COMED_P4_112-65-BT2-3__	CONTINGENCY 'COMED_P4_112-65-BT2-3__' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 / WILTO; 765 COLLI; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270644 CKT 1 / WILTO;3M 345 WILTO; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270926 CKT 1 / WILTO;3M 345 WILTO; B 345 TRIP BRANCH FROM BUS 275232 TO BUS 275332 CKT 1 / WILTO;3M 345 WILTO;3C 33 END
COMED_P4_112-65-BT3-4__	CONTINGENCY 'COMED_P4_112-65-BT3-4__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 275232 TO BUS 270644 CKT 1 / WILTO;3M 345 WILTO; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270926 CKT 1 / WILTO;3M 345 WILTO; B 345 TRIP BRANCH FROM BUS 275232 TO BUS 275332 CKT 1 / WILTO;3M 345 WILTO;3C 33 END

Contingency Name	Contingency Definition
AEP_P4_#2978_05DUMONT 765_B	CONTINGENCY 'AEP_P4_#2978_05DUMONT 765_B' OPEN BRANCH FROM BUS 243206 TO BUS 243207 CKT 1 / 243206 05DUMONT 765 243207 05GRNTWN 765 1 OPEN BRANCH FROM BUS 243206 TO BUS 270644 CKT 1 / 243206 05DUMONT 765 270644 WILTON ; 765 1 END
COMED_P1-2_765-L11216__-S	CONTINGENCY 'COMED_P1-2_765-L11216__-S' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 / WILTO; 765 COLLI; 765 END
Base Case	
COMED_P4_023-65-BT2-3__	CONTINGENCY 'COMED_P4_023-65-BT2-3__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 270607 TO BUS 270630 CKT 1 / COLLI; 765 PLANO; 765 END
COMED_P1-2_345-L2004_AR-S-B	CONTINGENCY 'COMED_P1-2_345-L2004_AR-S-B' TRIP BRANCH FROM BUS 941560 TO BUS 270711 CKT 1 / AE2-153 TAP 345 DAVIS; R 345 END
COMED_P4_112-65-BT5-6__	CONTINGENCY 'COMED_P4_112-65-BT5-6__' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 / WILTO; 765 COLLI; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270644 CKT 1 / WILTO;4M 345 WILTO; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270927 CKT 1 / WILTO;4M 345 WILTO; R 345 TRIP BRANCH FROM BUS 275233 TO BUS 275333 CKT 1 / WILTO;4M 345 WILTO;4C 33 END
COMED_P1-2_345-L94507_B-S	CONTINGENCY 'COMED_P1-2_345-L94507_B-S' TRIP BRANCH FROM BUS 274750 TO BUS 255112 CKT 1 / CRETE;BP 345 17STJOHN 345 END
COMED_P4_112-65-BT4-5__	CONTINGENCY 'COMED_P4_112-65-BT4-5__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 275233 TO BUS 270644 CKT 1 / WILTO;4M 345 WILTO; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270927 CKT 1 / WILTO;4M 345 WILTO; R 345 TRIP BRANCH FROM BUS 275233 TO BUS 275333 CKT 1 / WILTO;4M 345 WILTO;4C 33 END
COMED_P4_023-65-BT4-5__	CONTINGENCY 'COMED_P4_023-65-BT4-5__' TRIP BRANCH FROM BUS 275168 TO BUS 270607 CKT 1 / COLLI;2M 345 COLLI; 765 TRIP BRANCH FROM BUS 275168 TO BUS 270697 CKT 1 / COLLI;2M 345 COLLI; R 345 TRIP BRANCH FROM BUS 275168 TO BUS 275268 CKT 1 / COLLI;2M 345 COLLI;2C 33 TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 END

Short Circuit

19 Short Circuit

Bus Number	Bus Name	BREAKER	Rating Type	Breaker Capacity (Amps)	Duty Percent with AE2-153_BKRRating_COMED_OSF_Area=222.csv	Duty Percent without AE2-153_without_BKRRating_COMED_OSF_Area=222.csv	Duty Percent Difference	COST (\$)	TIME ESTIMATE (Months)	REINFORCEMENT DESCRIPTION
270670	BRAIDWORK 345.kV	20 4-7 T141	S	63000	100.43%	99.49%	0.93%	\$6,1M Included in attachment facilities	24-30 months	Install series inductor on the ComEd side of the interconnecting generator lead. Suggested size is 5 ohms.
270671	BRAIDWORK 345.kV	20 BT 11-14	S	63000	100.36%	99.43%	0.94%	Included in above reinforcement		

20 Secondary Point of Interconnection General

20.1 Secondary Point of Interconnection

Under this option, Queue Position AE2-153, a 200 MW wind facility, proposes to interconnect with the ComEd transmission system by tying into the 138kV bus at the Interconnection Substation proposed in the AE1-166 project.

20.2 Cost Summary

Will be supplied in Impact Study should the Interconnection Customer elect this option.

21 Network Impacts for Secondary Point of Interconnection

The Queue Project AE2-153 was evaluated as a 200.0 MW (Capacity 35.2 MW) injection tapping the Wilmington to Davis Creek 138kV line in the ComEd area. Project AE2-153 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AE2-153 was studied with a commercial probability of 0.53. Potential network impacts were as follows:

Summer Peak Load Flow

22 Generation Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

23 Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

24 Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC/D C	MW IMPACT
1542324	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	122.79	123.03	DC	14.73
1542325	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	COMED_P4_112-65-BT4-5	breaker	1409.0	112.62	112.87	DC	16.27
1542326	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	COMED_P4_112-65-BT3-4	breaker	1409.0	112.62	112.87	DC	16.27
2229371	255104	17GREEN_AC RE	NIPS	270771	GREENACRE; T	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	111.92	112.05	DC	17.54
2229239	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	133.25	133.36	DC	18.27
2229240	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_023-65-BT2-3	breaker	1091.0	133.07	133.17	DC	18.43
2229241	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_112-65-BT4-5	breaker	1091.0	132.72	132.83	DC	18.43
2229242	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_112-65-BT3-4	breaker	1091.0	132.72	132.82	DC	18.43
1541920	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	173.14	173.32	DC	31.28
1543537	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L94507_B-S+_345-L97008_R-S	tower	4105.0	107.04	107.14	DC	63.56
1543538	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L6607_B-S+_345-L97008_R-S	tower	4105.0	104.95	105.04	DC	63.64
2229444	270677	BURNHAM ;OR	CE	255109	17MUNSTER	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1441.0	100.82	100.99	DC	28.23
2229307	270716	DRESDEN ; B	CE	270928	WOLFS ; B	CE	1	COMED_P4_012-45-BT5-6	breaker	1479.0	120.51	121.95	DC	21.21
2229342	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1399.0	114.49	114.61	DC	24.91
2229343	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	COMED_P4_023-65-BT2-3	breaker	1399.0	114.04	114.17	DC	25.07
2229344	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	COMED_P4_112-65-BT4-5	breaker	1399.0	113.97	114.09	DC	25.06
2229345	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	COMED_P4_112-65-BT3-4	breaker	1399.0	113.96	114.08	DC	25.06
1542191	270771	GREENACRE; T	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	125.73	125.87	DC	17.54
2229244	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1091.0	133.25	133.36	DC	18.27

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC/D C	MW IMPACT
2229245	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_023-65-BT2-3__	breaker	1091.0	133.07	133.17	DC	18.43
2229246	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_112-65-BT4-5__	breaker	1091.0	132.72	132.83	DC	18.43
2229247	270886	ST JOHN ; T	CE	255104	17GREEN_AC RE	NIPS	1	COMED_P4_112-65-BT3-4__	breaker	1091.0	132.72	132.82	DC	18.43
2229177	270926	WILTON ; B	CE	275232	WILTON ;3M	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.83	162.99	DC	33.13
2229179	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.55	162.73	DC	33.83
8772264	271567	GOOSE LK ; R	CE	271785	GOOSE LK ;RT	CE	1	COMED_P4_012-45-BT5-6__	breaker	449.0	100.71	101.97	DC	12.49
2229195	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1399.0	159.66	159.76	DC	24.59
2229196	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_023-65-BT2-3__	breaker	1399.0	159.21	159.32	DC	24.75
2229197	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_112-65-BT4-5__	breaker	1399.0	159.16	159.27	DC	24.74
2229198	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_012-65-BT3-4__	breaker	1399.0	159.15	159.26	DC	24.74
1542057	274804	UNIV PK N ;RP	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	138.54	138.75	DC	21.15
1542058	274804	UNIV PK N ;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_023-65-BT2-3__	breaker	971.0	137.43	137.64	DC	21.35
1542059	274804	UNIV PK N ;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_112-65-BT4-5__	breaker	971.0	137.41	137.63	DC	21.35
1542060	274804	UNIV PK N ;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_112-65-BT3-4__	breaker	971.0	137.41	137.63	DC	21.35
1542061	274804	UNIV PK N ;RP	CE	243229	05OLIVE	AEP	1	COMED_P4_023-65-BT4-5__	breaker	971.0	137.41	137.63	DC	21.35
2229175	275232	WILTON ;3M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.83	162.99	DC	33.13
2229181	275233	WILTON ;4M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.55	162.73	DC	33.83
2229853	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L17704AR-S_+_345-L17907TB-S-A	tower	1846.0	137.26	138.81	DC	28.59
14557937	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L2001_B-S_+_345-L2003_R-S	tower	1846.0	145.97	147.24	DC	23.42
2229848	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L17704AR-S_+_345-L17907TB-S-A	tower	1846.0	144.45	146.0	DC	28.59
11270908	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L2001_B-S_+_345-L2003_R-S	tower	1846.0	153.5	154.78	DC	23.42
7078669	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	123.64	124.11	DC	14.73
11783686	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	COMED_P4_023-65-BT2-3__	breaker	1409.0	119.01	119.53	DC	16.27
11783687	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	COMED_P4_112-65-BT4-5__	breaker	1409.0	119.0	119.53	DC	16.27
11783688	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	COMED_P4_112-65-BT3-4__	breaker	1409.0	119.0	119.53	DC	16.27
11783689	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	COMED_P4_023-65-BT4-5__	breaker	1409.0	119.0	119.53	DC	16.27

25 Potential Congestion due to Local Energy Deliverability

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed

with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Note: Only the most severely overloaded conditions are listed below. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission Interconnection Request, a subsequent analysis will be performed which shall study all overload conditions associated with the overloaded element(s) identified.

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1543192	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P1-2_#695A	operation	1409.0	112.62	112.87	DC	16.27
2229731	255104	17GREEN_ACRE	NIPS	270771	GREENACRE; T	CE	1	AEP_P1-2_#695A	operation	1091.0	110.88	111.01	DC	17.78
2229627	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	AEP_P1-2_#695A	operation	1091.0	132.71	132.81	DC	18.43
1542679	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	AEP_P1-2_#695A	operation	1409.0	170.21	170.4	DC	32.25
1542684	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	Base Case	operation	1409.0	110.25	110.39	DC	19.64
1543213	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	Base Case	operation	3555.0	105.52	105.6	DC	53.97
14557872	270670	BRAIDWOOD; B	CE	270728	E FRANKFO; B	CE	1	COMED_P1-2_345-L11212_B-S-A	operation	1528.0	98.43	98.9	DC	15.5
2229817	270677	BURNHAM ;OR	CE	255109	17MUNSTER	NIPS	1	AEP_P1-2_#695A	operation	1441.0	100.09	100.27	DC	28.43
2229824	270697	COLLINS ; R	CE	275168	COLLINS ;2M	CE	1	COMED_P1-2_765-L2315__S	operation	1379.0	98.59	99.07	DC	14.28
2229712	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	AEP_P1-2_#695A	operation	1399.0	113.92	114.04	DC	25.07
1542933	270771	GREENACRE; T	CE	243229	05OLIVE	AEP	1	AEP_P1-2_#695A	operation	971.0	124.56	124.71	DC	17.78
2229624	270886	ST JOHN ; T	CE	255104	17GREEN_ACRE	NIPS	1	AEP_P1-2_#695A	operation	1091.0	132.71	132.81	DC	18.43
2229809	270926	WILTON ; B	CE	275232	WILTON ;3M	CE	1	COMED_P1-2_765-L11216__S	operation	1379.0	102.22	102.33	DC	20.8
2229783	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P1-2_765-L11216__S	operation	1379.0	104.82	104.94	DC	21.81
2229582	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	AEP_P1-2_#695A	operation	1399.0	159.12	159.23	DC	24.74
2229583	274750	CRETE EC ;BP	CE	255112	17STJOHN	NIPS	1	Base Case	operation	1091.0	130.32	130.98	DC	15.8
1542839	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	AEP_P1-2_#695A	operation	971.0	137.4	137.61	DC	21.35
2229562	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P1-2_345-L8014__S-B	operation	1528.0	164.04	164.53	DC	16.57
2229567	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	Base Case	operation	1364.0	147.55	148.15	DC	18.04
2229789	934730	AD1-100 TAP	CE	270670	BRAIDWOOD; B	CE	1	COMED_P1-2_345-L11212_B-S-A	operation	1528.0	99.26	99.77	DC	17.06
2229556	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P1-2_345-L8014__S-B	operation	1528.0	171.54	172.03	DC	16.57
2229561	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	Base Case	operation	1364.0	157.45	158.05	DC	18.04
7079615	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P1-2_#695A	operation	1409.0	119.0	119.53	DC	16.27

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
14557769	941550	AE2-152 TAP	CE	272789	WILMINGTO;	CE	1	COMED_P1-2_138-L8607__R-S-A	operation	317.0	47.32	110.38	DC	200.0
14557770	941560	AE2-153 TAP	CE	271295	DAVIS CRK; R	CE	1	COMED_P1-2_138-L8607__R-S-C	operation	317.0	47.32	110.38	DC	200.0

26 Flow Gate Details

The following appendices contain additional information about each flowgate presented in the body of the report. For each appendix, a description of the flowgate and its contingency was included for convenience. However, the intent of the appendix section is to provide more information on which projects/generators have contributions to the flowgate in question. Although this information is not used "as is" for cost allocation purposes, it can be used to gage other generators impact. It should be noted the generator contributions presented in the appendices sections are full contributions, whereas in the body of the report, those contributions take into consideration the commercial probability of each project.

26.1 Index 1

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1542324	243918	05ELDERBRYSS	AEP	938670	AE1-089 TAP	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	122.79	123.03	DC	14.73

Bus #	Bus	MW Impact
247900	05FR-11G E	6.83
247901	05FR-12G E	6.72
247902	05FR-21G E	7.18
247903	05FR-22G E	6.87
247904	05FR-3G E	13.92
247905	05FR-4G E	10.47
247906	05MDL-1G E	15.59
247907	05MDL-2G E	7.73
247912	05MDL-3G E	8.09
247913	05MDL-4G E	7.81
247943	T-127 E	7.81
270859	PWR VTR EC;R	7.08
274722	S-055 E	6.52
274809	UNIV PK N;5U	0.64
274811	UNIV PK N;7U	0.64
274812	UNIV PK N;8U	0.64
274814	UNIV PK N;0U	0.64
274815	UNIV PK N;XU	0.64
274888	PILOT HIL;1E	10.28
275149	KEMPTON ;1E	10.28
290021	O50 E	11.42
290051	GSG-6; E	6.14
290108	LEEDK;1U E	14.18
293061	N-015 E	8.93
293644	O22 E1	5.91
293645	O22 E2	11.47
294392	P-010 E	11.34
295109	WESTBROOK E	3.29
909145	X2-052	28.77
914641	Y2-103	26.09
915011	Y3-013 1	2.17
915021	Y3-013 2	2.17
915031	Y3-013 3	2.17
916221	Z1-073 E	3.17
916502	Z1-106 E1	0.73
916504	Z1-106 E2	0.73
916512	Z1-107 E	1.49
916522	Z1-108 E	1.44
917711	Z2-114 C	0.05
917712	Z2-114 E	0.39
918052	AA1-018 E	9.77

Bus #	Bus	MW Impact
920272	AA2-123 E	1.43
924471	AB2-096	24.78
925302	AB2-191 E	0.81
926311	AC1-109 1	1.1
926321	AC1-109 2	1.1
926331	AC1-110 1	1.09
926341	AC1-110 2	1.09
926351	AC1-111 1	0.44
926361	AC1-111 2	0.44
926371	AC1-111 3	0.44
926381	AC1-111 4	0.44
926391	AC1-111 5	0.44
926401	AC1-111 6	0.44
926431	AC1-114	1.4
927091	AC1-204 1	41.76
927101	AC1-204 2	41.77
927451	AC1-142A 1	2.41
927461	AC1-142A 2	2.41
927511	AC1-113 1	0.7
927521	AC1-113 2	0.7
930042	AB1-006 E	16.99
930391	AB1-080	1.7
930481	AB1-089	38.62
930501	AB1-091 O1	40.0
930741	AB1-122 1O1	41.85
930751	AB1-122 2O1	42.52
932601	AC2-080 C O1	3.72
932602	AC2-080 E O1	24.87
932881	AC2-115 1	1.4
932891	AC2-115 2	1.4
932921	AC2-116	0.49
932931	AC2-117	5.16
933411	AC2-154 C	1.4
933412	AC2-154 E	2.28
933431	AC2-156 C O1	0.55
933432	AC2-156 E O1	0.9
933911	AD1-013 C	1.08
933912	AD1-013 E	1.73
933931	AD1-016 C	0.54
933932	AD1-016 E	0.88
934101	AD1-039 1	4.1
934111	AD1-039 2	4.17
934401	AD1-064 C O1	1.87
934402	AD1-064 E O1	8.77
934431	AD1-067 C	0.08
934432	AD1-067 E	0.32
934701	AD1-098 C O1	4.04
934702	AD1-098 E O1	2.95
934721	AD1-100 C	11.08
934722	AD1-100 E	51.72
934871	AD1-116 C	0.57
934872	AD1-116 E	0.93

Bus #	Bus	MW Impact
934971	AD1-129 C	0.53
934972	AD1-129 E	0.35
935001	AD1-133 C O1	3.55
935002	AD1-133 E O1	2.36
935271	AD1-137 C	5.67
935272	AD1-137 E	37.95
936291	AD2-038 C O1	1.41
936292	AD2-038 E O1	9.4
936371	AD2-047 C O1	1.25
936372	AD2-047 E O1	13.44
936461	AD2-060	1.47
936511	AD2-066 C O1	4.97
936512	AD2-066 E O1	3.32
936781	AD2-101 C	2.47
936782	AD2-101 E	11.55
937001	AD2-134 C	1.61
937002	AD2-134 E	6.63
937031	AD2-137 C O1	1.92
937032	AD2-137 E O1	8.97
937041	AD2-138 C	5.03
937042	AD2-138 E	23.56
937051	AD2-140 C O1	1.91
937052	AD2-140 E O1	8.96
937061	AD2-141 C O1	1.9
937062	AD2-141 E O1	8.97
937071	AD2-142 C O1	3.83
937072	AD2-142 E O1	17.91
937121	AD2-148 C O1	1.92
937122	AD2-148 E O1	8.99
937131	AD2-149 C O1	1.92
937132	AD2-149 E O1	8.99
937141	AD2-150 C O1	1.92
937142	AD2-150 E O1	8.99
937181	AD2-155 C O1	1.92
937182	AD2-155 E O1	8.99
937321	AD2-175 C	8.94
937322	AD2-175 E	5.96
937331	AD2-176 C O1	4.28
937332	AD2-176 E O1	2.85
937401	AD2-194 1	4.49
937411	AD2-194 2	4.49
938012	AE1-002 E O1	3.85
938511	AE1-070 1	5.28
938521	AE1-070 2	4.83
938851	AE1-113 C O1	5.17
938852	AE1-113 E O1	16.24
939321	AE1-163 C O1	3.53
939322	AE1-163 E O1	21.69
939351	AE1-166 C O1	5.84
939352	AE1-166 E O1	5.39
939401	AE1-172 C O1	3.7
939402	AE1-172 E O1	17.32

Bus #	Bus	MW Impact
939641	AE1-194 C	5.59
939642	AE1-194 E	37.41
939651	AE1-195 C	5.59
939652	AE1-195 E	37.41
939691	AE1-199	1.4
939701	AE1-201 C	1.17
939702	AE1-201 E	0.26
939732	AE1-204 E	0.17
939861	AE1-222 1	46.22
939871	AE1-222 2	46.95
939921	AE1-228 C O1	5.9
939922	AE1-228 E O1	3.93
940101	AE1-252 C O1	6.31
940102	AE1-252 E O1	4.2
940262	AE2-008 BAT	34.37
940581	AE2-045 C O2	16.87
940582	AE2-045 E O2	23.16
940621	AE2-049 C O2	5.07
940622	AE2-049 E O2	3.38
940631	AE2-050 C O2	6.94
940632	AE2-050 E O2	4.63
940752	AE2-062 E	0.07
940762	AE2-063 E	0.07
941131	AE2-107 C	4.26
941132	AE2-107 E	2.84
941551	AE2-152 C O2	6.64
941552	AE2-152 E O2	4.43
941561	AE2-153 C O2	2.59
941562	AE2-153 E O2	12.13
941571	AE2-154 C	3.17
941572	AE2-154 E	21.24
942421	AE2-255 C O2	1.79
942422	AE2-255 E O2	5.38
942651	AE2-281 C	0.5
942652	AE2-281 E	3.1
942881	AE2-307 C	12.73
942882	AE2-307 E	4.63
942911	AE2-310 C	4.92
942912	AE2-310 E	1.33
942991	AE2-321 C O2	4.78
942992	AE2-321 E O2	2.35
943121	AE2-341 C	7.34
943122	AE2-341 E	3.61
CARR	CARR	0.6
CATAWBA	CATAWBA	0.06
CBM-S1	CBM-S1	4.51
CBM-W1	CBM-W1	19.7
CBM-W2	CBM-W2	68.08
CIN	CIN	6.99
G-007	G-007	1.67
HAMLET	HAMLET	0.18
IPL	IPL	3.24

Bus #	Bus	MW Impact
LGEE	LGEE	0.71
MEC	MEC	25.2
O-066	O-066	10.75
RENSSELAER	RENSSELAER	0.48
WEC	WEC	4.68
Z1-043	Z1-043	17.58

26.2 Index 2

ID	FROM BUS#	FROM BUS	FRO M BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Ratin g MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC D C	MW IMPAC T
222937 1	25510 4	17GREEN_ACR E	NIPS	27077 1	GREENACR E; T	CE	1	AEP_P4_#2978_05DUMO NT 765_B	break er	1091. 0	111.92	112.05	DC	17.54

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	8.05
274722	S-055 E	7.51
274751	CRETE EC ;1U	1.53
274752	CRETE EC ;2U	1.53
274753	CRETE EC ;3U	1.53
274754	CRETE EC ;4U	1.53
274788	SE CHICAG;5U	3.6
274789	SE CHICAG;6U	3.6
274790	SE CHICAG;7U	3.6
274791	SE CHICAG;8U	3.6
274792	SE CHICAG;9U	3.65
274793	SE CHICAG;0U	3.65
274794	SE CHICAG;1U	3.65
274795	SE CHICAG;2U	3.65
274859	EASYR;U1 E	7.29
274860	EASYR;U2 E	7.29
274888	PILOT HIL;1E	12.38
274890	CAYUG;1U E	8.91
274891	CAYUG;2U E	8.91
275149	KEMPTON ;1E	12.38
290021	O50 E	12.96
290051	GSG-6; E	6.93
290108	LEEDK;1U E	16.12
293061	N-015 E	10.22
293516	O-009 E1	2.6
293517	O-009 E2	1.32
293518	O-009 E3	1.45
293644	O22 E1	7.23
293645	O22 E2	14.04
293715	O-029 E	6.46
293716	O-029 E	3.54
293717	O-029 E	3.26
294392	P-010 E	12.98
294763	P-046 E	6.22
295109	WESTBROOK E	3.71
295111	SUBLETTE E	1.72
910542	X3-005 E	0.52
914641	Y2-103	30.04
915011	Y3-013 1	2.5
915021	Y3-013 2	2.5
915031	Y3-013 3	2.5
916221	Z1-073 E	3.58

Bus #	Bus	MW Impact
916502	Z1-106 E1	0.84
916504	Z1-106 E2	0.84
916512	Z1-107 E	1.71
916522	Z1-108 E	1.66
918052	AA1-018 E	10.6
919221	AA1-146	11.65
919581	AA2-030	11.65
920272	AA2-123 E	1.63
924471	AB2-096	28.16
925161	AB2-173	2.08
925302	AB2-191 E	0.92
926311	AC1-109 1	1.27
926321	AC1-109 2	1.27
926331	AC1-110 1	1.26
926341	AC1-110 2	1.26
926351	AC1-111 1	0.51
926361	AC1-111 2	0.51
926371	AC1-111 3	0.51
926381	AC1-111 4	0.51
926391	AC1-111 5	0.51
926401	AC1-111 6	0.51
926431	AC1-114	1.58
926821	AC1-168 C O1	0.76
926822	AC1-168 E O1	5.07
927091	AC1-204 1	48.7
927101	AC1-204 2	48.66
927451	AC1-142A 1	2.83
927461	AC1-142A 2	2.83
927511	AC1-113 1	0.79
927521	AC1-113 2	0.79
927531	AC1-185 1	0.46
927541	AC1-185 2	0.46
927551	AC1-185 3	0.46
927561	AC1-185 4	0.46
927571	AC1-185 5	0.46
927581	AC1-185 6	0.46
927591	AC1-185 7	0.46
927601	AC1-185 8	0.46
930481	AB1-089	43.69
930501	AB1-091 O1	49.08
930741	AB1-122 1O1	47.51
930751	AB1-122 2O1	49.69
932881	AC2-115 1	1.58
932891	AC2-115 2	1.58
932921	AC2-116	0.55
933341	AC2-147 C	0.58
933342	AC2-147 E	0.94
933411	AC2-154 C	1.68
933412	AC2-154 E	2.74
933431	AC2-156 C O1	0.63
933432	AC2-156 E O1	1.04
933911	AD1-013 C	1.22

Bus #	Bus	MW Impact
933912	AD1-013 E	1.95
933931	AD1-016 C	0.62
933932	AD1-016 E	1.01
934101	AD1-039 1	4.66
934111	AD1-039 2	4.87
934401	AD1-064 C O1	2.13
934402	AD1-064 E O1	9.97
934431	AD1-067 C	0.09
934432	AD1-067 E	0.37
934651	AD1-096 C	0.59
934652	AD1-096 E	0.97
934701	AD1-098 C O1	4.56
934702	AD1-098 E O1	3.33
934721	AD1-100 C	12.92
934722	AD1-100 E	60.3
934871	AD1-116 C	0.62
934872	AD1-116 E	1.01
934971	AD1-129 C	0.6
934972	AD1-129 E	0.4
935001	AD1-133 C O1	13.71
935002	AD1-133 E O1	9.14
936291	AD2-038 C O1	1.54
936292	AD2-038 E O1	10.3
936371	AD2-047 C O1	1.5
936372	AD2-047 E O1	16.18
936461	AD2-060	1.77
936511	AD2-066 C O1	5.55
936512	AD2-066 E O1	3.7
936781	AD2-101 C	3.17
936782	AD2-101 E	14.82
936791	AD2-102 C	7.99
936792	AD2-102 E	7.67
937001	AD2-134 C	1.81
937002	AD2-134 E	7.49
937031	AD2-137 C O1	2.3
937032	AD2-137 E O1	10.79
937051	AD2-140 C O1	2.32
937052	AD2-140 E O1	10.85
937061	AD2-141 C O1	2.3
937062	AD2-141 E O1	10.86
937071	AD2-142 C O1	4.64
937072	AD2-142 E O1	21.7
937121	AD2-148 C O1	2.36
937122	AD2-148 E O1	11.03
937131	AD2-149 C O1	2.36
937132	AD2-149 E O1	11.03
937141	AD2-150 C O1	2.36
937142	AD2-150 E O1	11.03
937181	AD2-155 C O1	2.36
937182	AD2-155 E O1	11.03
937311	AD2-172 C	1.63
937312	AD2-172 E	2.26

Bus #	Bus	MW Impact
937321	AD2-175 C	10.97
937322	AD2-175 E	7.32
937331	AD2-176 C O1	4.88
937332	AD2-176 E O1	3.25
937401	AD2-194 1	5.24
937411	AD2-194 2	5.23
938012	AE1-002 E O1	4.63
938511	AE1-070 1	6.15
938521	AE1-070 2	5.63
938851	AE1-113 C O1	5.87
938852	AE1-113 E O1	18.44
938861	AE1-114 C O1	2.38
938862	AE1-114 E O1	9.12
939051	AE1-134 1	0.9
939061	AE1-134 2	0.9
939321	AE1-163 C O1	3.87
939322	AE1-163 E O1	23.76
939351	AE1-166 C O1	6.83
939352	AE1-166 E O1	6.3
939401	AE1-172 C O1	4.09
939402	AE1-172 E O1	19.14
939641	AE1-194 C	10.88
939642	AE1-194 E	72.79
939651	AE1-195 C	10.88
939652	AE1-195 E	72.79
939691	AE1-199	1.59
939701	AE1-201 C	1.33
939702	AE1-201 E	0.29
939732	AE1-204 E	0.2
939861	AE1-222 1	52.47
939871	AE1-222 2	54.87
939921	AE1-228 C O1	6.67
939922	AE1-228 E O1	4.44
940101	AE1-252 C O1	6.97
940102	AE1-252 E O1	4.65
940501	AE2-035 C	1.63
940502	AE2-035 E	2.26
940621	AE2-049 C O2	6.1
940622	AE2-049 E O2	4.07
940631	AE2-050 C O2	8.04
940632	AE2-050 E O2	5.36
940752	AE2-062 E	0.09
940762	AE2-063 E	0.09
940881	AE2-077 C	2.09
940882	AE2-077 E	3.42
941131	AE2-107 C	4.85
941132	AE2-107 E	3.23
941551	AE2-152 C O2	7.84
941552	AE2-152 E O2	5.23
941561	AE2-153 C O2	3.09
941562	AE2-153 E O2	14.45
942421	AE2-255 C O2	1.97

Bus #	Bus	MW Impact
942422	AE2-255 E O2	5.9
942651	AE2-281 C	0.55
942652	AE2-281 E	3.39
942881	AE2-307 C	14.74
942882	AE2-307 E	5.36
942911	AE2-310 C	5.93
942912	AE2-310 E	1.6
942991	AE2-321 C O2	5.45
942992	AE2-321 E O2	2.68
943121	AE2-341 C	8.47
943122	AE2-341 E	4.16
951721	J643	15.48
952581	J740 C	3.4
952582	J740 E	18.4
953871	J847	8.37
BLUEG	BLUEG	2.92
CANNELTON	CANNELTON	0.01
CARR	CARR	0.5
CATAWBA	CATAWBA	0.17
CBM-S1	CBM-S1	1.31
CBM-W1	CBM-W1	20.03
CBM-W2	CBM-W2	38.34
CHEOAH	CHEOAH	0.0
CIN	CIN	0.09
G-007	G-007	1.39
HAMLET	HAMLET	0.33
MEC	MEC	24.99
O-066	O-066	8.94
RENSSELAER	RENSSELAER	0.4
SANTEETLA	SANTEETLA	0.0
TRIMBLE	TRIMBLE	0.35
WEC	WEC	5.32
Z1-043	Z1-043	18.79

26.3 Index 3

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229240	255112	17STJOHN	NIPS	270886	ST JOHN ; T	CE	1	COMED_P4_023-65-BT2-3__	breaker	1091.0	133.07	133.17	DC	18.43

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.02
274654	BRAIDWOOD;1U	15.11
274655	BRAIDWOOD;2U	14.47
274661	LASCO STA;2U	13.96
274687	WILL CNTY;4U	6.37
274704	KENDALL ;1C	2.23
274705	KENDALL ;1S	1.49
274706	KENDALL ;2C	2.23
274707	KENDALL ;2S	1.49
274722	S-055 E	8.43
274751	CRETE EC ;1U	2.67
274752	CRETE EC ;2U	2.67
274753	CRETE EC ;3U	2.67
274754	CRETE EC ;4U	2.67
274859	EASYR;U1 E	8.15
274860	EASYR;U2 E	8.15
274861	TOP CROP ;1U	0.26
274862	TOP CROP ;2U	0.5
274888	PILOT HIL;1E	12.78
275149	KEMPTON ;1E	12.78
290021	O50 E	14.62
290051	GSG-6; E	7.76
290108	LEEDK;1U E	18.05
293061	N-015 E	11.59
293644	O22 E1	8.49
293645	O22 E2	16.47
294392	P-010 E	14.72
294763	P-046 E	6.96
295109	WESTBROOK E	4.15
295111	SUBLETTE E	1.92
914641	Y2-103	33.72
915011	Y3-013 1	2.81
915021	Y3-013 2	2.81
915031	Y3-013 3	2.81
916221	Z1-073 E	4.0
916502	Z1-106 E1	0.94
916504	Z1-106 E2	0.94
916512	Z1-107 E	1.85
916522	Z1-108 E	1.86
918052	AA1-018 E	11.61
920272	AA2-123 E	1.82

Bus #	Bus	MW Impact
924471	AB2-096	31.56
925302	AB2-191 E	1.03
926311	AC1-109 1	1.42
926321	AC1-109 2	1.42
926331	AC1-110 1	1.42
926341	AC1-110 2	1.42
926351	AC1-111 1	0.57
926361	AC1-111 2	0.57
926371	AC1-111 3	0.57
926381	AC1-111 4	0.57
926391	AC1-111 5	0.57
926401	AC1-111 6	0.57
926431	AC1-114	1.77
927091	AC1-204 1	55.08
927101	AC1-204 2	55.0
927451	AC1-142A 1	3.19
927461	AC1-142A 2	3.2
927511	AC1-113 1	0.89
927521	AC1-113 2	0.89
927531	AC1-185 1	0.51
927541	AC1-185 2	0.51
927551	AC1-185 3	0.51
927561	AC1-185 4	0.51
927571	AC1-185 5	0.51
927581	AC1-185 6	0.51
927591	AC1-185 7	0.51
927601	AC1-185 8	0.51
930481	AB1-089	48.93
930501	AB1-091 O1	50.49
930741	AB1-122 1O1	52.86
930751	AB1-122 2O1	56.21
932881	AC2-115 1	1.77
932891	AC2-115 2	1.77
932921	AC2-116	0.62
933341	AC2-147 C	0.65
933342	AC2-147 E	1.05
933411	AC2-154 C	1.73
933412	AC2-154 E	2.83
933431	AC2-156 C O1	0.71
933432	AC2-156 E O1	1.16
933911	AD1-013 C	1.37
933912	AD1-013 E	2.18
933931	AD1-016 C	0.69
933932	AD1-016 E	1.13
934101	AD1-039 1	5.18
934111	AD1-039 2	5.51
934401	AD1-064 C O1	2.39
934402	AD1-064 E O1	11.18
934431	AD1-067 C	0.1
934432	AD1-067 E	0.41
934651	AD1-096 C	0.66
934652	AD1-096 E	1.08

Bus #	Bus	MW Impact
934701	AD1-098 C O1	5.1
934702	AD1-098 E O1	3.73
934721	AD1-100 C	14.24
934722	AD1-100 E	66.45
934871	AD1-116 C	0.68
934872	AD1-116 E	1.1
934971	AD1-129 C	0.67
934972	AD1-129 E	0.45
935001	AD1-133 C O1	10.36
935002	AD1-133 E O1	6.91
936291	AD2-038 C O1	1.71
936292	AD2-038 E O1	11.42
936371	AD2-047 C O1	1.55
936372	AD2-047 E O1	16.71
936461	AD2-060	1.83
936511	AD2-066 C O1	6.18
936512	AD2-066 E O1	4.12
936781	AD2-101 C	3.08
936782	AD2-101 E	14.43
936791	AD2-102 C	8.94
936792	AD2-102 E	8.59
937001	AD2-134 C	2.03
937002	AD2-134 E	8.38
937031	AD2-137 C O1	2.44
937032	AD2-137 E O1	11.4
937051	AD2-140 C O1	2.43
937052	AD2-140 E O1	11.4
937061	AD2-141 C O1	2.42
937062	AD2-141 E O1	11.41
937071	AD2-142 C O1	4.87
937072	AD2-142 E O1	22.79
937121	AD2-148 C O1	2.42
937122	AD2-148 E O1	11.35
937131	AD2-149 C O1	2.42
937132	AD2-149 E O1	11.35
937141	AD2-150 C O1	2.42
937142	AD2-150 E O1	11.35
937181	AD2-155 C O1	2.42
937182	AD2-155 E O1	11.35
937311	AD2-172 C	1.83
937312	AD2-172 E	2.52
937321	AD2-175 C	11.29
937322	AD2-175 E	7.53
937331	AD2-176 C O1	5.47
937332	AD2-176 E O1	3.65
937401	AD2-194 1	5.92
937411	AD2-194 2	5.91
938012	AE1-002 E O1	4.89
938511	AE1-070 1	6.96
938521	AE1-070 2	6.36
938851	AE1-113 C O1	6.61
938852	AE1-113 E O1	20.79

Bus #	Bus	MW Impact
938861	AE1-114 C O1	2.67
938862	AE1-114 E O1	10.19
939321	AE1-163 C O1	4.29
939322	AE1-163 E O1	26.35
939351	AE1-166 C O1	7.59
939352	AE1-166 E O1	7.0
939401	AE1-172 C O1	4.46
939402	AE1-172 E O1	20.9
939641	AE1-194 C	18.94
939642	AE1-194 E	126.77
939651	AE1-195 C	18.94
939652	AE1-195 E	126.77
939691	AE1-199	1.77
939701	AE1-201 C	1.49
939702	AE1-201 E	0.33
939732	AE1-204 E	0.22
939861	AE1-222 1	58.38
939871	AE1-222 2	62.07
939921	AE1-228 C O1	7.46
939922	AE1-228 E O1	4.97
940101	AE1-252 C O1	7.61
940102	AE1-252 E O1	5.07
940501	AE2-035 C	1.83
940502	AE2-035 E	2.52
940621	AE2-049 C O2	6.3
940622	AE2-049 E O2	4.2
940631	AE2-050 C O2	9.26
940632	AE2-050 E O2	6.17
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.34
940882	AE2-077 E	3.82
941131	AE2-107 C	5.42
941132	AE2-107 E	3.62
941551	AE2-152 C O2	8.35
941552	AE2-152 E O2	5.57
941561	AE2-153 C O2	3.24
941562	AE2-153 E O2	15.19
942421	AE2-255 C O2	2.18
942422	AE2-255 E O2	6.55
942651	AE2-281 C	0.61
942652	AE2-281 E	3.76
942881	AE2-307 C	16.97
942882	AE2-307 E	6.17
942911	AE2-310 C	6.12
942912	AE2-310 E	1.65
942991	AE2-321 C O2	6.11
942992	AE2-321 E O2	3.01
943121	AE2-341 C	9.48
943122	AE2-341 E	4.66
BLUEG	BLUEG	5.15
CALDERWOOD	CALDERWOOD	0.1

Bus #	Bus	MW Impact
CANNELTON	CANNELTON	0.11
CARR	CARR	0.57
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	0.69
CBM-W1	CBM-W1	20.05
CBM-W2	CBM-W2	36.81
CHEOAH	CHEOAH	0.1
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.15
G-007	G-007	1.6
GIBSON	GIBSON	0.07
HAMLET	HAMLET	0.45
MEC	MEC	27.48
O-066	O-066	10.25
RENSSELAER	RENSSELAER	0.45
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.6
WEC	WEC	5.96
Z1-043	Z1-043	20.93

26.4 Index 4

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1541920	255113	17STILLWELL	NIPS	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	173.14	173.32	DC	31.28

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	13.9
274722	S-055 E	12.93
274724	RIVER EC ;11	3.77
274788	SE CHICAG;5U	7.41
274789	SE CHICAG;6U	7.41
274790	SE CHICAG;7U	7.41
274791	SE CHICAG;8U	7.41
274792	SE CHICAG;9U	7.31
274793	SE CHICAG;0U	7.31
274794	SE CHICAG;1U	7.31
274795	SE CHICAG;2U	7.31
274832	U4-027	12.43
274859	EASYR;U1 E	12.65
274860	EASYR;U2 E	12.65
274888	PILOT HIL;1E	22.27
274890	CAYUG;1U E	15.74
274891	CAYUG;2U E	15.74
275149	KEMPTON ;1E	22.27
290021	O50 E	22.28
290051	GSG-6; E	12.01
290108	LEEDK;1U E	27.88
293061	N-015 E	17.51
293516	O-009 E1	10.43
293517	O-009 E2	5.3
293518	O-009 E3	5.84
293644	O22 E1	11.94
293645	O22 E2	23.17
293715	O-029 E	11.25
293716	O-029 E	6.17
293717	O-029 E	5.67
293771	O-035 E	7.35
294392	P-010 E	22.24
294763	P-046 E	10.78
295109	WESTBROOK E	6.43
295111	SUBLETTE E	2.98
910542	X3-005 E	1.0
914641	Y2-103	51.72
915011	Y3-013 1	4.31
915021	Y3-013 2	4.31
915031	Y3-013 3	4.31
916211	Z1-072 E	5.56
916221	Z1-073 E	6.2

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.45
916504	Z1-106 E2	1.45
916512	Z1-107 E	3.03
916522	Z1-108 E	2.86
918052	AA1-018 E	18.71
919221	AA1-146	20.25
919581	AA2-030	20.25
920272	AA2-123 E	2.81
924471	AB2-096	48.66
925161	AB2-173	3.61
925302	AB2-191 E	1.59
925581	AC1-033 C	1.61
925582	AC1-033 E	10.79
926311	AC1-109 1	2.19
926321	AC1-109 2	2.19
926331	AC1-110 1	2.18
926341	AC1-110 2	2.18
926351	AC1-111 1	0.87
926361	AC1-111 2	0.87
926371	AC1-111 3	0.87
926381	AC1-111 4	0.87
926391	AC1-111 5	0.87
926401	AC1-111 6	0.87
926431	AC1-114	2.74
926821	AC1-168 C O1	1.32
926822	AC1-168 E O1	8.84
927091	AC1-204 1	83.15
927101	AC1-204 2	83.12
927201	AC1-214 C O1	2.36
927202	AC1-214 E O1	7.5
927451	AC1-142A 1	4.83
927461	AC1-142A 2	4.83
927511	AC1-113 1	1.37
927521	AC1-113 2	1.37
927531	AC1-185 1	0.79
927541	AC1-185 2	0.79
927551	AC1-185 3	0.79
927561	AC1-185 4	0.79
927571	AC1-185 5	0.79
927581	AC1-185 6	0.79
927591	AC1-185 7	0.79
927601	AC1-185 8	0.79
930481	AB1-089	75.56
930501	AB1-091 O1	88.12
930741	AB1-122 1O1	82.31
930751	AB1-122 2O1	84.84
932881	AC2-115 1	2.74
932891	AC2-115 2	2.74
932921	AC2-116	0.96
932931	AC2-117	5.8
933341	AC2-147 C	1.0
933342	AC2-147 E	1.64

Bus #	Bus	MW Impact
933411	AC2-154 C	3.02
933412	AC2-154 E	4.93
933431	AC2-156 C O1	1.1
933432	AC2-156 E O1	1.79
933911	AD1-013 C	2.11
933912	AD1-013 E	3.38
933931	AD1-016 C	1.07
933932	AD1-016 E	1.74
934101	AD1-039 1	8.07
934111	AD1-039 2	8.31
934401	AD1-064 C O1	3.68
934402	AD1-064 E O1	17.23
934431	AD1-067 C	0.15
934432	AD1-067 E	0.63
934651	AD1-096 C	1.03
934652	AD1-096 E	1.67
934701	AD1-098 C O1	7.9
934702	AD1-098 E O1	5.77
934721	AD1-100 C	22.42
934722	AD1-100 E	104.63
934871	AD1-116 C	1.09
934872	AD1-116 E	1.78
934971	AD1-129 C	1.04
934972	AD1-129 E	0.69
935001	AD1-133 C O1	24.03
935002	AD1-133 E O1	16.02
936291	AD2-038 C O1	2.69
936292	AD2-038 E O1	18.0
936371	AD2-047 C O1	2.7
936372	AD2-047 E O1	29.11
936461	AD2-060	3.18
936511	AD2-066 C O1	9.66
936512	AD2-066 E O1	6.44
936781	AD2-101 C	5.89
936782	AD2-101 E	27.59
936791	AD2-102 C	13.83
936792	AD2-102 E	13.28
937001	AD2-134 C	3.14
937002	AD2-134 E	12.97
937031	AD2-137 C O1	4.07
937032	AD2-137 E O1	19.06
937051	AD2-140 C O1	4.11
937052	AD2-140 E O1	19.23
937061	AD2-141 C O1	4.08
937062	AD2-141 E O1	19.25
937071	AD2-142 C O1	8.21
937072	AD2-142 E O1	38.45
937121	AD2-148 C O1	4.23
937122	AD2-148 E O1	19.8
937131	AD2-149 C O1	4.23
937132	AD2-149 E O1	19.8
937141	AD2-150 C O1	4.23

Bus #	Bus	MW Impact
937142	AD2-150 E O1	19.8
937181	AD2-155 C O1	4.23
937182	AD2-155 E O1	19.8
937311	AD2-172 C	2.83
937312	AD2-172 E	3.91
937321	AD2-175 C	19.7
937322	AD2-175 E	13.14
937331	AD2-176 C O1	8.42
937332	AD2-176 E O1	5.62
937401	AD2-194 1	8.94
937411	AD2-194 2	8.94
937531	AD2-214 C	5.09
937532	AD2-214 E	2.39
938012	AE1-002 E O1	8.17
938511	AE1-070 1	10.51
938521	AE1-070 2	9.61
938851	AE1-113 C O1	10.08
938852	AE1-113 E O1	31.69
938861	AE1-114 C O1	4.14
938862	AE1-114 E O1	15.81
939051	AE1-134 1	1.57
939061	AE1-134 2	1.57
939321	AE1-163 C O1	6.76
939322	AE1-163 E O1	41.51
939351	AE1-166 C O1	11.78
939352	AE1-166 E O1	10.87
939401	AE1-172 C O1	7.2
939402	AE1-172 E O1	33.69
939641	AE1-194 C	10.23
939642	AE1-194 E	68.46
939651	AE1-195 C	10.23
939652	AE1-195 E	68.46
939681	AE1-198 C O1	10.75
939682	AE1-198 E O1	9.13
939691	AE1-199	2.74
939701	AE1-201 C	2.3
939702	AE1-201 E	0.51
939732	AE1-204 E	0.34
939861	AE1-222 1	90.89
939871	AE1-222 2	93.69
939921	AE1-228 C O1	11.54
939922	AE1-228 E O1	7.7
940101	AE1-252 C O1	12.26
940102	AE1-252 E O1	8.18
940501	AE2-035 C	2.83
940502	AE2-035 E	3.91
940621	AE2-049 C O2	10.98
940622	AE2-049 E O2	7.32
940631	AE2-050 C O2	13.58
940632	AE2-050 E O2	9.05
940752	AE2-062 E	0.15
940762	AE2-063 E	0.15

Bus #	Bus	MW Impact
940881	AE2-077 C	3.62
940882	AE2-077 E	5.91
941131	AE2-107 C	8.38
941132	AE2-107 E	5.59
941551	AE2-152 C O2	13.89
941552	AE2-152 E O2	9.26
941561	AE2-153 C O2	5.5
941562	AE2-153 E O2	25.77
942421	AE2-255 C O2	3.44
942422	AE2-255 E O2	10.3
942651	AE2-281 C	0.97
942652	AE2-281 E	5.93
942881	AE2-307 C	24.9
942882	AE2-307 E	9.05
942911	AE2-310 C	10.66
942912	AE2-310 E	2.88
942991	AE2-321 C O2	9.41
942992	AE2-321 E O2	4.63
943121	AE2-341 C	14.63
943122	AE2-341 E	7.18
951721	J643	25.68
952581	J740 C	4.29
952582	J740 E	23.24
953871	J847	13.08
954751	J351	434.36
BLUEG	BLUEG	1.16
CARR	CARR	0.91
CATAWBA	CATAWBA	0.23
CBM-S1	CBM-S1	3.87
CBM-W1	CBM-W1	35.94
CBM-W2	CBM-W2	81.94
CIN	CIN	3.25
G-007	G-007	2.53
HAMLET	HAMLET	0.49
IPL	IPL	1.09
MEC	MEC	44.6
O-066	O-066	16.25
RENSSELAER	RENSSELAER	0.72
TRIMBLE	TRIMBLE	0.17
WEC	WEC	9.18
Z1-043	Z1-043	32.88

26.5 Index 5

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1543537	270644	WILTON ;	CE	243206	05DUMONT	AEP	1	COMED_P7_345-L94507_B-S+_345-L97008_R-S	tower	4105.0	107.04	107.14	DC	63.56

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	32.1
274722	S-055 E	29.48
274772	LINCOLN ;3U	3.73
274773	LINCOLN ;4U	3.73
274774	LINCOLN ;5U	3.73
274775	LINCOLN ;6U	3.73
274776	LINCOLN ;7U	3.73
274777	LINCOLN ;8U	3.73
274832	U4-027	27.98
274859	EASYR;U1 E	29.06
274860	EASYR;U2 E	29.06
274888	PILOT HIL;1E	44.2
274890	CAYUG;1U E	35.98
274891	CAYUG;2U E	35.98
275149	KEMPTON ;1E	44.2
290021	O50 E	49.13
290051	GSG-6; E	28.02
290108	LEEDK;1U E	65.42
293061	N-015 E	41.13
293516	O-009 E1	23.73
293517	O-009 E2	12.06
293518	O-009 E3	13.28
293644	O22 E1	25.25
293645	O22 E2	49.01
293715	O-029 E	25.72
293716	O-029 E	14.1
293717	O-029 E	12.96
293771	O-035 E	16.45
294392	P-010 E	52.23
294763	P-046 E	24.82
295109	WESTBROOK E	15.0
295111	SUBLETTE E	6.85
296125	R-030 C3	6.1
296128	R-030 E3	24.42
296271	R-030 C2	6.03
296272	R-030 E2	24.12
296308	R-030 C1	6.03
296309	R-030 E1	24.12
910542	X3-005 E	1.57
914641	Y2-103	117.93

Bus #	Bus	MW Impact
915011	Y3-013 1	9.83
915021	Y3-013 2	9.83
915031	Y3-013 3	9.83
916211	Z1-072 E	12.45
916221	Z1-073 E	14.46
916502	Z1-106 E1	3.4
916504	Z1-106 E2	3.4
916512	Z1-107 E	6.51
916522	Z1-108 E	6.61
918052	AA1-018 E	40.31
919221	AA1-146	46.38
919581	AA2-030	46.38
920272	AA2-123 E	6.49
924471	AB2-096	112.35
925161	AB2-173	8.27
925302	AB2-191 E	3.71
926311	AC1-109 1	5.2
926321	AC1-109 2	5.2
926331	AC1-110 1	5.11
926341	AC1-110 2	5.11
926351	AC1-111 1	2.06
926361	AC1-111 2	2.06
926371	AC1-111 3	2.06
926381	AC1-111 4	2.06
926391	AC1-111 5	2.06
926401	AC1-111 6	2.06
926431	AC1-114	6.31
926821	AC1-168 C O1	2.97
926822	AC1-168 E O1	19.96
927091	AC1-204 1	183.87
927101	AC1-204 2	183.91
927201	AC1-214 C O1	5.28
927202	AC1-214 E O1	16.78
927451	AC1-142A 1	10.58
927461	AC1-142A 2	10.58
927511	AC1-113 1	3.15
927521	AC1-113 2	3.15
927531	AC1-185 1	1.82
927541	AC1-185 2	1.82
927551	AC1-185 3	1.82
927561	AC1-185 4	1.82
927571	AC1-185 5	1.82
927581	AC1-185 6	1.82
927591	AC1-185 7	1.82
927601	AC1-185 8	1.82
930481	AB1-089	174.75
930501	AB1-091 O1	173.57
930741	AB1-122 1O1	194.53
930751	AB1-122 2O1	188.25
932881	AC2-115 1	6.31
932891	AC2-115 2	6.31
932921	AC2-116	2.21

Bus #	Bus	MW Impact
932931	AC2-117	14.91
933341	AC2-147 C	2.31
933342	AC2-147 E	3.76
933411	AC2-154 C	6.0
933412	AC2-154 E	9.79
933431	AC2-156 C O1	2.63
933432	AC2-156 E O1	4.29
933911	AD1-013 C	4.93
933912	AD1-013 E	7.88
933931	AD1-016 C	2.47
933932	AD1-016 E	4.02
934101	AD1-039 1	19.06
934111	AD1-039 2	18.45
934401	AD1-064 C O1	8.54
934402	AD1-064 E O1	39.99
934431	AD1-067 C	0.35
934432	AD1-067 E	1.48
934651	AD1-096 C	2.36
934652	AD1-096 E	3.85
934701	AD1-098 C O1	18.43
934702	AD1-098 E O1	13.45
934721	AD1-100 C	50.93
934722	AD1-100 E	237.66
934871	AD1-116 C	2.35
934872	AD1-116 E	3.83
934971	AD1-129 C	2.4
934972	AD1-129 E	1.6
935001	AD1-133 C O1	55.82
935002	AD1-133 E O1	37.22
936291	AD2-038 C O1	5.84
936292	AD2-038 E O1	39.11
936371	AD2-047 C O1	5.37
936372	AD2-047 E O1	57.77
936461	AD2-060	6.31
936511	AD2-066 C O1	21.42
936512	AD2-066 E O1	14.28
936781	AD2-101 C	10.65
936782	AD2-101 E	49.86
936791	AD2-102 C	31.81
936792	AD2-102 E	30.57
937001	AD2-134 C	7.32
937002	AD2-134 E	30.26
937031	AD2-137 C O1	10.24
937032	AD2-137 E O1	47.92
937051	AD2-140 C O1	10.48
937052	AD2-140 E O1	49.08
937061	AD2-141 C O1	10.42
937062	AD2-141 E O1	49.14
937071	AD2-142 C O1	20.97
937072	AD2-142 E O1	98.16
937121	AD2-148 C O1	8.33
937122	AD2-148 E O1	39.01

Bus #	Bus	MW Impact
937131	AD2-149 C O1	8.33
937132	AD2-149 E O1	39.01
937141	AD2-150 C O1	8.33
937142	AD2-150 E O1	39.01
937181	AD2-155 C O1	8.33
937182	AD2-155 E O1	39.01
937311	AD2-172 C	6.51
937312	AD2-172 E	9.0
937321	AD2-175 C	38.82
937322	AD2-175 E	25.88
937331	AD2-176 C O1	19.48
937332	AD2-176 E O1	12.98
937401	AD2-194 1	19.77
937411	AD2-194 2	19.78
937531	AD2-214 C	11.57
937532	AD2-214 E	5.45
938012	AE1-002 E O1	20.55
938511	AE1-070 1	23.23
938521	AE1-070 2	21.26
938851	AE1-113 C O1	22.23
938852	AE1-113 E O1	69.88
938861	AE1-114 C O1	9.51
938862	AE1-114 E O1	36.36
939051	AE1-134 1	3.6
939061	AE1-134 2	3.6
939321	AE1-163 C O1	14.68
939322	AE1-163 E O1	90.2
939351	AE1-166 C O1	26.21
939352	AE1-166 E O1	24.2
939401	AE1-172 C O1	16.53
939402	AE1-172 E O1	77.39
939641	AE1-194 C	21.06
939642	AE1-194 E	140.92
939651	AE1-195 C	21.06
939652	AE1-195 E	140.92
939691	AE1-199	6.41
939701	AE1-201 C	5.32
939702	AE1-201 E	1.17
939732	AE1-204 E	0.77
939741	AE1-205 C O1	23.23
939742	AE1-205 E O1	32.08
939861	AE1-222 1	214.83
939871	AE1-222 2	207.89
939921	AE1-228 C O1	26.96
939922	AE1-228 E O1	17.97
940101	AE1-252 C O1	28.18
940102	AE1-252 E O1	18.78
940501	AE2-035 C	6.51
940502	AE2-035 E	9.0
940621	AE2-049 C O2	21.78
940622	AE2-049 E O2	14.52
940631	AE2-050 C O2	30.27

Bus #	Bus	MW Impact
940632	AE2-050 E O2	20.18
940752	AE2-062 E	0.33
940762	AE2-063 E	0.33
940881	AE2-077 C	8.36
940882	AE2-077 E	13.63
941131	AE2-107 C	19.67
941132	AE2-107 E	13.12
941551	AE2-152 C O2	28.74
941552	AE2-152 E O2	19.16
941561	AE2-153 C O2	11.19
941562	AE2-153 E O2	52.37
941731	AE2-173	13.85
942421	AE2-255 C O2	7.47
942422	AE2-255 E O2	22.41
942651	AE2-281 C	2.1
942652	AE2-281 E	12.89
942881	AE2-307 C	55.5
942882	AE2-307 E	20.18
942911	AE2-310 C	21.15
942912	AE2-310 E	5.71
942991	AE2-321 C O2	21.75
942992	AE2-321 E O2	10.71
943121	AE2-341 C	35.31
943122	AE2-341 E	17.34
BLUEG	BLUEG	17.17
CALDERWOOD	CALDERWOOD	0.27
CANNELTON	CANNELTON	0.28
CARR	CARR	2.0
CATAWBA	CATAWBA	0.82
CBM-S1	CBM-S1	3.15
CBM-W1	CBM-W1	76.97
CBM-W2	CBM-W2	139.76
CHEOAH	CHEOAH	0.28
CHILHOWEE	CHILHOWEE	0.08
ELMERSMITH	ELMERSMITH	0.31
G-007	G-007	5.61
GIBSON	GIBSON	0.1
HAMLET	HAMLET	1.54
MEC	MEC	97.87
O-066	O-066	35.97
RENSSELAER	RENSSELAER	1.58
SANTEETLA	SANTEETLA	0.09
TRIMBLE	TRIMBLE	2.03
WEC	WEC	20.89
Z1-043	Z1-043	73.68

26.6 Index 6

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
222944 4	27067 7	BURNHAM ;OR	CE	25510 9	17MUNSTER	NIPS	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1441.0	100.82	100.99	DC	28.23

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	11.72
274722	S-055 E	10.94
274723	RIVER EC ;12	3.43
274792	SE CHICAG;9U	6.24
274793	SE CHICAG;0U	6.24
274794	SE CHICAG;1U	6.24
274795	SE CHICAG;2U	6.24
274826	FSK ;BP	1.82
274832	U4-027	10.29
274859	EASYSR;U1 E	10.59
274860	EASYSR;U2 E	10.59
274888	PILOT HIL;1E	20.45
274890	CAYUG;1U E	13.37
274891	CAYUG;2U E	13.37
275149	KEMPTON ;1E	20.45
290021	O50 E	18.53
290051	GSG-6; E	10.11
290108	LEEDK;1U E	23.53
293061	N-015 E	14.79
293516	O-009 E1	8.68
293517	O-009 E2	4.41
293518	O-009 E3	4.86
293644	O22 E1	9.25
293645	O22 E2	17.95
293715	O-029 E	9.38
293716	O-029 E	5.14
293717	O-029 E	4.73
293771	O-035 E	6.07
294392	P-010 E	18.79
294763	P-046 E	9.05
295109	WESTBROOK E	5.41
295111	SUBLETTE E	2.49
296125	R-030 C3	3.42
296128	R-030 E3	13.68
296271	R-030 C2	3.38
296272	R-030 E2	13.51
296308	R-030 C1	3.38
296309	R-030 E1	13.51
910541	X3-005 C	0.07
910542	X3-005 E	0.91
914641	Y2-103	43.75
915011	Y3-013 1	3.65

Bus #	Bus	MW Impact
915021	Y3-013 2	3.65
915031	Y3-013 3	3.65
916211	Z1-072 E	4.6
916221	Z1-073 E	5.22
916502	Z1-106 E1	1.23
916504	Z1-106 E2	1.23
916512	Z1-107 E	2.58
916522	Z1-108 E	2.42
917502	Z2-087 E	4.4
918052	AA1-018 E	16.78
919221	AA1-146	16.9
919581	AA2-030	16.9
920272	AA2-123 E	2.37
924471	AB2-096	41.03
925161	AB2-173	3.01
925302	AB2-191 E	1.34
926311	AC1-109 1	1.86
926321	AC1-109 2	1.86
926331	AC1-110 1	1.85
926341	AC1-110 2	1.85
926351	AC1-111 1	0.74
926361	AC1-111 2	0.74
926371	AC1-111 3	0.74
926381	AC1-111 4	0.74
926391	AC1-111 5	0.74
926401	AC1-111 6	0.74
926431	AC1-114	2.3
926821	AC1-168 C O1	1.09
926822	AC1-168 E O1	7.34
927091	AC1-204 1	69.97
927101	AC1-204 2	70.02
927201	AC1-214 C O1	1.95
927202	AC1-214 E O1	6.2
927451	AC1-142A 1	4.09
927461	AC1-142A 2	4.08
927511	AC1-113 1	1.15
927521	AC1-113 2	1.15
927531	AC1-185 1	0.66
927541	AC1-185 2	0.66
927551	AC1-185 3	0.66
927561	AC1-185 4	0.66
927571	AC1-185 5	0.66
927581	AC1-185 6	0.66
927591	AC1-185 7	0.66
927601	AC1-185 8	0.66
930481	AB1-089	63.61
930501	AB1-091 O1	82.15
930741	AB1-122 1O1	69.9
930751	AB1-122 2O1	70.86
932881	AC2-115 1	2.3
932891	AC2-115 2	2.3
932921	AC2-116	0.81

Bus #	Bus	MW Impact
932931	AC2-117	5.29
933341	AC2-147 C	0.84
933342	AC2-147 E	1.37
933411	AC2-154 C	2.78
933412	AC2-154 E	4.53
933431	AC2-156 C O1	0.93
933432	AC2-156 E O1	1.52
933911	AD1-013 C	1.78
933912	AD1-013 E	2.84
933931	AD1-016 C	0.9
933932	AD1-016 E	1.47
934101	AD1-039 1	6.85
934111	AD1-039 2	6.94
934401	AD1-064 C O1	3.1
934402	AD1-064 E O1	14.53
934431	AD1-067 C	0.13
934432	AD1-067 E	0.53
934651	AD1-096 C	0.86
934652	AD1-096 E	1.4
934701	AD1-098 C O1	6.65
934702	AD1-098 E O1	4.86
934721	AD1-100 C	19.51
934722	AD1-100 E	91.04
934871	AD1-116 C	0.98
934872	AD1-116 E	1.59
934971	AD1-129 C	0.88
934972	AD1-129 E	0.58
935001	AD1-133 C O1	20.26
935002	AD1-133 E O1	13.5
936291	AD2-038 C O1	2.32
936292	AD2-038 E O1	15.55
936371	AD2-047 C O1	2.48
936372	AD2-047 E O1	26.73
936461	AD2-060	2.92
936511	AD2-066 C O1	8.12
936512	AD2-066 E O1	5.42
936781	AD2-101 C	4.74
936782	AD2-101 E	22.18
936791	AD2-102 C	11.62
936792	AD2-102 E	11.17
937001	AD2-134 C	2.64
937002	AD2-134 E	10.92
937031	AD2-137 C O1	3.66
937032	AD2-137 E O1	17.14
937051	AD2-140 C O1	3.71
937052	AD2-140 E O1	17.39
937061	AD2-141 C O1	3.69
937062	AD2-141 E O1	17.41
937071	AD2-142 C O1	7.43
937072	AD2-142 E O1	34.78
937121	AD2-148 C O1	3.93
937122	AD2-148 E O1	18.4

Bus #	Bus	MW Impact
937131	AD2-149 C O1	3.93
937132	AD2-149 E O1	18.4
937141	AD2-150 C O1	3.93
937142	AD2-150 E O1	18.4
937181	AD2-155 C O1	3.93
937182	AD2-155 E O1	18.4
937311	AD2-172 C	2.38
937312	AD2-172 E	3.28
937321	AD2-175 C	18.31
937322	AD2-175 E	12.21
937331	AD2-176 C O1	7.11
937332	AD2-176 E O1	4.74
937401	AD2-194 1	7.52
937411	AD2-194 2	7.53
937531	AD2-214 C	4.23
937532	AD2-214 E	1.99
938012	AE1-002 E O1	7.35
938511	AE1-070 1	8.84
938521	AE1-070 2	8.09
938851	AE1-113 C O1	8.39
938852	AE1-113 E O1	26.36
938861	AE1-114 C O1	3.47
938862	AE1-114 E O1	13.25
939051	AE1-134 1	1.31
939061	AE1-134 2	1.31
939321	AE1-163 C O1	5.84
939322	AE1-163 E O1	35.88
939351	AE1-166 C O1	10.22
939352	AE1-166 E O1	9.43
939401	AE1-172 C O1	6.17
939402	AE1-172 E O1	28.89
939691	AE1-199	2.31
939701	AE1-201 C	1.94
939702	AE1-201 E	0.43
939732	AE1-204 E	0.28
939741	AE1-205 C O1	8.55
939742	AE1-205 E O1	11.81
939861	AE1-222 1	77.2
939871	AE1-222 2	78.26
939921	AE1-228 C O1	9.72
939922	AE1-228 E O1	6.48
940101	AE1-252 C O1	10.52
940102	AE1-252 E O1	7.01
940501	AE2-035 C	2.38
940502	AE2-035 E	3.28
940621	AE2-049 C O2	10.08
940622	AE2-049 E O2	6.72
940631	AE2-050 C O2	11.43
940632	AE2-050 E O2	7.62
940752	AE2-062 E	0.13
940762	AE2-063 E	0.13
940881	AE2-077 C	3.05

Bus #	Bus	MW Impact
940882	AE2-077 E	4.97
941131	AE2-107 C	7.07
941132	AE2-107 E	4.72
941551	AE2-152 C O2	12.37
941552	AE2-152 E O2	8.24
941561	AE2-153 C O2	4.97
941562	AE2-153 E O2	23.26
941731	AE2-173	5.1
942111	AE2-223 C	1.98
942112	AE2-223 E	13.26
942421	AE2-255 C O2	2.96
942422	AE2-255 E O2	8.87
942651	AE2-281 C	0.83
942652	AE2-281 E	5.13
942881	AE2-307 C	20.96
942882	AE2-307 E	7.62
942911	AE2-310 C	9.79
942912	AE2-310 E	2.64
942991	AE2-321 C O2	7.94
942992	AE2-321 E O2	3.91
943121	AE2-341 C	12.44
943122	AE2-341 E	6.11
BLUEG	BLUEG	5.58
CALDERWOOD	CALDERWOOD	0.07
CANNELTON	CANNELTON	0.09
CARR	CARR	0.74
CATAWBA	CATAWBA	0.28
CBM-S1	CBM-S1	1.36
CBM-W1	CBM-W1	23.91
CBM-W2	CBM-W2	51.57
CHEOAH	CHEOAH	0.07
CHILHOWEE	CHILHOWEE	0.02
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.05
GIBSON	GIBSON	0.04
HAMLET	HAMLET	0.53
MEC	MEC	35.99
O-066	O-066	13.18
RENSSELAER	RENSSELAER	0.58
SANTEETLA	SANTEETLA	0.02
TRIMBLE	TRIMBLE	0.66
WEC	WEC	7.73
Z1-043	Z1-043	27.22

26.7 Index 7

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229307	270716	DRESDEN ; B	CE	270928	WOLFS ; B	CE	1	COMED_P4_012-45-BT5-6__	breaker	1479.0	120.51	121.95	DC	21.21

Bus #	Bus	MW Impact
274658	DRESDEN ;2U	61.98
274677	POWERTON ;5U	10.18
274678	POWERTON ;6U	10.09
274836	EQUISTAR ; R	3.53
274879	MINONK ;1U	1.5
290021	O50 E	49.28
904211	W3-135	0.29
916502	Z1-106 E1	0.62
916504	Z1-106 E2	0.61
930751	AB1-122 2O1	318.89
934111	AD1-039 2	31.25
936291	AD2-038 C O1	1.49
936292	AD2-038 E O1	9.96
936511	AD2-066 C O1	15.81
936512	AD2-066 E O1	10.54
938851	AE1-113 C O1	22.3
938852	AE1-113 E O1	70.1
939321	AE1-163 C O1	3.74
939322	AE1-163 E O1	22.96
939871	AE1-222 2	352.17
941551	AE2-152 C O2	15.21
941552	AE2-152 E O2	10.14
941561	AE2-153 C O2	3.73
941562	AE2-153 E O2	17.48
942421	AE2-255 C O2	1.98
942422	AE2-255 E O2	5.94
942651	AE2-281 C	0.53
942652	AE2-281 E	3.28
953201	J715 C	1.34
953202	J715 E	7.25
BLUEG	BLUEG	0.44
CALDERWOOD	CALDERWOOD	0.02
CARR	CARR	0.07
CATAWBA	CATAWBA	0.03
CBM-S1	CBM-S1	0.07
CBM-W2	CBM-W2	7.83
CHEOAH	CHEOAH	0.02
CHILHOWEE	CHILHOWEE	0.01
CIN	CIN	0.15
FARMERCITY	FARMERCITY	0.1
G-007	G-007	0.2
HAMLET	HAMLET	0.06

Bus #	Bus	MW Impact
IPL	IPL	0.03
O-066	O-066	1.31
RENSSELAER	RENSSELAER	0.06
SANTEETLA	SANTEETLA	0.01
TATANKA	TATANKA	0.73
TRIMBLE	TRIMBLE	0.05
Z1-043	Z1-043	16.13

26.8 Index 8

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229345	270728	E FRANKFO; B	CE	274750	CRETE EC ;BP	CE	1	COMED_P4_112-65-BT3-4__	breaker	1399.0	113.96	114.08	DC	25.06

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	12.76
274654	BRAIDWOOD;1U	21.73
274655	BRAIDWOOD;2U	20.79
274660	LASCO STA;1U	19.85
274661	LASCO STA;2U	19.89
274675	JOLIET 29;7U	8.97
274676	JOLIET 29;8U	8.97
274687	WILL CNTY;4U	9.06
274704	KENDALL ;1C	3.19
274705	KENDALL ;1S	2.13
274706	KENDALL ;2C	3.19
274707	KENDALL ;2S	2.13
274722	S-055 E	11.95
274736	ELWOOD EC;9P	2.57
274859	EASYR;U1 E	11.54
274860	EASYR;U2 E	11.54
274861	TOP CROP ;1U	0.38
274862	TOP CROP ;2U	0.73
274888	PILOT HIL;1E	17.16
275149	KEMPTON ;1E	17.16
290021	O50 E	20.84
290051	GSG-6; E	10.97
290108	LEEDK;1U E	25.51
293061	N-015 E	16.48
293516	O-009 E1	6.05
293517	O-009 E2	3.07
293518	O-009 E3	3.39
293644	O22 E1	12.37
293645	O22 E2	24.01
293715	O-029 E	10.23
293716	O-029 E	5.61
293717	O-029 E	5.15
294392	P-010 E	20.93
294763	P-046 E	9.86
295109	WESTBROOK E	5.87
295111	SUBLETTE E	2.72
914641	Y2-103	47.78
915011	Y3-013 1	3.98
915021	Y3-013 2	3.98
915031	Y3-013 3	3.98
916221	Z1-073 E	5.66

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.33
916504	Z1-106 E2	1.33
916512	Z1-107 E	2.56
916522	Z1-108 E	2.63
918052	AA1-018 E	16.24
919221	AA1-146	18.43
919581	AA2-030	18.43
920272	AA2-123 E	2.58
924471	AB2-096	44.68
925161	AB2-173	3.29
925302	AB2-191 E	1.45
926311	AC1-109 1	2.0
926321	AC1-109 2	2.0
926331	AC1-110 1	2.01
926341	AC1-110 2	2.01
926351	AC1-111 1	0.8
926361	AC1-111 2	0.8
926371	AC1-111 3	0.8
926381	AC1-111 4	0.8
926391	AC1-111 5	0.8
926401	AC1-111 6	0.8
926431	AC1-114	2.51
926821	AC1-168 C O1	1.2
926822	AC1-168 E O1	8.04
927091	AC1-204 1	78.55
927101	AC1-204 2	78.42
927451	AC1-142A 1	4.55
927461	AC1-142A 2	4.55
927511	AC1-113 1	1.25
927521	AC1-113 2	1.25
927531	AC1-185 1	0.72
927541	AC1-185 2	0.72
927551	AC1-185 3	0.72
927561	AC1-185 4	0.72
927571	AC1-185 5	0.72
927581	AC1-185 6	0.72
927591	AC1-185 7	0.72
927601	AC1-185 8	0.72
930481	AB1-089	69.28
930501	AB1-091 O1	67.62
930741	AB1-122 1O1	74.91
930751	AB1-122 2O1	80.1
932881	AC2-115 1	2.51
932891	AC2-115 2	2.51
932921	AC2-116	0.88
933341	AC2-147 C	0.92
933342	AC2-147 E	1.49
933411	AC2-154 C	2.33
933412	AC2-154 E	3.8
933431	AC2-156 C O1	1.0
933432	AC2-156 E O1	1.63
933911	AD1-013 C	1.93

Bus #	Bus	MW Impact
933912	AD1-013 E	3.09
933931	AD1-016 C	0.98
933932	AD1-016 E	1.6
934101	AD1-039 1	7.34
934111	AD1-039 2	7.85
934401	AD1-064 C O1	3.38
934402	AD1-064 E O1	15.82
934431	AD1-067 C	0.14
934432	AD1-067 E	0.58
934651	AD1-096 C	0.94
934652	AD1-096 E	1.53
934701	AD1-098 C O1	7.22
934702	AD1-098 E O1	5.27
934721	AD1-100 C	19.99
934722	AD1-100 E	93.28
934871	AD1-116 C	0.95
934872	AD1-116 E	1.54
934971	AD1-129 C	0.95
934972	AD1-129 E	0.64
935001	AD1-133 C O1	21.37
935002	AD1-133 E O1	14.25
936291	AD2-038 C O1	2.41
936292	AD2-038 E O1	16.13
936371	AD2-047 C O1	2.08
936372	AD2-047 E O1	22.44
936461	AD2-060	2.45
936511	AD2-066 C O1	8.73
936512	AD2-066 E O1	5.82
936791	AD2-102 C	12.66
936792	AD2-102 E	12.17
937001	AD2-134 C	2.87
937002	AD2-134 E	11.85
937031	AD2-137 C O1	3.34
937032	AD2-137 E O1	15.65
937051	AD2-140 C O1	3.33
937052	AD2-140 E O1	15.57
937061	AD2-141 C O1	3.31
937062	AD2-141 E O1	15.59
937071	AD2-142 C O1	6.65
937072	AD2-142 E O1	31.14
937121	AD2-148 C O1	3.25
937122	AD2-148 E O1	15.2
937131	AD2-149 C O1	3.25
937132	AD2-149 E O1	15.2
937141	AD2-150 C O1	3.25
937142	AD2-150 E O1	15.2
937181	AD2-155 C O1	3.25
937182	AD2-155 E O1	15.2
937311	AD2-172 C	2.59
937312	AD2-172 E	3.57
937321	AD2-175 C	15.13
937322	AD2-175 E	10.08

Bus #	Bus	MW Impact
937331	AD2-176 C O1	7.74
937332	AD2-176 E O1	5.16
937401	AD2-194 1	8.45
937411	AD2-194 2	8.43
938012	AE1-002 E O1	6.71
938511	AE1-070 1	9.93
938521	AE1-070 2	9.07
938851	AE1-113 C O1	9.43
938852	AE1-113 E O1	29.64
938861	AE1-114 C O1	3.78
938862	AE1-114 E O1	14.44
939051	AE1-134 1	1.43
939061	AE1-134 2	1.43
939321	AE1-163 C O1	6.06
939322	AE1-163 E O1	37.2
939351	AE1-166 C O1	10.69
939352	AE1-166 E O1	9.87
939401	AE1-172 C O1	6.26
939402	AE1-172 E O1	29.3
939691	AE1-199	2.51
939701	AE1-201 C	2.12
939702	AE1-201 E	0.46
939732	AE1-204 E	0.31
939861	AE1-222 1	82.73
939871	AE1-222 2	88.46
939921	AE1-228 C O1	10.55
939922	AE1-228 E O1	7.03
940101	AE1-252 C O1	10.67
940102	AE1-252 E O1	7.11
940501	AE2-035 C	2.59
940502	AE2-035 E	3.57
940621	AE2-049 C O2	8.46
940622	AE2-049 E O2	5.64
940631	AE2-050 C O2	13.3
940632	AE2-050 E O2	8.87
940752	AE2-062 E	0.14
940762	AE2-063 E	0.14
940881	AE2-077 C	3.32
940882	AE2-077 E	5.42
941131	AE2-107 C	7.67
941132	AE2-107 E	5.11
941551	AE2-152 C O2	11.47
941552	AE2-152 E O2	7.64
941561	AE2-153 C O2	4.41
941562	AE2-153 E O2	20.65
942421	AE2-255 C O2	3.09
942422	AE2-255 E O2	9.26
942651	AE2-281 C	0.87
942652	AE2-281 E	5.31
942881	AE2-307 C	24.39
942882	AE2-307 E	8.87
942911	AE2-310 C	8.21

Bus #	Bus	MW Impact
942912	AE2-310 E	2.22
942991	AE2-321 C O2	8.65
942992	AE2-321 E O2	4.26
943121	AE2-341 C	13.36
943122	AE2-341 E	6.56
BLUEG	BLUEG	6.81
CALDERWOOD	CALDERWOOD	0.08
CANNELTON	CANNELTON	0.14
CARR	CARR	0.75
CATAWBA	CATAWBA	0.29
CBM-S1	CBM-S1	1.26
CBM-W1	CBM-W1	26.85
CBM-W2	CBM-W2	53.48
CHEOAH	CHEOAH	0.09
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.17
G-007	G-007	2.1
GIBSON	GIBSON	0.08
HAMLET	HAMLET	0.56
MEC	MEC	39.06
O-066	O-066	13.46
RENSSELAER	RENSSELAER	0.59
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.8
WEC	WEC	8.44
Z1-043	Z1-043	29.69

26.9 Index 9

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CK T ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADIN G %	POST PROJECT LOADIN G %	AC D C	MW IMPACT
154219 1	27077 1	GREENACRE ;T	CE	24322 9	05OLIV E	AEP	1	AEP_P4_#2978_05DUMON T 765_B	breaker	971.0	125.73	125.87	DC	17.54

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	8.05
274722	S-055 E	7.51
274751	CRETE EC ;1U	1.53
274752	CRETE EC ;2U	1.53
274753	CRETE EC ;3U	1.53
274754	CRETE EC ;4U	1.53
274788	SE CHICAG;5U	3.6
274789	SE CHICAG;6U	3.6
274790	SE CHICAG;7U	3.6
274791	SE CHICAG;8U	3.6
274792	SE CHICAG;9U	3.65
274793	SE CHICAG;0U	3.65
274794	SE CHICAG;1U	3.65
274795	SE CHICAG;2U	3.65
274859	EASYR;U1 E	7.29
274860	EASYR;U2 E	7.29
274888	PILOT HIL;1E	12.38
274890	CAYUG;1U E	8.91
274891	CAYUG;2U E	8.91
275149	KEMPTON ;1E	12.38
290021	O50 E	12.96
290051	GSG-6; E	6.93
290108	LEEDK;1U E	16.12
293061	N-015 E	10.22
293516	O-009 E1	2.6
293517	O-009 E2	1.32
293518	O-009 E3	1.45
293644	O22 E1	7.23
293645	O22 E2	14.04
293715	O-029 E	6.46
293716	O-029 E	3.54
293717	O-029 E	3.26
294392	P-010 E	12.98
294763	P-046 E	6.22
295109	WESTBROOK E	3.71
295111	SUBLETTE E	1.72
910542	X3-005 E	0.52
914641	Y2-103	30.04
915011	Y3-013 1	2.5
915021	Y3-013 2	2.5
915031	Y3-013 3	2.5
916221	Z1-073 E	3.58

Bus #	Bus	MW Impact
916502	Z1-106 E1	0.84
916504	Z1-106 E2	0.84
916512	Z1-107 E	1.71
916522	Z1-108 E	1.66
918052	AA1-018 E	10.6
919221	AA1-146	11.65
919581	AA2-030	11.65
920272	AA2-123 E	1.63
924471	AB2-096	28.16
925161	AB2-173	2.08
925302	AB2-191 E	0.92
926311	AC1-109 1	1.27
926321	AC1-109 2	1.27
926331	AC1-110 1	1.26
926341	AC1-110 2	1.26
926351	AC1-111 1	0.51
926361	AC1-111 2	0.51
926371	AC1-111 3	0.51
926381	AC1-111 4	0.51
926391	AC1-111 5	0.51
926401	AC1-111 6	0.51
926431	AC1-114	1.58
926821	AC1-168 C O1	0.76
926822	AC1-168 E O1	5.07
927091	AC1-204 1	48.7
927101	AC1-204 2	48.66
927451	AC1-142A 1	2.83
927461	AC1-142A 2	2.83
927511	AC1-113 1	0.79
927521	AC1-113 2	0.79
927531	AC1-185 1	0.46
927541	AC1-185 2	0.46
927551	AC1-185 3	0.46
927561	AC1-185 4	0.46
927571	AC1-185 5	0.46
927581	AC1-185 6	0.46
927591	AC1-185 7	0.46
927601	AC1-185 8	0.46
930481	AB1-089	43.69
930501	AB1-091 O1	49.08
930741	AB1-122 1O1	47.51
930751	AB1-122 2O1	49.69
932881	AC2-115 1	1.58
932891	AC2-115 2	1.58
932921	AC2-116	0.55
933341	AC2-147 C	0.58
933342	AC2-147 E	0.94
933411	AC2-154 C	1.68
933412	AC2-154 E	2.74
933431	AC2-156 C O1	0.63
933432	AC2-156 E O1	1.04
933911	AD1-013 C	1.22

Bus #	Bus	MW Impact
933912	AD1-013 E	1.95
933931	AD1-016 C	0.62
933932	AD1-016 E	1.01
934101	AD1-039 1	4.66
934111	AD1-039 2	4.87
934401	AD1-064 C O1	2.13
934402	AD1-064 E O1	9.97
934431	AD1-067 C	0.09
934432	AD1-067 E	0.37
934651	AD1-096 C	0.59
934652	AD1-096 E	0.97
934701	AD1-098 C O1	4.56
934702	AD1-098 E O1	3.33
934721	AD1-100 C	12.92
934722	AD1-100 E	60.3
934871	AD1-116 C	0.62
934872	AD1-116 E	1.01
934971	AD1-129 C	0.6
934972	AD1-129 E	0.4
935001	AD1-133 C O1	13.71
935002	AD1-133 E O1	9.14
936291	AD2-038 C O1	1.54
936292	AD2-038 E O1	10.3
936371	AD2-047 C O1	1.5
936372	AD2-047 E O1	16.18
936461	AD2-060	1.77
936511	AD2-066 C O1	5.55
936512	AD2-066 E O1	3.7
936781	AD2-101 C	3.17
936782	AD2-101 E	14.82
936791	AD2-102 C	7.99
936792	AD2-102 E	7.67
937001	AD2-134 C	1.81
937002	AD2-134 E	7.49
937031	AD2-137 C O1	2.3
937032	AD2-137 E O1	10.79
937051	AD2-140 C O1	2.32
937052	AD2-140 E O1	10.85
937061	AD2-141 C O1	2.3
937062	AD2-141 E O1	10.86
937071	AD2-142 C O1	4.64
937072	AD2-142 E O1	21.7
937121	AD2-148 C O1	2.36
937122	AD2-148 E O1	11.03
937131	AD2-149 C O1	2.36
937132	AD2-149 E O1	11.03
937141	AD2-150 C O1	2.36
937142	AD2-150 E O1	11.03
937181	AD2-155 C O1	2.36
937182	AD2-155 E O1	11.03
937311	AD2-172 C	1.63
937312	AD2-172 E	2.26

Bus #	Bus	MW Impact
937321	AD2-175 C	10.97
937322	AD2-175 E	7.32
937331	AD2-176 C O1	4.88
937332	AD2-176 E O1	3.25
937401	AD2-194 1	5.24
937411	AD2-194 2	5.23
938012	AE1-002 E O1	4.63
938511	AE1-070 1	6.15
938521	AE1-070 2	5.63
938851	AE1-113 C O1	5.87
938852	AE1-113 E O1	18.44
938861	AE1-114 C O1	2.38
938862	AE1-114 E O1	9.12
939051	AE1-134 1	0.9
939061	AE1-134 2	0.9
939321	AE1-163 C O1	3.87
939322	AE1-163 E O1	23.76
939351	AE1-166 C O1	6.83
939352	AE1-166 E O1	6.3
939401	AE1-172 C O1	4.09
939402	AE1-172 E O1	19.14
939641	AE1-194 C	10.88
939642	AE1-194 E	72.79
939651	AE1-195 C	10.88
939652	AE1-195 E	72.79
939691	AE1-199	1.59
939701	AE1-201 C	1.33
939702	AE1-201 E	0.29
939732	AE1-204 E	0.2
939861	AE1-222 1	52.47
939871	AE1-222 2	54.87
939921	AE1-228 C O1	6.67
939922	AE1-228 E O1	4.44
940101	AE1-252 C O1	6.97
940102	AE1-252 E O1	4.65
940501	AE2-035 C	1.63
940502	AE2-035 E	2.26
940621	AE2-049 C O2	6.1
940622	AE2-049 E O2	4.07
940631	AE2-050 C O2	8.04
940632	AE2-050 E O2	5.36
940752	AE2-062 E	0.09
940762	AE2-063 E	0.09
940881	AE2-077 C	2.09
940882	AE2-077 E	3.42
941131	AE2-107 C	4.85
941132	AE2-107 E	3.23
941551	AE2-152 C O2	7.84
941552	AE2-152 E O2	5.23
941561	AE2-153 C O2	3.09
941562	AE2-153 E O2	14.45
942421	AE2-255 C O2	1.97

Bus #	Bus	MW Impact
942422	AE2-255 E O2	5.9
942651	AE2-281 C	0.55
942652	AE2-281 E	3.39
942881	AE2-307 C	14.74
942882	AE2-307 E	5.36
942911	AE2-310 C	5.93
942912	AE2-310 E	1.6
942991	AE2-321 C O2	5.45
942992	AE2-321 E O2	2.68
943121	AE2-341 C	8.47
943122	AE2-341 E	4.16
951721	J643	15.48
952581	J740 C	3.4
952582	J740 E	18.4
953871	J847	8.37
BLUEG	BLUEG	2.92
CANNELTON	CANNELTON	0.01
CARR	CARR	0.5
CATAWBA	CATAWBA	0.17
CBM-S1	CBM-S1	1.31
CBM-W1	CBM-W1	20.03
CBM-W2	CBM-W2	38.34
CHEOAH	CHEOAH	0.0
CIN	CIN	0.09
G-007	G-007	1.39
HAMLET	HAMLET	0.33
MEC	MEC	24.99
O-066	O-066	8.94
RENSSELAER	RENSSELAER	0.4
SANTEETLA	SANTEETLA	0.0
TRIMBLE	TRIMBLE	0.35
WEC	WEC	5.32
Z1-043	Z1-043	18.79

26.10 Index 10

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229245	270886	ST JOHN ; T	CE	255104	17GREEN_ACRE	NIPS	1	COMED_P4_023-65-BT2-3__	breaker	1091.0	133.07	133.17	DC	18.43

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.02
274654	BRAIDWOOD;1U	15.11
274655	BRAIDWOOD;2U	14.47
274661	LASCO STA;2U	13.96
274687	WILL CNTY;4U	6.37
274704	KENDALL ;1C	2.23
274705	KENDALL ;1S	1.49
274706	KENDALL ;2C	2.23
274707	KENDALL ;2S	1.49
274722	S-055 E	8.43
274751	CRETE EC ;1U	2.67
274752	CRETE EC ;2U	2.67
274753	CRETE EC ;3U	2.67
274754	CRETE EC ;4U	2.67
274859	EASYR;U1 E	8.15
274860	EASYR;U2 E	8.15
274861	TOP CROP ;1U	0.26
274862	TOP CROP ;2U	0.5
274888	PILOT HIL;1E	12.78
275149	KEMPTON ;1E	12.78
290021	O50 E	14.62
290051	GSG-6; E	7.76
290108	LEEDK;1U E	18.05
293061	N-015 E	11.59
293644	O22 E1	8.49
293645	O22 E2	16.47
294392	P-010 E	14.72
294763	P-046 E	6.96
295109	WESTBROOK E	4.15
295111	SUBLETTE E	1.92
914641	Y2-103	33.72
915011	Y3-013 1	2.81
915021	Y3-013 2	2.81
915031	Y3-013 3	2.81
916221	Z1-073 E	4.0
916502	Z1-106 E1	0.94
916504	Z1-106 E2	0.94
916512	Z1-107 E	1.85
916522	Z1-108 E	1.86
918052	AA1-018 E	11.61
920272	AA2-123 E	1.82

Bus #	Bus	MW Impact
924471	AB2-096	31.56
925302	AB2-191 E	1.03
926311	AC1-109 1	1.42
926321	AC1-109 2	1.42
926331	AC1-110 1	1.42
926341	AC1-110 2	1.42
926351	AC1-111 1	0.57
926361	AC1-111 2	0.57
926371	AC1-111 3	0.57
926381	AC1-111 4	0.57
926391	AC1-111 5	0.57
926401	AC1-111 6	0.57
926431	AC1-114	1.77
927091	AC1-204 1	55.08
927101	AC1-204 2	55.0
927451	AC1-142A 1	3.19
927461	AC1-142A 2	3.2
927511	AC1-113 1	0.89
927521	AC1-113 2	0.89
927531	AC1-185 1	0.51
927541	AC1-185 2	0.51
927551	AC1-185 3	0.51
927561	AC1-185 4	0.51
927571	AC1-185 5	0.51
927581	AC1-185 6	0.51
927591	AC1-185 7	0.51
927601	AC1-185 8	0.51
930481	AB1-089	48.93
930501	AB1-091 O1	50.49
930741	AB1-122 1O1	52.86
930751	AB1-122 2O1	56.21
932881	AC2-115 1	1.77
932891	AC2-115 2	1.77
932921	AC2-116	0.62
933341	AC2-147 C	0.65
933342	AC2-147 E	1.05
933411	AC2-154 C	1.73
933412	AC2-154 E	2.83
933431	AC2-156 C O1	0.71
933432	AC2-156 E O1	1.16
933911	AD1-013 C	1.37
933912	AD1-013 E	2.18
933931	AD1-016 C	0.69
933932	AD1-016 E	1.13
934101	AD1-039 1	5.18
934111	AD1-039 2	5.51
934401	AD1-064 C O1	2.39
934402	AD1-064 E O1	11.18
934431	AD1-067 C	0.1
934432	AD1-067 E	0.41
934651	AD1-096 C	0.66
934652	AD1-096 E	1.08

Bus #	Bus	MW Impact
934701	AD1-098 C O1	5.1
934702	AD1-098 E O1	3.73
934721	AD1-100 C	14.24
934722	AD1-100 E	66.45
934871	AD1-116 C	0.68
934872	AD1-116 E	1.1
934971	AD1-129 C	0.67
934972	AD1-129 E	0.45
935001	AD1-133 C O1	10.36
935002	AD1-133 E O1	6.91
936291	AD2-038 C O1	1.71
936292	AD2-038 E O1	11.42
936371	AD2-047 C O1	1.55
936372	AD2-047 E O1	16.71
936461	AD2-060	1.83
936511	AD2-066 C O1	6.18
936512	AD2-066 E O1	4.12
936781	AD2-101 C	3.08
936782	AD2-101 E	14.43
936791	AD2-102 C	8.94
936792	AD2-102 E	8.59
937001	AD2-134 C	2.03
937002	AD2-134 E	8.38
937031	AD2-137 C O1	2.44
937032	AD2-137 E O1	11.4
937051	AD2-140 C O1	2.43
937052	AD2-140 E O1	11.4
937061	AD2-141 C O1	2.42
937062	AD2-141 E O1	11.41
937071	AD2-142 C O1	4.87
937072	AD2-142 E O1	22.79
937121	AD2-148 C O1	2.42
937122	AD2-148 E O1	11.35
937131	AD2-149 C O1	2.42
937132	AD2-149 E O1	11.35
937141	AD2-150 C O1	2.42
937142	AD2-150 E O1	11.35
937181	AD2-155 C O1	2.42
937182	AD2-155 E O1	11.35
937311	AD2-172 C	1.83
937312	AD2-172 E	2.52
937321	AD2-175 C	11.29
937322	AD2-175 E	7.53
937331	AD2-176 C O1	5.47
937332	AD2-176 E O1	3.65
937401	AD2-194 1	5.92
937411	AD2-194 2	5.91
938012	AE1-002 E O1	4.89
938511	AE1-070 1	6.96
938521	AE1-070 2	6.36
938851	AE1-113 C O1	6.61
938852	AE1-113 E O1	20.79

Bus #	Bus	MW Impact
938861	AE1-114 C O1	2.67
938862	AE1-114 E O1	10.19
939321	AE1-163 C O1	4.29
939322	AE1-163 E O1	26.35
939351	AE1-166 C O1	7.59
939352	AE1-166 E O1	7.0
939401	AE1-172 C O1	4.46
939402	AE1-172 E O1	20.9
939641	AE1-194 C	18.94
939642	AE1-194 E	126.77
939651	AE1-195 C	18.94
939652	AE1-195 E	126.77
939691	AE1-199	1.77
939701	AE1-201 C	1.49
939702	AE1-201 E	0.33
939732	AE1-204 E	0.22
939861	AE1-222 1	58.38
939871	AE1-222 2	62.07
939921	AE1-228 C O1	7.46
939922	AE1-228 E O1	4.97
940101	AE1-252 C O1	7.61
940102	AE1-252 E O1	5.07
940501	AE2-035 C	1.83
940502	AE2-035 E	2.52
940621	AE2-049 C O2	6.3
940622	AE2-049 E O2	4.2
940631	AE2-050 C O2	9.26
940632	AE2-050 E O2	6.17
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.34
940882	AE2-077 E	3.82
941131	AE2-107 C	5.42
941132	AE2-107 E	3.62
941551	AE2-152 C O2	8.35
941552	AE2-152 E O2	5.57
941561	AE2-153 C O2	3.24
941562	AE2-153 E O2	15.19
942421	AE2-255 C O2	2.18
942422	AE2-255 E O2	6.55
942651	AE2-281 C	0.61
942652	AE2-281 E	3.76
942881	AE2-307 C	16.97
942882	AE2-307 E	6.17
942911	AE2-310 C	6.12
942912	AE2-310 E	1.65
942991	AE2-321 C O2	6.11
942992	AE2-321 E O2	3.01
943121	AE2-341 C	9.48
943122	AE2-341 E	4.66
BLUEG	BLUEG	5.15
CALDERWOOD	CALDERWOOD	0.1

Bus #	Bus	MW Impact
CANNELTON	CANNELTON	0.11
CARR	CARR	0.57
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	0.69
CBM-W1	CBM-W1	20.05
CBM-W2	CBM-W2	36.81
CHEOAH	CHEOAH	0.1
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.15
G-007	G-007	1.6
GIBSON	GIBSON	0.07
HAMLET	HAMLET	0.45
MEC	MEC	27.48
O-066	O-066	10.25
RENSSELAER	RENSSELAER	0.45
SANTEETLA	SANTEETLA	0.03
TRIMBLE	TRIMBLE	0.6
WEC	WEC	5.96
Z1-043	Z1-043	20.93

26.11 Index 11

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229177	270926	WILTON ;B	CE	275232	WILTON ;3M	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.83	162.99	DC	33.13

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	14.78
274722	S-055 E	13.73
274772	LINCOLN ;3U	2.67
274773	LINCOLN ;4U	2.67
274774	LINCOLN ;5U	2.67
274775	LINCOLN ;6U	2.67
274776	LINCOLN ;7U	2.67
274777	LINCOLN ;8U	2.67
274788	SE CHICAG;5U	5.44
274789	SE CHICAG;6U	5.44
274790	SE CHICAG;7U	5.44
274791	SE CHICAG;8U	5.44
274792	SE CHICAG;9U	5.4
274793	SE CHICAG;0U	5.4
274794	SE CHICAG;1U	5.4
274795	SE CHICAG;2U	5.4
274859	EASYR;U1 E	13.43
274860	EASYR;U2 E	13.43
274888	PILOT HIL;1E	23.57
274890	CAYUG;1U E	20.22
274891	CAYUG;2U E	20.22
275149	KEMPTON ;1E	23.57
290021	O50 E	23.7
290051	GSG-6; E	12.77
290108	LEEDK;1U E	29.68
293061	N-015 E	19.41
293644	O22 E1	12.53
293645	O22 E2	24.32
294392	P-010 E	24.65
294763	P-046 E	11.45
295109	WESTBROOK E	6.84
295111	SUBLETTE E	3.17
296125	R-030 C3	4.97
296128	R-030 E3	19.89
296271	R-030 C2	4.91
296272	R-030 E2	19.65
296308	R-030 C1	4.91
296309	R-030 E1	19.65
910542	X3-005 E	0.89
914641	Y2-103	54.9
915011	Y3-013 1	4.58
915021	Y3-013 2	4.58

Bus #	Bus	MW Impact
915031	Y3-013 3	4.58
916221	Z1-073 E	6.59
916502	Z1-106 E1	1.54
916504	Z1-106 E2	1.54
916512	Z1-107 E	3.16
916522	Z1-108 E	3.04
917502	Z2-087 E	25.71
918052	AA1-018 E	20.09
919581	AA2-030	18.9
920272	AA2-123 E	2.99
924041	AB2-047 C O1	4.74
924042	AB2-047 E O1	31.72
924471	AB2-096	51.73
925161	AB2-173	3.83
925302	AB2-191 E	1.69
926311	AC1-109 1	2.34
926321	AC1-109 2	2.34
926331	AC1-110 1	2.32
926341	AC1-110 2	2.32
926351	AC1-111 1	0.93
926361	AC1-111 2	0.93
926371	AC1-111 3	0.93
926381	AC1-111 4	0.93
926391	AC1-111 5	0.93
926401	AC1-111 6	0.93
926431	AC1-114	2.91
926821	AC1-168 C O1	1.43
926822	AC1-168 E O1	9.57
927091	AC1-204 1	88.75
927101	AC1-204 2	88.75
927451	AC1-142A 1	5.11
927461	AC1-142A 2	5.11
927511	AC1-113 1	1.45
927521	AC1-113 2	1.45
927531	AC1-185 1	0.84
927541	AC1-185 2	0.84
927551	AC1-185 3	0.84
927561	AC1-185 4	0.84
927571	AC1-185 5	0.84
927581	AC1-185 6	0.84
927591	AC1-185 7	0.84
927601	AC1-185 8	0.84
930481	AB1-089	80.33
930501	AB1-091 O1	93.8
930741	AB1-122 1O1	89.17
930751	AB1-122 2O1	90.13
932881	AC2-115 1	2.91
932891	AC2-115 2	2.91
932921	AC2-116	1.02
932931	AC2-117	6.51
933341	AC2-147 C	1.07
933342	AC2-147 E	1.74

Bus #	Bus	MW Impact
933411	AC2-154 C	3.2
933412	AC2-154 E	5.22
933431	AC2-156 C O1	1.17
933432	AC2-156 E O1	1.91
933911	AD1-013 C	2.25
933912	AD1-013 E	3.59
933931	AD1-016 C	1.13
933932	AD1-016 E	1.85
934101	AD1-039 1	8.74
934111	AD1-039 2	8.83
934401	AD1-064 C O1	3.91
934402	AD1-064 E O1	18.33
934431	AD1-067 C	0.16
934432	AD1-067 E	0.67
934651	AD1-096 C	1.09
934652	AD1-096 E	1.78
934701	AD1-098 C O1	8.41
934702	AD1-098 E O1	6.14
934721	AD1-100 C	29.39
934722	AD1-100 E	137.14
934871	AD1-116 C	1.17
934872	AD1-116 E	1.91
934971	AD1-129 C	1.1
934972	AD1-129 E	0.74
935001	AD1-133 C O1	27.36
935002	AD1-133 E O1	18.24
936291	AD2-038 C O1	2.88
936292	AD2-038 E O1	19.25
936371	AD2-047 C O1	2.86
936372	AD2-047 E O1	30.81
936461	AD2-060	3.37
936511	AD2-066 C O1	10.34
936512	AD2-066 E O1	6.89
936781	AD2-101 C	5.82
936782	AD2-101 E	27.26
936791	AD2-102 C	14.68
936792	AD2-102 E	14.11
937001	AD2-134 C	3.34
937002	AD2-134 E	13.8
937031	AD2-137 C O1	7.17
937032	AD2-137 E O1	33.55
937051	AD2-140 C O1	7.53
937052	AD2-140 E O1	35.24
937061	AD2-141 C O1	7.48
937062	AD2-141 E O1	35.28
937071	AD2-142 C O1	15.05
937072	AD2-142 E O1	70.48
937121	AD2-148 C O1	4.51
937122	AD2-148 E O1	21.09
937131	AD2-149 C O1	4.51
937132	AD2-149 E O1	21.09
937141	AD2-150 C O1	4.51

Bus #	Bus	MW Impact
937142	AD2-150 E O1	21.09
937181	AD2-155 C O1	4.51
937182	AD2-155 E O1	21.09
937311	AD2-172 C	3.01
937312	AD2-172 E	4.15
937321	AD2-175 C	20.99
937322	AD2-175 E	13.99
937331	AD2-176 C O1	8.96
937332	AD2-176 E O1	5.97
937401	AD2-194 1	9.54
937411	AD2-194 2	9.54
938012	AE1-002 E O1	14.38
938511	AE1-070 1	11.21
938521	AE1-070 2	10.26
938851	AE1-113 C O1	10.72
938852	AE1-113 E O1	33.71
938861	AE1-114 C O1	4.39
938862	AE1-114 E O1	16.8
939051	AE1-134 1	1.67
939061	AE1-134 2	1.67
939321	AE1-163 C O1	7.23
939322	AE1-163 E O1	44.39
939351	AE1-166 C O1	14.5
939352	AE1-166 E O1	13.38
939401	AE1-172 C O1	9.5
939402	AE1-172 E O1	44.49
939691	AE1-199	2.92
939701	AE1-201 C	2.45
939702	AE1-201 E	0.54
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.45
939742	AE1-205 E O1	17.19
939861	AE1-222 1	98.48
939871	AE1-222 2	99.54
939921	AE1-228 C O1	12.28
939922	AE1-228 E O1	8.19
940101	AE1-252 C O1	16.2
940102	AE1-252 E O1	10.8
940501	AE2-035 C	3.01
940502	AE2-035 E	4.15
940621	AE2-049 C O2	11.62
940622	AE2-049 E O2	7.75
940631	AE2-050 C O2	15.56
940632	AE2-050 E O2	10.38
940752	AE2-062 E	0.16
940762	AE2-063 E	0.16
940881	AE2-077 C	3.85
940882	AE2-077 E	6.28
941131	AE2-107 C	8.92
941132	AE2-107 E	5.95
941551	AE2-152 C O2	14.72
941552	AE2-152 E O2	9.81

Bus #	Bus	MW Impact
941561	AE2-153 C O2	5.83
941562	AE2-153 E O2	27.3
941731	AE2-173	7.43
942111	AE2-223 C	2.88
942112	AE2-223 E	19.28
942421	AE2-255 C O2	3.67
942422	AE2-255 E O2	11.02
942651	AE2-281 C	1.03
942652	AE2-281 E	6.34
942881	AE2-307 C	28.54
942882	AE2-307 E	10.38
942911	AE2-310 C	11.28
942912	AE2-310 E	3.05
942991	AE2-321 C O2	10.0
942992	AE2-321 E O2	4.93
943121	AE2-341 C	15.61
943122	AE2-341 E	7.67
BLUEG	BLUEG	8.01
CALDERWOOD	CALDERWOOD	0.11
CANNELTON	CANNELTON	0.1
CARR	CARR	0.97
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.72
CBM-W1	CBM-W1	37.34
CBM-W2	CBM-W2	70.72
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.73
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.74
MEC	MEC	46.44
O-066	O-066	17.5
RENSSELAER	RENSSELAER	0.77
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.95
WEC	WEC	9.73
Z1-043	Z1-043	35.42

26.12 Index 12

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229179	270927	WILTON ; R	CE	275233	WILTON ;4M	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.55	162.73	DC	33.83

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	15.09
274722	S-055 E	14.02
274772	LINCOLN ;3U	2.74
274773	LINCOLN ;4U	2.74
274774	LINCOLN ;5U	2.74
274775	LINCOLN ;6U	2.74
274776	LINCOLN ;7U	2.74
274777	LINCOLN ;8U	2.74
274788	SE CHICAG;5U	5.56
274789	SE CHICAG;6U	5.56
274790	SE CHICAG;7U	5.56
274791	SE CHICAG;8U	5.56
274792	SE CHICAG;9U	5.52
274793	SE CHICAG;0U	5.52
274794	SE CHICAG;1U	5.52
274795	SE CHICAG;2U	5.52
274859	EASYR;U1 E	13.72
274860	EASYR;U2 E	13.72
274888	PILOT HIL;1E	24.06
274890	CAYUG;1U E	20.62
274891	CAYUG;2U E	20.62
275149	KEMPTON ;1E	24.06
290021	O50 E	24.2
290051	GSG-6; E	13.05
290108	LEEDK;1U E	30.31
293061	N-015 E	19.81
293516	O-009 E1	2.14
293517	O-009 E2	1.09
293518	O-009 E3	1.2
293644	O22 E1	12.79
293645	O22 E2	24.84
293715	O-029 E	12.21
293716	O-029 E	6.69
293717	O-029 E	6.15
294392	P-010 E	25.16
294763	P-046 E	11.7
295109	WESTBROOK E	6.98
295111	SUBLETTE E	3.24
296125	R-030 C3	5.07
296128	R-030 E3	20.29
296271	R-030 C2	5.01
296272	R-030 E2	20.05

Bus #	Bus	MW Impact
296308	R-030 C1	5.01
296309	R-030 E1	20.05
910542	X3-005 E	0.91
914641	Y2-103	56.07
915011	Y3-013 1	4.67
915021	Y3-013 2	4.67
915031	Y3-013 3	4.67
916221	Z1-073 E	6.73
916502	Z1-106 E1	1.58
916504	Z1-106 E2	1.58
916512	Z1-107 E	3.23
916522	Z1-108 E	3.1
917502	Z2-087 E	26.23
918052	AA1-018 E	20.53
919221	AA1-146	21.95
919581	AA2-030	21.95
920272	AA2-123 E	3.05
924041	AB2-047 C O1	4.84
924042	AB2-047 E O1	32.36
924471	AB2-096	52.83
925161	AB2-173	3.91
925302	AB2-191 E	1.73
926311	AC1-109 1	2.39
926321	AC1-109 2	2.39
926331	AC1-110 1	2.37
926341	AC1-110 2	2.37
926351	AC1-111 1	0.95
926361	AC1-111 2	0.95
926371	AC1-111 3	0.95
926381	AC1-111 4	0.95
926391	AC1-111 5	0.95
926401	AC1-111 6	0.95
926431	AC1-114	2.97
926821	AC1-168 C O1	1.46
926822	AC1-168 E O1	9.77
927091	AC1-204 1	90.65
927101	AC1-204 2	90.65
927451	AC1-142A 1	5.22
927461	AC1-142A 2	5.22
927511	AC1-113 1	1.48
927521	AC1-113 2	1.48
927531	AC1-185 1	0.86
927541	AC1-185 2	0.86
927551	AC1-185 3	0.86
927561	AC1-185 4	0.86
927571	AC1-185 5	0.86
927581	AC1-185 6	0.86
927591	AC1-185 7	0.86
927601	AC1-185 8	0.86
930481	AB1-089	82.03
930501	AB1-091 O1	95.74
930741	AB1-122 1O1	91.06

Bus #	Bus	MW Impact
930751	AB1-122 2O1	92.05
932881	AC2-115 1	2.97
932891	AC2-115 2	2.97
932921	AC2-116	1.04
932931	AC2-117	6.65
933341	AC2-147 C	1.09
933342	AC2-147 E	1.78
933411	AC2-154 C	3.27
933412	AC2-154 E	5.33
933431	AC2-156 C O1	1.19
933432	AC2-156 E O1	1.95
933911	AD1-013 C	2.3
933912	AD1-013 E	3.67
933931	AD1-016 C	1.16
933932	AD1-016 E	1.89
934101	AD1-039 1	8.92
934111	AD1-039 2	9.02
934401	AD1-064 C O1	4.0
934402	AD1-064 E O1	18.72
934431	AD1-067 C	0.16
934432	AD1-067 E	0.69
934651	AD1-096 C	1.11
934652	AD1-096 E	1.81
934701	AD1-098 C O1	8.59
934702	AD1-098 E O1	6.27
934721	AD1-100 C	29.97
934722	AD1-100 E	139.86
934871	AD1-116 C	1.2
934872	AD1-116 E	1.95
934971	AD1-129 C	1.13
934972	AD1-129 E	0.75
935001	AD1-133 C O1	27.93
935002	AD1-133 E O1	18.62
936291	AD2-038 C O1	2.94
936292	AD2-038 E O1	19.66
936371	AD2-047 C O1	2.92
936372	AD2-047 E O1	31.46
936461	AD2-060	3.44
936511	AD2-066 C O1	10.56
936512	AD2-066 E O1	7.04
936781	AD2-101 C	5.94
936782	AD2-101 E	27.83
936791	AD2-102 C	14.99
936792	AD2-102 E	14.41
937001	AD2-134 C	3.41
937002	AD2-134 E	14.09
937031	AD2-137 C O1	7.3
937032	AD2-137 E O1	34.17
937051	AD2-140 C O1	7.67
937052	AD2-140 E O1	35.89
937061	AD2-141 C O1	7.62
937062	AD2-141 E O1	35.93

Bus #	Bus	MW Impact
937071	AD2-142 C O1	15.33
937072	AD2-142 E O1	71.78
937121	AD2-148 C O1	4.6
937122	AD2-148 E O1	21.53
937131	AD2-149 C O1	4.6
937132	AD2-149 E O1	21.53
937141	AD2-150 C O1	4.6
937142	AD2-150 E O1	21.53
937181	AD2-155 C O1	4.6
937182	AD2-155 E O1	21.53
937311	AD2-172 C	3.07
937312	AD2-172 E	4.24
937321	AD2-175 C	21.43
937322	AD2-175 E	14.28
937331	AD2-176 C O1	9.15
937332	AD2-176 E O1	6.1
937401	AD2-194 1	9.75
937411	AD2-194 2	9.75
938012	AE1-002 E O1	14.65
938511	AE1-070 1	11.45
938521	AE1-070 2	10.48
938851	AE1-113 C O1	10.95
938852	AE1-113 E O1	34.43
938861	AE1-114 C O1	4.49
938862	AE1-114 E O1	17.15
939051	AE1-134 1	1.71
939061	AE1-134 2	1.71
939321	AE1-163 C O1	7.38
939322	AE1-163 E O1	45.35
939351	AE1-166 C O1	14.79
939352	AE1-166 E O1	13.65
939401	AE1-172 C O1	9.69
939402	AE1-172 E O1	45.37
939691	AE1-199	2.98
939701	AE1-201 C	2.5
939702	AE1-201 E	0.55
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.7
939742	AE1-205 E O1	17.54
939861	AE1-222 1	100.56
939871	AE1-222 2	101.66
939921	AE1-228 C O1	12.54
939922	AE1-228 E O1	8.36
940101	AE1-252 C O1	16.52
940102	AE1-252 E O1	11.01
940501	AE2-035 C	3.07
940502	AE2-035 E	4.24
940621	AE2-049 C O2	11.86
940622	AE2-049 E O2	7.91
940631	AE2-050 C O2	15.89
940632	AE2-050 E O2	10.59
940752	AE2-062 E	0.16

Bus #	Bus	MW Impact
940762	AE2-063 E	0.16
940881	AE2-077 C	3.93
940882	AE2-077 E	6.42
941131	AE2-107 C	9.11
941132	AE2-107 E	6.07
941551	AE2-152 C O2	15.03
941552	AE2-152 E O2	10.02
941561	AE2-153 C O2	5.95
941562	AE2-153 E O2	27.87
941731	AE2-173	7.58
942111	AE2-223 C	2.94
942112	AE2-223 E	19.67
942421	AE2-255 C O2	3.75
942422	AE2-255 E O2	11.25
942651	AE2-281 C	1.05
942652	AE2-281 E	6.48
942881	AE2-307 C	29.12
942882	AE2-307 E	10.59
942911	AE2-310 C	11.52
942912	AE2-310 E	3.11
942991	AE2-321 C O2	10.21
942992	AE2-321 E O2	5.03
943121	AE2-341 C	15.94
943122	AE2-341 E	7.83
BLUEG	BLUEG	8.19
CALDERWOOD	CALDERWOOD	0.12
CANNELTON	CANNELTON	0.1
CARR	CARR	0.99
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.75
CBM-W1	CBM-W1	38.13
CBM-W2	CBM-W2	72.18
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.04
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.79
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.76
MEC	MEC	47.42
O-066	O-066	17.87
RENSSELAER	RENSSELAER	0.78
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.97
WEC	WEC	9.94
Z1-043	Z1-043	36.17

26.13 Index 13

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
8772264	271567	GOOSE LK ; R	CE	271785	GOOSE LK ;RT	CE	1	COMED_P4_012-45-BT5-6__	breaker	449.0	100.71	101.97	DC	12.49

Bus #	Bus	MW Impact
274658	DRESDEN ;2U	12.59
274836	EQUISTAR ; R	2.4
290021	O50 E	10.07
904211	W3-135	0.17
916512	Z1-107 E	1.98
930751	AB1-122 2O1	64.77
934111	AD1-039 2	6.35
936511	AD2-066 C O1	10.48
936512	AD2-066 E O1	6.98
938851	AE1-113 C O1	4.56
938852	AE1-113 E O1	14.33
939871	AE1-222 2	71.53
941551	AE2-152 C O2	9.69
941552	AE2-152 E O2	6.46
941561	AE2-153 C O2	2.2
941562	AE2-153 E O2	10.29
BLUEG	BLUEG	0.38
CANNELTON	CANNELTON	0.0
CARR	CARR	0.04
CATAWBA	CATAWBA	0.01
CBM-S1	CBM-S1	0.24
CBM-W1	CBM-W1	2.03
CBM-W2	CBM-W2	5.71
G-007	G-007	0.12
GIBSON	GIBSON	0.0
HAMLET	HAMLET	0.02
MEC	MEC	3.88
O-066	O-066	0.75
RENSSELAER	RENSSELAER	0.03
TRIMBLE	TRIMBLE	0.05
WEC	WEC	0.35
Z1-043	Z1-043	9.7

26.14 Index 14

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229198	274750	CRETE EC;BP	CE	255112	17STJOHN	NIPS	1	COMED_P4_112-65-BT3-4__	breaker	1399.0	159.15	159.26	DC	24.74

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	12.6
274654	BRAIDWOOD;1U	21.49
274655	BRAIDWOOD;2U	20.56
274661	LASCO STA;2U	19.66
274687	WILL CNTY;4U	8.96
274704	KENDALL ;1C	3.15
274705	KENDALL ;1S	2.1
274706	KENDALL ;2C	3.15
274707	KENDALL ;2S	2.1
274722	S-055 E	11.8
274751	CRETE EC ;1U	4.57
274752	CRETE EC ;2U	4.57
274753	CRETE EC ;3U	4.57
274754	CRETE EC ;4U	4.57
274859	EASYR;U1 E	11.39
274860	EASYR;U2 E	11.39
274861	TOP CROP ;1U	0.37
274862	TOP CROP ;2U	0.72
274888	PILOT HIL;1E	16.93
275149	KEMPTON ;1E	16.93
290021	O50 E	20.58
290051	GSG-6; E	10.83
290108	LEEDK;1U E	25.18
293061	N-015 E	16.29
293644	O22 E1	12.24
293645	O22 E2	23.75
294392	P-010 E	20.68
294763	P-046 E	9.73
295109	WESTBROOK E	5.8
295111	SUBLETTE E	2.68
914641	Y2-103	47.2
915011	Y3-013 1	3.93
915021	Y3-013 2	3.93
915031	Y3-013 3	3.93
916221	Z1-073 E	5.59
916502	Z1-106 E1	1.32
916504	Z1-106 E2	1.32
916512	Z1-107 E	2.53
916522	Z1-108 E	2.6
918052	AA1-018 E	16.03
920272	AA2-123 E	2.55
924471	AB2-096	44.11

Bus #	Bus	MW Impact
925302	AB2-191 E	1.43
926311	AC1-109 1	1.98
926321	AC1-109 2	1.98
926331	AC1-110 1	1.98
926341	AC1-110 2	1.98
926351	AC1-111 1	0.79
926361	AC1-111 2	0.79
926371	AC1-111 3	0.79
926381	AC1-111 4	0.79
926391	AC1-111 5	0.79
926401	AC1-111 6	0.79
926431	AC1-114	2.47
927091	AC1-204 1	77.64
927101	AC1-204 2	77.51
927451	AC1-142A 1	4.49
927461	AC1-142A 2	4.5
927511	AC1-113 1	1.24
927521	AC1-113 2	1.24
927531	AC1-185 1	0.71
927541	AC1-185 2	0.71
927551	AC1-185 3	0.71
927561	AC1-185 4	0.71
927571	AC1-185 5	0.71
927581	AC1-185 6	0.71
927591	AC1-185 7	0.71
927601	AC1-185 8	0.71
930481	AB1-089	68.38
930501	AB1-091 O1	66.72
930741	AB1-122 1O1	73.97
930751	AB1-122 2O1	79.17
932881	AC2-115 1	2.47
932891	AC2-115 2	2.47
932921	AC2-116	0.87
933341	AC2-147 C	0.9
933342	AC2-147 E	1.47
933411	AC2-154 C	2.3
933412	AC2-154 E	3.75
933431	AC2-156 C O1	0.99
933432	AC2-156 E O1	1.61
933911	AD1-013 C	1.91
933912	AD1-013 E	3.05
933931	AD1-016 C	0.97
933932	AD1-016 E	1.58
934101	AD1-039 1	7.25
934111	AD1-039 2	7.76
934401	AD1-064 C O1	3.34
934402	AD1-064 E O1	15.62
934431	AD1-067 C	0.14
934432	AD1-067 E	0.57
934651	AD1-096 C	0.93
934652	AD1-096 E	1.51
934701	AD1-098 C O1	7.13

Bus #	Bus	MW Impact
934702	AD1-098 E O1	5.2
934721	AD1-100 C	19.74
934722	AD1-100 E	92.14
934871	AD1-116 C	0.93
934872	AD1-116 E	1.52
934971	AD1-129 C	0.94
934972	AD1-129 E	0.63
935001	AD1-133 C O1	21.07
935002	AD1-133 E O1	14.05
936291	AD2-038 C O1	2.38
936292	AD2-038 E O1	15.91
936371	AD2-047 C O1	2.06
936372	AD2-047 E O1	22.14
936461	AD2-060	2.42
936511	AD2-066 C O1	8.62
936512	AD2-066 E O1	5.75
936791	AD2-102 C	12.5
936792	AD2-102 E	12.01
937001	AD2-134 C	2.83
937002	AD2-134 E	11.69
937031	AD2-137 C O1	3.3
937032	AD2-137 E O1	15.45
937051	AD2-140 C O1	3.28
937052	AD2-140 E O1	15.37
937061	AD2-141 C O1	3.26
937062	AD2-141 E O1	15.39
937071	AD2-142 C O1	6.57
937072	AD2-142 E O1	30.74
937121	AD2-148 C O1	3.2
937122	AD2-148 E O1	15.0
937131	AD2-149 C O1	3.2
937132	AD2-149 E O1	15.0
937141	AD2-150 C O1	3.2
937142	AD2-150 E O1	15.0
937181	AD2-155 C O1	3.2
937182	AD2-155 E O1	15.0
937311	AD2-172 C	2.55
937312	AD2-172 E	3.53
937321	AD2-175 C	14.93
937322	AD2-175 E	9.95
937331	AD2-176 C O1	7.64
937332	AD2-176 E O1	5.1
937401	AD2-194 1	8.35
937411	AD2-194 2	8.34
938012	AE1-002 E O1	6.62
938511	AE1-070 1	9.81
938521	AE1-070 2	8.96
938851	AE1-113 C O1	9.31
938852	AE1-113 E O1	29.27
938861	AE1-114 C O1	3.73
938862	AE1-114 E O1	14.25
939051	AE1-134 1	1.26

Bus #	Bus	MW Impact
939061	AE1-134 2	1.26
939321	AE1-163 C O1	5.98
939322	AE1-163 E O1	36.71
939351	AE1-166 C O1	10.57
939352	AE1-166 E O1	9.75
939401	AE1-172 C O1	6.17
939402	AE1-172 E O1	28.89
939641	AE1-194 C	32.42
939642	AE1-194 E	216.99
939651	AE1-195 C	32.42
939652	AE1-195 E	216.99
939691	AE1-199	2.48
939701	AE1-201 C	2.09
939702	AE1-201 E	0.46
939732	AE1-204 E	0.31
939861	AE1-222 1	81.69
939871	AE1-222 2	87.43
939921	AE1-228 C O1	10.41
939922	AE1-228 E O1	6.94
940101	AE1-252 C O1	10.52
940102	AE1-252 E O1	7.01
940501	AE2-035 C	2.55
940502	AE2-035 E	3.53
940621	AE2-049 C O2	8.35
940622	AE2-049 E O2	5.56
940631	AE2-050 C O2	13.16
940632	AE2-050 E O2	8.77
940752	AE2-062 E	0.14
940762	AE2-063 E	0.14
940881	AE2-077 C	3.28
940882	AE2-077 E	5.34
941131	AE2-107 C	7.57
941132	AE2-107 E	5.05
941551	AE2-152 C O2	11.32
941552	AE2-152 E O2	7.54
941561	AE2-153 C O2	4.35
941562	AE2-153 E O2	20.38
942421	AE2-255 C O2	3.05
942422	AE2-255 E O2	9.14
942651	AE2-281 C	0.85
942652	AE2-281 E	5.24
942881	AE2-307 C	24.12
942882	AE2-307 E	8.77
942911	AE2-310 C	8.1
942912	AE2-310 E	2.19
942991	AE2-321 C O2	8.54
942992	AE2-321 E O2	4.2
943121	AE2-341 C	13.2
943122	AE2-341 E	6.48
BLUEG	BLUEG	7.64
CALDERWOOD	CALDERWOOD	0.17
CANNELTON	CANNELTON	0.19

Bus #	Bus	MW Impact
CARR	CARR	0.81
CATAWBA	CATAWBA	0.35
CBM-S1	CBM-S1	0.73
CBM-W1	CBM-W1	25.9
CBM-W2	CBM-W2	49.59
CHEOAH	CHEOAH	0.17
CHILHOWEE	CHILHOWEE	0.05
ELMERSMITH	ELMERSMITH	0.26
G-007	G-007	2.27
GIBSON	GIBSON	0.12
HAMLET	HAMLET	0.65
MEC	MEC	38.3
O-066	O-066	14.57
RENSSELAER	RENSSELAER	0.64
SANTEETLA	SANTEETLA	0.05
TRIMBLE	TRIMBLE	0.89
WEC	WEC	8.33
Z1-043	Z1-043	29.27

26.15 Index 15

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
1542057	274804	UNIV PK N;RP	CE	243229	05OLIVE	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	971.0	138.54	138.75	DC	21.15

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	9.77
274722	S-055 E	9.13
274808	UNIV PK N;4U	1.28
274809	UNIV PK N;5U	1.28
274811	UNIV PK N;7U	1.28
274812	UNIV PK N;8U	1.28
274814	UNIV PK N;0U	1.28
274815	UNIV PK N;XU	1.28
274832	U4-027	8.59
274859	EASYR;U1 E	8.82
274860	EASYR;U2 E	8.82
274888	PILOT HIL;1E	14.83
274890	CAYUG;1U E	10.67
274891	CAYUG;2U E	10.67
275149	KEMPTON ;1E	14.83
290021	O50 E	15.58
290051	GSG-6; E	8.41
290108	LEEDK;1U E	19.56
293061	N-015 E	12.57
293516	O-009 E1	7.24
293517	O-009 E2	3.68
293518	O-009 E3	4.05
293644	O22 E1	7.86
293645	O22 E2	15.26
293715	O-029 E	7.82
293716	O-029 E	4.29
293717	O-029 E	3.94
293771	O-035 E	5.08
294392	P-010 E	15.97
294401	BSHIL;1U E	6.79
294410	BSHIL;2U E	6.79
294763	P-046 E	7.54
295109	WESTBROOK E	4.5
295111	SUBLETTE E	2.08
910542	X3-005 E	0.51
914641	Y2-103	36.51
915011	Y3-013 1	3.04
915021	Y3-013 2	3.04
915031	Y3-013 3	3.04
916211	Z1-072 E	3.84
916221	Z1-073 E	4.34

Bus #	Bus	MW Impact
916502	Z1-106 E1	1.02
916504	Z1-106 E2	1.02
916512	Z1-107 E	2.17
916522	Z1-108 E	2.01
918052	AA1-018 E	14.26
919221	AA1-146	14.08
919581	AA2-030	14.08
919621	AA2-039 C	1.65
919622	AA2-039 E	11.07
920272	AA2-123 E	1.98
924471	AB2-096	34.19
925161	AB2-173	2.51
925302	AB2-191 E	1.11
925581	AC1-033 C	1.11
925582	AC1-033 E	7.44
926311	AC1-109 1	1.55
926321	AC1-109 2	1.55
926331	AC1-110 1	1.53
926341	AC1-110 2	1.53
926351	AC1-111 1	0.62
926361	AC1-111 2	0.62
926371	AC1-111 3	0.62
926381	AC1-111 4	0.62
926391	AC1-111 5	0.62
926401	AC1-111 6	0.62
926431	AC1-114	1.92
926821	AC1-168 C O1	0.92
926822	AC1-168 E O1	6.16
927091	AC1-204 1	59.05
927101	AC1-204 2	59.09
927201	AC1-214 C O1	1.63
927202	AC1-214 E O1	5.18
927451	AC1-142A 1	3.45
927461	AC1-142A 2	3.44
927511	AC1-113 1	0.96
927521	AC1-113 2	0.96
927531	AC1-185 1	0.55
927541	AC1-185 2	0.55
927551	AC1-185 3	0.55
927561	AC1-185 4	0.55
927571	AC1-185 5	0.55
927581	AC1-185 6	0.55
927591	AC1-185 7	0.55
927601	AC1-185 8	0.55
930481	AB1-089	52.99
930501	AB1-091 O1	57.0
930741	AB1-122 1O1	58.08
930751	AB1-122 2O1	59.56
932881	AC2-115 1	1.92
932891	AC2-115 2	1.92
932921	AC2-116	0.67
932931	AC2-117	10.38

Bus #	Bus	MW Impact
933341	AC2-147 C	0.7
933342	AC2-147 E	1.14
933411	AC2-154 C	2.01
933412	AC2-154 E	3.28
933431	AC2-156 C O1	0.77
933432	AC2-156 E O1	1.26
933911	AD1-013 C	1.48
933912	AD1-013 E	2.37
933931	AD1-016 C	0.75
933932	AD1-016 E	1.22
934051	AD1-031 C O1	2.26
934052	AD1-031 E O1	3.68
934101	AD1-039 1	5.69
934111	AD1-039 2	5.84
934401	AD1-064 C O1	2.59
934402	AD1-064 E O1	12.1
934431	AD1-067 C	0.11
934432	AD1-067 E	0.44
934651	AD1-096 C	0.72
934652	AD1-096 E	1.17
934701	AD1-098 C O1	5.53
934702	AD1-098 E O1	4.04
934721	AD1-100 C	15.54
934722	AD1-100 E	72.54
934871	AD1-116 C	0.83
934872	AD1-116 E	1.36
934971	AD1-129 C	0.73
934972	AD1-129 E	0.49
935001	AD1-133 C O1	16.63
935002	AD1-133 E O1	11.09
936291	AD2-038 C O1	1.97
936292	AD2-038 E O1	13.16
936371	AD2-047 C O1	1.8
936372	AD2-047 E O1	19.38
936461	AD2-060	2.12
936511	AD2-066 C O1	6.81
936512	AD2-066 E O1	4.54
936781	AD2-101 C	3.5
936782	AD2-101 E	16.38
936791	AD2-102 C	9.68
936792	AD2-102 E	9.3
937001	AD2-134 C	2.2
937002	AD2-134 E	9.08
937031	AD2-137 C O1	2.69
937032	AD2-137 E O1	12.58
937051	AD2-140 C O1	2.69
937052	AD2-140 E O1	12.58
937061	AD2-141 C O1	2.67
937062	AD2-141 E O1	12.6
937071	AD2-142 C O1	5.38
937072	AD2-142 E O1	25.17
937121	AD2-148 C O1	2.74

Bus #	Bus	MW Impact
937122	AD2-148 E O1	12.81
937131	AD2-149 C O1	2.74
937132	AD2-149 E O1	12.81
937141	AD2-150 C O1	2.74
937142	AD2-150 E O1	12.81
937181	AD2-155 C O1	2.74
937182	AD2-155 E O1	12.81
937311	AD2-172 C	1.98
937312	AD2-172 E	2.73
937321	AD2-175 C	12.74
937322	AD2-175 E	8.5
937331	AD2-176 C O1	5.92
937332	AD2-176 E O1	3.95
937401	AD2-194 1	6.35
937411	AD2-194 2	6.35
937531	AD2-214 C	3.52
937532	AD2-214 E	1.66
938012	AE1-002 E O1	5.39
938511	AE1-070 1	7.46
938521	AE1-070 2	6.83
938851	AE1-113 C O1	7.05
938852	AE1-113 E O1	22.17
938861	AE1-114 C O1	2.89
938862	AE1-114 E O1	11.04
939051	AE1-134 1	1.09
939061	AE1-134 2	1.09
939321	AE1-163 C O1	4.94
939322	AE1-163 E O1	30.35
939351	AE1-166 C O1	8.26
939352	AE1-166 E O1	7.63
939401	AE1-172 C O1	4.9
939402	AE1-172 E O1	22.92
939631	AE1-193 C O1	5.51
939632	AE1-193 E O1	36.9
939681	AE1-198 C O1	16.37
939682	AE1-198 E O1	13.91
939691	AE1-199	1.92
939701	AE1-201 C	1.62
939702	AE1-201 E	0.36
939732	AE1-204 E	0.24
939861	AE1-222 1	64.14
939871	AE1-222 2	65.77
939921	AE1-228 C O1	8.09
939922	AE1-228 E O1	5.39
940101	AE1-252 C O1	8.34
940102	AE1-252 E O1	5.56
940501	AE2-035 C	1.98
940502	AE2-035 E	2.73
940621	AE2-049 C O2	7.31
940622	AE2-049 E O2	4.87
940631	AE2-050 C O2	9.99
940632	AE2-050 E O2	6.66

Bus #	Bus	MW Impact
940752	AE2-062 E	0.1
940762	AE2-063 E	0.1
940881	AE2-077 C	2.54
940882	AE2-077 E	4.14
941131	AE2-107 C	5.88
941132	AE2-107 E	3.92
941551	AE2-152 C O2	9.51
941552	AE2-152 E O2	6.34
941561	AE2-153 C O2	3.72
941562	AE2-153 E O2	17.43
942421	AE2-255 C O2	2.5
942422	AE2-255 E O2	7.5
942651	AE2-281 C	0.71
942652	AE2-281 E	4.34
942881	AE2-307 C	18.31
942882	AE2-307 E	6.66
942911	AE2-310 C	7.09
942912	AE2-310 E	1.92
942991	AE2-321 C O2	6.62
942992	AE2-321 E O2	3.26
943121	AE2-341 C	10.31
943122	AE2-341 E	5.06
990901	L-005 E	8.02
BLUEG	BLUEG	4.51
CALDERWOOD	CALDERWOOD	0.06
CANNELTON	CANNELTON	0.07
CARR	CARR	0.62
CATAWBA	CATAWBA	0.24
CBM-S1	CBM-S1	1.13
CBM-W1	CBM-W1	21.91
CBM-W2	CBM-W2	42.89
CHEOAH	CHEOAH	0.06
CHILHOWEE	CHILHOWEE	0.02
ELMERSMITH	ELMERSMITH	0.07
G-007	G-007	1.74
GIBSON	GIBSON	0.03
HAMLET	HAMLET	0.45
MEC	MEC	29.98
O-066	O-066	11.15
RENSSELAER	RENSSELAER	0.49
SANTEETLA	SANTEETLA	0.02
TRIMBLE	TRIMBLE	0.53
WEC	WEC	6.45
Z1-043	Z1-043	22.8

26.16 Index 16

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229175	275232	WILTON ;3M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT5-6__	breaker	1379.0	162.83	162.99	DC	33.13

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	14.78
274722	S-055 E	13.73
274772	LINCOLN ;3U	2.67
274773	LINCOLN ;4U	2.67
274774	LINCOLN ;5U	2.67
274775	LINCOLN ;6U	2.67
274776	LINCOLN ;7U	2.67
274777	LINCOLN ;8U	2.67
274788	SE CHICAG;5U	5.44
274789	SE CHICAG;6U	5.44
274790	SE CHICAG;7U	5.44
274791	SE CHICAG;8U	5.44
274792	SE CHICAG;9U	5.4
274793	SE CHICAG;0U	5.4
274794	SE CHICAG;1U	5.4
274795	SE CHICAG;2U	5.4
274859	EASYR;U1 E	13.43
274860	EASYR;U2 E	13.43
274888	PILOT HIL;1E	23.57
274890	CAYUG;1U E	20.22
274891	CAYUG;2U E	20.22
275149	KEMPTON ;1E	23.57
290021	O50 E	23.7
290051	GSG-6; E	12.77
290108	LEEDK;1U E	29.68
293061	N-015 E	19.41
293644	O22 E1	12.53
293645	O22 E2	24.32
294392	P-010 E	24.65
294763	P-046 E	11.45
295109	WESTBROOK E	6.84
295111	SUBLETTE E	3.17
296125	R-030 C3	4.97
296128	R-030 E3	19.89
296271	R-030 C2	4.91
296272	R-030 E2	19.65
296308	R-030 C1	4.91
296309	R-030 E1	19.65
910542	X3-005 E	0.89
914641	Y2-103	54.9
915011	Y3-013 1	4.58
915021	Y3-013 2	4.58

Bus #	Bus	MW Impact
915031	Y3-013 3	4.58
916221	Z1-073 E	6.59
916502	Z1-106 E1	1.54
916504	Z1-106 E2	1.54
916512	Z1-107 E	3.16
916522	Z1-108 E	3.04
917502	Z2-087 E	25.71
918052	AA1-018 E	20.09
919581	AA2-030	18.9
920272	AA2-123 E	2.99
924041	AB2-047 C O1	4.74
924042	AB2-047 E O1	31.72
924471	AB2-096	51.73
925161	AB2-173	3.83
925302	AB2-191 E	1.69
926311	AC1-109 1	2.34
926321	AC1-109 2	2.34
926331	AC1-110 1	2.32
926341	AC1-110 2	2.32
926351	AC1-111 1	0.93
926361	AC1-111 2	0.93
926371	AC1-111 3	0.93
926381	AC1-111 4	0.93
926391	AC1-111 5	0.93
926401	AC1-111 6	0.93
926431	AC1-114	2.91
926821	AC1-168 C O1	1.43
926822	AC1-168 E O1	9.57
927091	AC1-204 1	88.75
927101	AC1-204 2	88.75
927451	AC1-142A 1	5.11
927461	AC1-142A 2	5.11
927511	AC1-113 1	1.45
927521	AC1-113 2	1.45
927531	AC1-185 1	0.84
927541	AC1-185 2	0.84
927551	AC1-185 3	0.84
927561	AC1-185 4	0.84
927571	AC1-185 5	0.84
927581	AC1-185 6	0.84
927591	AC1-185 7	0.84
927601	AC1-185 8	0.84
930481	AB1-089	80.33
930501	AB1-091 O1	93.8
930741	AB1-122 1O1	89.17
930751	AB1-122 2O1	90.13
932881	AC2-115 1	2.91
932891	AC2-115 2	2.91
932921	AC2-116	1.02
932931	AC2-117	6.51
933341	AC2-147 C	1.07
933342	AC2-147 E	1.74

Bus #	Bus	MW Impact
933411	AC2-154 C	3.2
933412	AC2-154 E	5.22
933431	AC2-156 C O1	1.17
933432	AC2-156 E O1	1.91
933911	AD1-013 C	2.25
933912	AD1-013 E	3.59
933931	AD1-016 C	1.13
933932	AD1-016 E	1.85
934101	AD1-039 1	8.74
934111	AD1-039 2	8.83
934401	AD1-064 C O1	3.91
934402	AD1-064 E O1	18.33
934431	AD1-067 C	0.16
934432	AD1-067 E	0.67
934651	AD1-096 C	1.09
934652	AD1-096 E	1.78
934701	AD1-098 C O1	8.41
934702	AD1-098 E O1	6.14
934721	AD1-100 C	29.39
934722	AD1-100 E	137.14
934871	AD1-116 C	1.17
934872	AD1-116 E	1.91
934971	AD1-129 C	1.1
934972	AD1-129 E	0.74
935001	AD1-133 C O1	27.36
935002	AD1-133 E O1	18.24
936291	AD2-038 C O1	2.88
936292	AD2-038 E O1	19.25
936371	AD2-047 C O1	2.86
936372	AD2-047 E O1	30.81
936461	AD2-060	3.37
936511	AD2-066 C O1	10.34
936512	AD2-066 E O1	6.89
936781	AD2-101 C	5.82
936782	AD2-101 E	27.26
936791	AD2-102 C	14.68
936792	AD2-102 E	14.11
937001	AD2-134 C	3.34
937002	AD2-134 E	13.8
937031	AD2-137 C O1	7.17
937032	AD2-137 E O1	33.55
937051	AD2-140 C O1	7.53
937052	AD2-140 E O1	35.24
937061	AD2-141 C O1	7.48
937062	AD2-141 E O1	35.28
937071	AD2-142 C O1	15.05
937072	AD2-142 E O1	70.48
937121	AD2-148 C O1	4.51
937122	AD2-148 E O1	21.09
937131	AD2-149 C O1	4.51
937132	AD2-149 E O1	21.09
937141	AD2-150 C O1	4.51

Bus #	Bus	MW Impact
937142	AD2-150 E O1	21.09
937181	AD2-155 C O1	4.51
937182	AD2-155 E O1	21.09
937311	AD2-172 C	3.01
937312	AD2-172 E	4.15
937321	AD2-175 C	20.99
937322	AD2-175 E	13.99
937331	AD2-176 C O1	8.96
937332	AD2-176 E O1	5.97
937401	AD2-194 1	9.54
937411	AD2-194 2	9.54
938012	AE1-002 E O1	14.38
938511	AE1-070 1	11.21
938521	AE1-070 2	10.26
938851	AE1-113 C O1	10.72
938852	AE1-113 E O1	33.71
938861	AE1-114 C O1	4.39
938862	AE1-114 E O1	16.8
939051	AE1-134 1	1.67
939061	AE1-134 2	1.67
939321	AE1-163 C O1	7.23
939322	AE1-163 E O1	44.39
939351	AE1-166 C O1	14.5
939352	AE1-166 E O1	13.38
939401	AE1-172 C O1	9.5
939402	AE1-172 E O1	44.49
939691	AE1-199	2.92
939701	AE1-201 C	2.45
939702	AE1-201 E	0.54
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.45
939742	AE1-205 E O1	17.19
939861	AE1-222 1	98.48
939871	AE1-222 2	99.54
939921	AE1-228 C O1	12.28
939922	AE1-228 E O1	8.19
940101	AE1-252 C O1	16.2
940102	AE1-252 E O1	10.8
940501	AE2-035 C	3.01
940502	AE2-035 E	4.15
940621	AE2-049 C O2	11.62
940622	AE2-049 E O2	7.75
940631	AE2-050 C O2	15.56
940632	AE2-050 E O2	10.38
940752	AE2-062 E	0.16
940762	AE2-063 E	0.16
940881	AE2-077 C	3.85
940882	AE2-077 E	6.28
941131	AE2-107 C	8.92
941132	AE2-107 E	5.95
941551	AE2-152 C O2	14.72
941552	AE2-152 E O2	9.81

Bus #	Bus	MW Impact
941561	AE2-153 C O2	5.83
941562	AE2-153 E O2	27.3
941731	AE2-173	7.43
942111	AE2-223 C	2.88
942112	AE2-223 E	19.28
942421	AE2-255 C O2	3.67
942422	AE2-255 E O2	11.02
942651	AE2-281 C	1.03
942652	AE2-281 E	6.34
942881	AE2-307 C	28.54
942882	AE2-307 E	10.38
942911	AE2-310 C	11.28
942912	AE2-310 E	3.05
942991	AE2-321 C O2	10.0
942992	AE2-321 E O2	4.93
943121	AE2-341 C	15.61
943122	AE2-341 E	7.67
BLUEG	BLUEG	8.01
CALDERWOOD	CALDERWOOD	0.11
CANNELTON	CANNELTON	0.1
CARR	CARR	0.97
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.72
CBM-W1	CBM-W1	37.34
CBM-W2	CBM-W2	70.72
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.03
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.73
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.74
MEC	MEC	46.44
O-066	O-066	17.5
RENSSELAER	RENSSELAER	0.77
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.95
WEC	WEC	9.73
Z1-043	Z1-043	35.42

26.17 Index 17

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
2229181	275233	WILTON ;4M	CE	270644	WILTON ;	CE	1	COMED_P4_112-65-BT2-3__	breaker	1379.0	162.55	162.73	DC	33.83

Bus #	Bus	MW Impact
270859	PWR VTR EC;R	15.09
274722	S-055 E	14.02
274772	LINCOLN ;3U	2.74
274773	LINCOLN ;4U	2.74
274774	LINCOLN ;5U	2.74
274775	LINCOLN ;6U	2.74
274776	LINCOLN ;7U	2.74
274777	LINCOLN ;8U	2.74
274788	SE CHICAG;5U	5.56
274789	SE CHICAG;6U	5.56
274790	SE CHICAG;7U	5.56
274791	SE CHICAG;8U	5.56
274792	SE CHICAG;9U	5.52
274793	SE CHICAG;0U	5.52
274794	SE CHICAG;1U	5.52
274795	SE CHICAG;2U	5.52
274859	EASYR;U1 E	13.72
274860	EASYR;U2 E	13.72
274888	PILOT HIL;1E	24.06
274890	CAYUG;1U E	20.62
274891	CAYUG;2U E	20.62
275149	KEMPTON ;1E	24.06
290021	O50 E	24.2
290051	GSG-6; E	13.05
290108	LEEDK;1U E	30.31
293061	N-015 E	19.81
293516	O-009 E1	2.14
293517	O-009 E2	1.09
293518	O-009 E3	1.2
293644	O22 E1	12.79
293645	O22 E2	24.84
293715	O-029 E	12.21
293716	O-029 E	6.69
293717	O-029 E	6.15
294392	P-010 E	25.16
294763	P-046 E	11.7
295109	WESTBROOK E	6.98
295111	SUBLETTE E	3.24
296125	R-030 C3	5.07
296128	R-030 E3	20.29
296271	R-030 C2	5.01
296272	R-030 E2	20.05

Bus #	Bus	MW Impact
296308	R-030 C1	5.01
296309	R-030 E1	20.05
910542	X3-005 E	0.91
914641	Y2-103	56.07
915011	Y3-013 1	4.67
915021	Y3-013 2	4.67
915031	Y3-013 3	4.67
916221	Z1-073 E	6.73
916502	Z1-106 E1	1.58
916504	Z1-106 E2	1.58
916512	Z1-107 E	3.23
916522	Z1-108 E	3.1
917502	Z2-087 E	26.23
918052	AA1-018 E	20.53
919221	AA1-146	21.95
919581	AA2-030	21.95
920272	AA2-123 E	3.05
924041	AB2-047 C O1	4.84
924042	AB2-047 E O1	32.36
924471	AB2-096	52.83
925161	AB2-173	3.91
925302	AB2-191 E	1.73
926311	AC1-109 1	2.39
926321	AC1-109 2	2.39
926331	AC1-110 1	2.37
926341	AC1-110 2	2.37
926351	AC1-111 1	0.95
926361	AC1-111 2	0.95
926371	AC1-111 3	0.95
926381	AC1-111 4	0.95
926391	AC1-111 5	0.95
926401	AC1-111 6	0.95
926431	AC1-114	2.97
926821	AC1-168 C O1	1.46
926822	AC1-168 E O1	9.77
927091	AC1-204 1	90.65
927101	AC1-204 2	90.65
927451	AC1-142A 1	5.22
927461	AC1-142A 2	5.22
927511	AC1-113 1	1.48
927521	AC1-113 2	1.48
927531	AC1-185 1	0.86
927541	AC1-185 2	0.86
927551	AC1-185 3	0.86
927561	AC1-185 4	0.86
927571	AC1-185 5	0.86
927581	AC1-185 6	0.86
927591	AC1-185 7	0.86
927601	AC1-185 8	0.86
930481	AB1-089	82.03
930501	AB1-091 O1	95.74
930741	AB1-122 1O1	91.06

Bus #	Bus	MW Impact
930751	AB1-122 2O1	92.05
932881	AC2-115 1	2.97
932891	AC2-115 2	2.97
932921	AC2-116	1.04
932931	AC2-117	6.65
933341	AC2-147 C	1.09
933342	AC2-147 E	1.78
933411	AC2-154 C	3.27
933412	AC2-154 E	5.33
933431	AC2-156 C O1	1.19
933432	AC2-156 E O1	1.95
933911	AD1-013 C	2.3
933912	AD1-013 E	3.67
933931	AD1-016 C	1.16
933932	AD1-016 E	1.89
934101	AD1-039 1	8.92
934111	AD1-039 2	9.02
934401	AD1-064 C O1	4.0
934402	AD1-064 E O1	18.72
934431	AD1-067 C	0.16
934432	AD1-067 E	0.69
934651	AD1-096 C	1.11
934652	AD1-096 E	1.81
934701	AD1-098 C O1	8.59
934702	AD1-098 E O1	6.27
934721	AD1-100 C	29.97
934722	AD1-100 E	139.86
934871	AD1-116 C	1.2
934872	AD1-116 E	1.95
934971	AD1-129 C	1.13
934972	AD1-129 E	0.75
935001	AD1-133 C O1	27.93
935002	AD1-133 E O1	18.62
936291	AD2-038 C O1	2.94
936292	AD2-038 E O1	19.66
936371	AD2-047 C O1	2.92
936372	AD2-047 E O1	31.46
936461	AD2-060	3.44
936511	AD2-066 C O1	10.56
936512	AD2-066 E O1	7.04
936781	AD2-101 C	5.94
936782	AD2-101 E	27.83
936791	AD2-102 C	14.99
936792	AD2-102 E	14.41
937001	AD2-134 C	3.41
937002	AD2-134 E	14.09
937031	AD2-137 C O1	7.3
937032	AD2-137 E O1	34.17
937051	AD2-140 C O1	7.67
937052	AD2-140 E O1	35.89
937061	AD2-141 C O1	7.62
937062	AD2-141 E O1	35.93

Bus #	Bus	MW Impact
937071	AD2-142 C O1	15.33
937072	AD2-142 E O1	71.78
937121	AD2-148 C O1	4.6
937122	AD2-148 E O1	21.53
937131	AD2-149 C O1	4.6
937132	AD2-149 E O1	21.53
937141	AD2-150 C O1	4.6
937142	AD2-150 E O1	21.53
937181	AD2-155 C O1	4.6
937182	AD2-155 E O1	21.53
937311	AD2-172 C	3.07
937312	AD2-172 E	4.24
937321	AD2-175 C	21.43
937322	AD2-175 E	14.28
937331	AD2-176 C O1	9.15
937332	AD2-176 E O1	6.1
937401	AD2-194 1	9.75
937411	AD2-194 2	9.75
938012	AE1-002 E O1	14.65
938511	AE1-070 1	11.45
938521	AE1-070 2	10.48
938851	AE1-113 C O1	10.95
938852	AE1-113 E O1	34.43
938861	AE1-114 C O1	4.49
938862	AE1-114 E O1	17.15
939051	AE1-134 1	1.71
939061	AE1-134 2	1.71
939321	AE1-163 C O1	7.38
939322	AE1-163 E O1	45.35
939351	AE1-166 C O1	14.79
939352	AE1-166 E O1	13.65
939401	AE1-172 C O1	9.69
939402	AE1-172 E O1	45.37
939691	AE1-199	2.98
939701	AE1-201 C	2.5
939702	AE1-201 E	0.55
939732	AE1-204 E	0.36
939741	AE1-205 C O1	12.7
939742	AE1-205 E O1	17.54
939861	AE1-222 1	100.56
939871	AE1-222 2	101.66
939921	AE1-228 C O1	12.54
939922	AE1-228 E O1	8.36
940101	AE1-252 C O1	16.52
940102	AE1-252 E O1	11.01
940501	AE2-035 C	3.07
940502	AE2-035 E	4.24
940621	AE2-049 C O2	11.86
940622	AE2-049 E O2	7.91
940631	AE2-050 C O2	15.89
940632	AE2-050 E O2	10.59
940752	AE2-062 E	0.16

Bus #	Bus	MW Impact
940762	AE2-063 E	0.16
940881	AE2-077 C	3.93
940882	AE2-077 E	6.42
941131	AE2-107 C	9.11
941132	AE2-107 E	6.07
941551	AE2-152 C O2	15.03
941552	AE2-152 E O2	10.02
941561	AE2-153 C O2	5.95
941562	AE2-153 E O2	27.87
941731	AE2-173	7.58
942111	AE2-223 C	2.94
942112	AE2-223 E	19.67
942421	AE2-255 C O2	3.75
942422	AE2-255 E O2	11.25
942651	AE2-281 C	1.05
942652	AE2-281 E	6.48
942881	AE2-307 C	29.12
942882	AE2-307 E	10.59
942911	AE2-310 C	11.52
942912	AE2-310 E	3.11
942991	AE2-321 C O2	10.21
942992	AE2-321 E O2	5.03
943121	AE2-341 C	15.94
943122	AE2-341 E	7.83
BLUEG	BLUEG	8.19
CALDERWOOD	CALDERWOOD	0.12
CANNELTON	CANNELTON	0.1
CARR	CARR	0.99
CATAWBA	CATAWBA	0.4
CBM-S1	CBM-S1	1.75
CBM-W1	CBM-W1	38.13
CBM-W2	CBM-W2	72.18
CHEOAH	CHEOAH	0.12
CHILHOWEE	CHILHOWEE	0.04
ELMERSMITH	ELMERSMITH	0.09
G-007	G-007	2.79
GIBSON	GIBSON	0.01
HAMLET	HAMLET	0.76
MEC	MEC	47.42
O-066	O-066	17.87
RENSSELAER	RENSSELAER	0.78
SANTEETLA	SANTEETLA	0.04
TRIMBLE	TRIMBLE	0.97
WEC	WEC	9.94
Z1-043	Z1-043	36.17

26.18 Index 18

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
14557937	934720	AD1-100 TAP	CE	937030	AD2-137 TAP	CE	1	COMED_P7_345-L2001__B-S+_345-L2003__R-S	tower	1846.0	145.97	147.24	DC	23.42

Bus #	Bus	MW Impact
274654	BRAIDWOOD;1U	33.97
274655	BRAIDWOOD;2U	32.44
274660	LASCO STA;1U	21.33
274661	LASCO STA;2U	21.37
274847	GR RIDGE ;BU	0.46
274853	TWINGROVE;U1	0.72
274854	TWINGROVE;U2	0.72
274863	CAYUGA RI;1U	0.94
274864	CAYUGA RI;2U	0.94
274871	GR RIDGE ;2U	0.59
274881	PLEAS RDG;2U	0.62
274887	PILOT HIL;1U	0.62
274888	PILOT HIL;1E	20.33
274890	CAYUG;1U E	31.01
274891	CAYUG;2U E	31.01
275149	KEMPTON ;1E	20.33
276150	W2-048 E	1.39
290261	S-027 E	23.71
290265	S-028 E	23.71
293061	N-015 E	15.16
294392	P-010 E	19.26
296125	R-030 C3	6.08
296128	R-030 E3	24.33
296271	R-030 C2	6.01
296272	R-030 E2	24.04
296308	R-030 C1	6.01
296309	R-030 E1	24.04
905081	W4-005 C	0.7
905082	W4-005 E	38.29
909052	X2-022 E	19.29
917501	Z2-087 C	0.57
917502	Z2-087 E	31.42
924041	AB2-047 C O1	5.77
924042	AB2-047 E O1	38.6
924261	AB2-070 C O1	2.84
924262	AB2-070 E O1	18.99
925771	AC1-053 C	2.79
925772	AC1-053 E	18.64
926821	AC1-168 C O1	0.69
926822	AC1-168 E O1	4.62

Bus #	Bus	MW Impact
930501	AB1-091 O1	92.41
933411	AC2-154 C	2.76
933412	AC2-154 E	4.5
934721	AD1-100 C	51.69
934722	AD1-100 E	241.21
935001	AD1-133 C O1	18.06
935002	AD1-133 E O1	12.04
935141	AD1-148	5.04
936371	AD2-047 C O1	2.47
936372	AD2-047 E O1	26.58
936461	AD2-060	2.9
936771	AD2-100 C O1	10.69
936772	AD2-100 E O1	7.13
936781	AD2-101 C	3.9
936782	AD2-101 E	18.24
936972	AD2-131 E O1	2.25
937121	AD2-148 C O1	4.45
937122	AD2-148 E O1	20.84
937131	AD2-149 C O1	4.45
937132	AD2-149 E O1	20.84
937141	AD2-150 C O1	4.45
937142	AD2-150 E O1	20.84
937161	AD2-153 C O1	3.91
937162	AD2-153 E O1	18.29
937171	AD2-154 C O1	3.91
937172	AD2-154 E O1	18.29
937181	AD2-155 C O1	4.45
937182	AD2-155 E O1	20.84
937211	AD2-159 C	4.14
937212	AD2-159 E	19.37
937321	AD2-175 C	20.73
937322	AD2-175 E	13.82
938012	AE1-002 E O1	28.93
939351	AE1-166 C O1	22.6
939352	AE1-166 E O1	20.86
939401	AE1-172 C O1	15.93
939402	AE1-172 E O1	74.58
939741	AE1-205 C O1	15.3
939742	AE1-205 E O1	21.13
940101	AE1-252 C O1	27.15
940102	AE1-252 E O1	18.1
940621	AE2-049 C O2	10.02
940622	AE2-049 E O2	6.68
940631	AE2-050 C O2	20.77
940632	AE2-050 E O2	13.84
941551	AE2-152 C O2	8.61
941552	AE2-152 E O2	5.74
941561	AE2-153 C O2	4.12
941562	AE2-153 E O2	19.3
941731	AE2-173	9.13
942111	AE2-223 C	3.52
942112	AE2-223 E	23.57

Bus #	Bus	MW Impact
942481	AE2-261 C	13.71
942482	AE2-261 E	9.14
942881	AE2-307 C	38.07
942882	AE2-307 E	13.84
942911	AE2-310 C	9.73
942912	AE2-310 E	2.63
951001	J339	4.12
951741	J474 C	1.79
951742	J474 E	9.69
952321	J734	3.46
953741	J826 C	1.05
953742	J826 E	5.67
954181	J884	9.28
BLUEG	BLUEG	0.29
CARR	CARR	0.29
CATAWBA	CATAWBA	0.01
CBM-S1	CBM-S1	2.5
CBM-W1	CBM-W1	3.98
CBM-W2	CBM-W2	47.18
CIN	CIN	2.43
G-007	G-007	0.8
HAMLET	HAMLET	0.07
IPL	IPL	1.03
MEC	MEC	12.37
O-066	O-066	5.13
RENSSELAER	RENSSELAER	0.23
TRIMBLE	TRIMBLE	0.07
WEC	WEC	0.85
Z1-043	Z1-043	15.21

26.19 Index 19

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
11270908	937030	AD2-137 TAP	CE	270926	WILTON ; B	CE	1	COMED_P7_345-L2001__B-S+_345-L2003__R-S	tower	1846.0	153.5	154.78	DC	23.42

Bus #	Bus	MW Impact
274654	BRAIDWOOD;1U	33.97
274655	BRAIDWOOD;2U	32.44
274660	LASCO STA;1U	21.33
274661	LASCO STA;2U	21.37
274847	GR RIDGE ;BU	0.46
274853	TWINGROVE;U1	0.72
274854	TWINGROVE;U2	0.72
274863	CAYUGA RI;1U	0.94
274864	CAYUGA RI;2U	0.94
274871	GR RIDGE ;2U	0.59
274881	PLEAS RDG;2U	0.62
274887	PILOT HIL;1U	0.62
274888	PILOT HIL;1E	20.33
274890	CAYUG;1U E	31.01
274891	CAYUG;2U E	31.01
275149	KEMPTON ;1E	20.33
276150	W2-048 E	1.39
290261	S-027 E	23.71
290265	S-028 E	23.71
293061	N-015 E	15.16
294392	P-010 E	19.26
296125	R-030 C3	6.08
296128	R-030 E3	24.33
296271	R-030 C2	6.01
296272	R-030 E2	24.04
296308	R-030 C1	6.01
296309	R-030 E1	24.04
905081	W4-005 C	0.7
905082	W4-005 E	38.29
909052	X2-022 E	19.29
917501	Z2-087 C	0.57
917502	Z2-087 E	31.42
924041	AB2-047 C O1	5.77
924042	AB2-047 E O1	38.6
924261	AB2-070 C O1	2.84
924262	AB2-070 E O1	18.99
925771	AC1-053 C	2.79
925772	AC1-053 E	18.64
926821	AC1-168 C O1	0.69
926822	AC1-168 E O1	4.62

Bus #	Bus	MW Impact
930501	AB1-091 O1	92.41
933411	AC2-154 C	2.76
933412	AC2-154 E	4.5
934721	AD1-100 C	51.69
934722	AD1-100 E	241.21
935001	AD1-133 C O1	18.06
935002	AD1-133 E O1	12.04
935141	AD1-148	5.04
936371	AD2-047 C O1	2.47
936372	AD2-047 E O1	26.58
936461	AD2-060	2.9
936771	AD2-100 C O1	10.69
936772	AD2-100 E O1	7.13
936781	AD2-101 C	3.9
936782	AD2-101 E	18.24
936972	AD2-131 E O1	2.25
937031	AD2-137 C O1	18.76
937032	AD2-137 E O1	87.84
937121	AD2-148 C O1	4.45
937122	AD2-148 E O1	20.84
937131	AD2-149 C O1	4.45
937132	AD2-149 E O1	20.84
937141	AD2-150 C O1	4.45
937142	AD2-150 E O1	20.84
937161	AD2-153 C O1	3.91
937162	AD2-153 E O1	18.29
937171	AD2-154 C O1	3.91
937172	AD2-154 E O1	18.29
937181	AD2-155 C O1	4.45
937182	AD2-155 E O1	20.84
937211	AD2-159 C	4.14
937212	AD2-159 E	19.37
937321	AD2-175 C	20.73
937322	AD2-175 E	13.82
938012	AE1-002 E O1	71.07
939351	AE1-166 C O1	22.6
939352	AE1-166 E O1	20.86
939401	AE1-172 C O1	15.93
939402	AE1-172 E O1	74.58
939741	AE1-205 C O1	15.3
939742	AE1-205 E O1	21.13
940101	AE1-252 C O1	27.15
940102	AE1-252 E O1	18.1
940621	AE2-049 C O2	10.02
940622	AE2-049 E O2	6.68
940631	AE2-050 C O2	20.77
940632	AE2-050 E O2	13.84
941551	AE2-152 C O2	8.61
941552	AE2-152 E O2	5.74
941561	AE2-153 C O2	4.12
941562	AE2-153 E O2	19.3
941731	AE2-173	9.13

Bus #	Bus	MW Impact
942111	AE2-223 C	3.52
942112	AE2-223 E	23.57
942481	AE2-261 C	13.71
942482	AE2-261 E	9.14
942881	AE2-307 C	38.07
942882	AE2-307 E	13.84
942911	AE2-310 C	9.73
942912	AE2-310 E	2.63
951741	J474 C	1.79
951742	J474 E	9.69
953741	J826 C	1.05
953742	J826 E	5.67
954181	J884	9.28
BLUEG	BLUEG	0.29
CARR	CARR	0.29
CATAWBA	CATAWBA	0.01
CBM-S1	CBM-S1	2.5
CBM-W1	CBM-W1	3.98
CBM-W2	CBM-W2	47.18
CIN	CIN	2.43
G-007	G-007	0.8
HAMLET	HAMLET	0.07
IPL	IPL	1.03
MEC	MEC	12.37
O-066	O-066	5.13
RENSSELAER	RENSSELAER	0.23
TRIMBLE	TRIMBLE	0.07
WEC	WEC	0.85
Z1-043	Z1-043	15.21

26.20 Index 20

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CKT ID	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	AC DC	MW IMPACT
7078669	938670	AE1-089 TAP	AEP	243219	05DUMONT	AEP	1	AEP_P4_#2978_05DUMONT 765_B	breaker	1409.0	123.64	124.11	DC	14.73

Bus #	Bus	MW Impact
247900	05FR-11G E	6.83
247901	05FR-12G E	6.72
247902	05FR-21G E	7.18
247903	05FR-22G E	6.87
247904	05FR-3G E	13.92
247905	05FR-4G E	10.47
247906	05MDL-1G E	15.59
247907	05MDL-2G E	7.73
247912	05MDL-3G E	8.09
247913	05MDL-4G E	7.81
247943	T-127 E	7.81
274722	S-055 E	6.52
274809	UNIV PK N;5U	0.64
274811	UNIV PK N;7U	0.64
274812	UNIV PK N;8U	0.64
274814	UNIV PK N;0U	0.64
274815	UNIV PK N;XU	0.64
274888	PILOT HIL;1E	10.28
275149	KEMPTON ;1E	10.28
290021	O50 E	11.42
293061	N-015 E	8.93
293644	O22 E1	5.91
293645	O22 E2	11.47
294392	P-010 E	11.34
909145	X2-052	28.77
914641	Y2-103	26.09
915011	Y3-013 1	2.17
915021	Y3-013 2	2.17
915031	Y3-013 3	2.17
916502	Z1-106 E1	0.73
916504	Z1-106 E2	0.73
916512	Z1-107 E	1.49
916522	Z1-108 E	1.44
917711	Z2-114 C	0.05
917712	Z2-114 E	0.39
918052	AA1-018 E	9.77
926311	AC1-109 1	1.1
926321	AC1-109 2	1.1
926331	AC1-110 1	1.09
926341	AC1-110 2	1.09
926351	AC1-111 1	0.44

Bus #	Bus	MW Impact
926361	AC1-111 2	0.44
926371	AC1-111 3	0.44
926381	AC1-111 4	0.44
926391	AC1-111 5	0.44
926401	AC1-111 6	0.44
927091	AC1-204 1	41.76
927101	AC1-204 2	41.77
927451	AC1-142A 1	2.41
927461	AC1-142A 2	2.41
930042	AB1-006 E	16.99
930391	AB1-080	1.7
930501	AB1-091 O1	40.0
930741	AB1-122 1O1	41.85
930751	AB1-122 2O1	42.52
932601	AC2-080 C O1	3.72
932602	AC2-080 E O1	24.87
932931	AC2-117	5.16
933411	AC2-154 C	1.4
933412	AC2-154 E	2.28
933431	AC2-156 C O1	0.55
933432	AC2-156 E O1	0.9
934101	AD1-039 1	4.1
934111	AD1-039 2	4.17
934721	AD1-100 C	11.08
934722	AD1-100 E	51.72
934871	AD1-116 C	0.57
934872	AD1-116 E	0.93
935271	AD1-137 C	5.67
935272	AD1-137 E	37.95
936291	AD2-038 C O1	1.41
936292	AD2-038 E O1	9.4
936371	AD2-047 C O1	1.25
936372	AD2-047 E O1	13.44
936461	AD2-060	1.47
936511	AD2-066 C O1	4.97
936512	AD2-066 E O1	3.32
937031	AD2-137 C O1	1.92
937032	AD2-137 E O1	8.97
937041	AD2-138 C	5.03
937042	AD2-138 E	23.56
937051	AD2-140 C O1	1.91
937052	AD2-140 E O1	8.96
937061	AD2-141 C O1	1.9
937062	AD2-141 E O1	8.97
937071	AD2-142 C O1	3.83
937072	AD2-142 E O1	17.91
937121	AD2-148 C O1	1.92
937122	AD2-148 E O1	8.99
937131	AD2-149 C O1	1.92
937132	AD2-149 E O1	8.99
937141	AD2-150 C O1	1.92
937142	AD2-150 E O1	8.99

Bus #	Bus	MW Impact
937181	AD2-155 C O1	1.92
937182	AD2-155 E O1	8.99
937321	AD2-175 C	8.94
937322	AD2-175 E	5.96
937401	AD2-194 1	4.49
937411	AD2-194 2	4.49
938012	AE1-002 E O1	3.85
938511	AE1-070 1	5.28
938521	AE1-070 2	4.83
938671	AE1-089 C	74.52
938672	AE1-089 E	102.29
938851	AE1-113 C O1	5.17
938852	AE1-113 E O1	16.24
939321	AE1-163 C O1	3.53
939322	AE1-163 E O1	21.69
939351	AE1-166 C O1	5.84
939352	AE1-166 E O1	5.39
939641	AE1-194 C	5.59
939642	AE1-194 E	37.41
939651	AE1-195 C	5.59
939652	AE1-195 E	37.41
939732	AE1-204 E	0.17
939861	AE1-222 1	46.22
939871	AE1-222 2	46.95
940261	AE2-008	45.69
940581	AE2-045 C O2	16.87
940582	AE2-045 E O2	23.16
940621	AE2-049 C O2	5.07
940622	AE2-049 E O2	3.38
940631	AE2-050 C O2	6.94
940632	AE2-050 E O2	4.63
940752	AE2-062 E	0.07
940762	AE2-063 E	0.07
941551	AE2-152 C O2	6.64
941552	AE2-152 E O2	4.43
941561	AE2-153 C O2	2.59
941562	AE2-153 E O2	12.13
941571	AE2-154 C	3.17
941572	AE2-154 E	21.24
942421	AE2-255 C O2	1.79
942422	AE2-255 E O2	5.38
942651	AE2-281 C	0.5
942652	AE2-281 E	3.1
942881	AE2-307 C	12.73
942882	AE2-307 E	4.63
942911	AE2-310 C	4.92
942912	AE2-310 E	1.33
943121	AE2-341 C	7.34
943122	AE2-341 E	3.61
CARR	CARR	0.6
CATAWBA	CATAWBA	0.06
CBM-S1	CBM-S1	4.51

Bus #	Bus	MW Impact
CBM-W1	CBM-W1	19.7
CBM-W2	CBM-W2	68.08
CIN	CIN	6.99
G-007	G-007	1.67
HAMLET	HAMLET	0.18
IPL	IPL	3.24
LGEE	LGEE	0.71
MEC	MEC	25.2
O-066	O-066	10.75
RENSSELAER	RENSSELAER	0.48
WEC	WEC	4.68
Z1-043	Z1-043	17.58

Contingency Name	Contingency Definition
COMED_P7_345-L17704AR-S+_345-L17907TB-S-A	CONTINGENCY 'COMED_P7_345-L17704AR-S+_345-L17907TB-S-A' TRIP BRANCH FROM BUS 270675 TO BUS 270711 CKT 1 / BURNHAM ;1R 345 DAVIS CRK; R 345 TRIP BRANCH FROM BUS 270662 TO BUS 936780 CKT 1 / BLOOM ; B 345 AD2-101 TAP 345 TRIP BRANCH FROM BUS 270662 TO BUS 271098 TO BUS 275258 CKT 1 / BLOOM ; B 345 BLOOM ; B 138 BLOOM ;4C 34.5 END
COMED_P7_345-L6607__B-S+_345-L97008_R-S	CONTINGENCY 'COMED_P7_345-L6607__B-S+_345-L97008_R-S' TRIP BRANCH FROM BUS 270728 TO BUS 274750 CKT 1 / E FRANKFO; B 345 CRETE EC ;BP 345 TRIP BRANCH FROM BUS 274804 TO BUS 243229 CKT 1 / UNIV PK N;RP 345 05OLIVE 345 END
COMED_P1-2_138-L8607__R-S-A	CONTINGENCY 'COMED_P1-2_138-L8607__R-S-A' TRIP BRANCH FROM BUS 271295 TO BUS 941560 CKT 1 / DAVIS; R 138 AE2-153 TAP 138 END
AEP_P1-2_#695A	CONTINGENCY 'AEP_P1-2_#695A' OPEN BRANCH FROM BUS 243206 TO BUS 270644 CKT 1 / 243206 05DUMONT 765 270644 WILTON ; 765 1 END
COMED_P7_345-L94507_B-S+_345-L97008_R-S	CONTINGENCY 'COMED_P7_345-L94507_B-S+_345-L97008_R-S' TRIP BRANCH FROM BUS 274750 TO BUS 255112 CKT 1 / CRETE;BP 345 17STJOHN 345 TRIP BRANCH FROM BUS 274804 TO BUS 243229 CKT 1 / UPNOR;RP 345 05OLIVE 345 END
COMED_P1-2_138-L8607__R-S-C	CONTINGENCY 'COMED_P1-2_138-L8607__R-S-C' TRIP BRANCH FROM BUS 941550 TO BUS 272789 CKT 1 / AE2-152 TAP 138 WILMI; 138 END
COMED_P4_023-65-BT4-5__	CONTINGENCY 'COMED_P4_023-65-BT4-5__' TRIP BRANCH FROM BUS 275168 TO BUS 270607 CKT 1 / COLLI;2M 345 COLLI; 765 TRIP BRANCH FROM BUS 275168 TO BUS 270697 CKT 1 / COLLI;2M 345 COLLI; R 345 TRIP BRANCH FROM BUS 275168 TO BUS 275268 CKT 1 / COLLI;2M 345 COLLI;2C 33 TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 END
COMED_P1-2_765-L2315__S	CONTINGENCY 'COMED_P1-2_765-L2315__S' TRIP BRANCH FROM BUS 270607 TO BUS 270630 CKT 1 / COLLI; 765 PLANO; 765 END
COMED_P1-2_345-L8014__S-B	CONTINGENCY 'COMED_P1-2_345-L8014__S-B' TRIP BRANCH FROM BUS 935000 TO BUS 270717 CKT 1 / AD1-133 TAP 345 DRESDEN ; R 345 END
COMED_P7_345-L2001__B-S+_345-L2003__R-S	CONTINGENCY 'COMED_P7_345-L2001__B-S+_345-L2003__R-S' TRIP BRANCH FROM BUS 270670 TO BUS 270728 CKT 1 / BRAID; B 345 E FRA; B 345 TRIP BRANCH FROM BUS 270728 TO BUS 270766 CKT 1 / E FRA; B 345 GOODI;3B 345 TRIP BRANCH FROM BUS 270728 TO BUS 274750 CKT 1 / E FRA; B 345 CRETE;BP 345 TRIP BRANCH FROM BUS 270671 TO BUS 270729 CKT 1 / BRAID; R 345 E FRA; R 345 END

Contingency Name	Contingency Definition
COMED_P1-2_345-L11212_B-S-A	CONTINGENCY 'COMED_P1-2_345-L11212_B-S-A' TRIP BRANCH FROM BUS 270926 TO BUS 937030 CKT 1 END / WILTO; B 345 AD2-137 TAP 345
COMED_P4_112-65-BT2-3__	CONTINGENCY 'COMED_P4_112-65-BT2-3__' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 / WILTO; 765 COLLI; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270644 CKT 1 / WILTO;3M 345 WILTO; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270926 CKT 1 / WILTO;3M 345 WILTO; B 345 TRIP BRANCH FROM BUS 275232 TO BUS 275332 CKT 1 / WILTO;3M 345 WILTO;3C 33 END
COMED_P4_112-65-BT3-4__	CONTINGENCY 'COMED_P4_112-65-BT3-4__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 275232 TO BUS 270644 CKT 1 / WILTO;3M 345 WILTO; 765 TRIP BRANCH FROM BUS 275232 TO BUS 270926 CKT 1 / WILTO;3M 345 WILTO; B 345 TRIP BRANCH FROM BUS 275232 TO BUS 275332 CKT 1 / WILTO;3M 345 WILTO;3C 33 END
AEP_P4_#2978_05DUMONT 765_B	CONTINGENCY 'AEP_P4_#2978_05DUMONT 765_B' OPEN BRANCH FROM BUS 243206 TO BUS 243207 CKT 1 / 243206 05DUMONT 765 243207 05GRNTWN 765 1 OPEN BRANCH FROM BUS 243206 TO BUS 270644 CKT 1 / 243206 05DUMONT 765 270644 WILTON ; 765 1 END
COMED_P1-2_765-L11216__-S	CONTINGENCY 'COMED_P1-2_765-L11216__-S' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 END / WILTO; 765 COLLI; 765
Base Case	
COMED_P4_023-65-BT2-3__	CONTINGENCY 'COMED_P4_023-65-BT2-3__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 270607 TO BUS 270630 CKT 1 / COLLI; 765 PLANO; 765 END
COMED_P4_112-65-BT5-6__	CONTINGENCY 'COMED_P4_112-65-BT5-6__' TRIP BRANCH FROM BUS 270644 TO BUS 270607 CKT 1 / WILTO; 765 COLLI; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270644 CKT 1 / WILTO;4M 345 WILTO; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270927 CKT 1 / WILTO;4M 345 WILTO; R 345 TRIP BRANCH FROM BUS 275233 TO BUS 275333 CKT 1 / WILTO;4M 345 WILTO;4C 33 END
COMED_P4_112-65-BT4-5__	CONTINGENCY 'COMED_P4_112-65-BT4-5__' TRIP BRANCH FROM BUS 270644 TO BUS 243206 CKT 1 / WILTO; 765 05DUMONT 765 TRIP BRANCH FROM BUS 275233 TO BUS 270644 CKT 1 / WILTO;4M 345 WILTO; 765 TRIP BRANCH FROM BUS 275233 TO BUS 270927 CKT 1 / WILTO;4M 345 WILTO; R 345 TRIP BRANCH FROM BUS 275233 TO BUS 275333 CKT 1 / WILTO;4M 345 WILTO;4C 33 END

Contingency Name	Contingency Definition
COMED_P4_012-45-BT5-6__	CONTINGENCY 'COMED_P4_012-45-BT5-6__' TRIP BRANCH FROM BUS 270716 TO BUS 270736 CKT 1 / DRES; B 345 ELWOO; B 345 TRIP BRANCH FROM BUS 270736 TO BUS 270737 CKT 1 / ELWOO; B 345 ELWOO; R 345 TRIP BRANCH FROM BUS 274702 TO BUS 270716 CKT 1 / KEND

Short Circuit

27 Short Circuit

AE2-153 Option 2:

Bus Number	Bus Name	BREAKER	Rating Type	Breaker Capacity (Amps)	Duty Percent with AE2-153_	Duty Percent without AE2-153	Duty Percent Difference
271295	DaviCrk R1 138.kV	86 0902	S	56473.2	100.63%	98.72%	1.92%