

***Generation Interconnection Feasibility Study  
Report***

***PJM Generation Interconnection Request  
Queue Position #U3-012  
Bradford 115kV  
85 MW  
(11 MW capacity)***

**January 2009**

## **Preface**

The intent of the Generation Interconnection Feasibility Study is to determine a plan, with ballpark cost and construction time estimates, to connect the subject generation interconnection project to the PJM network at a location specified by the Interconnection Customer. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system.

The proposed interconnection facilities must be designed in accordance with the FirstEnergy “Requirements for Transmission Connected Facilities” document. Procedures for gaining access to these standards can be found at the link below.

<http://www.pjm.com/planning/design-engineering/to-tech-standards.aspx>

In some instances an Interconnection Customer may not be responsible for 100% of the identified Network Upgrade cost because other transmission network uses, e.g. another generation interconnection or merchant transmission upgrade, may also contribute to the need for the same network reinforcement. The possibility of sharing the reinforcement costs with other projects may be identified in the Generation Interconnection Feasibility Study, but the actual allocation will be deferred until the System Impact Study is performed.

The Generation Interconnection Feasibility Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities unless noted in the report. The project Interconnection Customer is responsible for acquiring any necessary right of way and real estate, as well as applying for and obtaining any and all permits unless prior agreement by interested parties allows for other arrangements. For properties currently owned by Transmission Owners, some permitting and real estate costs may be included in the study.

## **Cost and Timing Estimates**

The estimates in this report do not include tax gross-up.

While the information in this transmittal is reasonable for the scope of work defined, it should, however, be noted that the cost figures and time estimates are conceptual in nature at this stage, as an engineering team has not been assigned to the project. Any change to the scope of work will require that the estimates be revisited. The costs are a best estimate, but the Interconnection Customer will be charged for actual costs. Any under-runs or over-runs will be reconciled at the conclusion of the project.

## **General**

The Queue Position U3-012 project was studied as an 85MW (11MW of which was capacity) injection into the PENELEC system on the Farmers Valley-Lewis Run 115kV line. U3-012 was evaluated for compliance with reliability criteria for summer peak conditions in 2012.

## **Metering**

The Interconnection Customer will be required to install and maintain metering and telemetry equipment to provide revenue metering and real-time telemetry data to PJM and the Transmission Owner. The PJM requirements for this equipment are listed in Appendix 2, section 8 of Attachment O to the PJM Tariff, as well as PJM Manuals 01 and 14D. The PJM and Transmission Owner requirements for Metering Equipment will be discussed in more detail in subsequent studies.

### **PENELEC Revenue Metering Requirements for Generation Interconnection Customer**

Interconnection Customer shall install, own, operate, test and maintain the necessary revenue quality Metering Equipment. This includes current transformers, voltage transformers, mounting structures, wiring, meters, communication circuits, and associated devices. The Metering Equipment must meet the specifications listed in the FirstEnergy connection documents. The FirstEnergy “Requirements for Transmission Connected Facilities” can be retrieved from:

<http://www.pjm.com/planning/design-engineering/to-tech-standards.aspx>

The Metering Equipment shall be located at the generation facility on the high voltage side of the generator step-up transformers or facility main step-up transformer and/or station service power transformers. Power flows to and from the facility shall be compensated to the Point of Interconnection.

Penelec will provide revenue quality Metering Equipment for a station service power supply at a generation facility if the supply is from the local Penelec distribution system.

The revenue quality Metering Equipment shall be capable of collecting and storing bidirectional billing data. The billing data shall be stored in intervals specified by Penelec, typically fifteen minutes or thirty minutes. The Interconnection Customer must provide Penelec with remote access to the billing data in the Metering Equipment via a dedicated voice-grade analog telephone circuit. The Interconnection Customer shall provide Penelec with contact information for the person or persons responsible for meter programming and Metering Equipment maintenance.

The Interconnection Customer shall consult with Penelec regarding the revenue quality metering system design and provide the following information:

- Facility one line and revenue metering installation drawings (schematics, wiring diagrams, etc.)
- Estimated power flows to and from the facility at all revenue metering points
- Current transformer and voltage transformer specifications, including manufacturer, type, nameplate drawings, and certified accuracy test reports
- Revenue meter specifications including manufacturer, type, model number, and accuracy

- Revenue meter program information including but not limited to billing data recorder channel assignments, recorder pulse weights (Ke), and read-only password for access to interval data by the FirstEnergy billing data collection system (MV-90)
- Revenue meter telephone number
- Revenue meter loss compensation data (if applicable)

The Interconnection Customer shall provide Penelec with prior notification of any modifications at the facility that will affect the revenue meter measurements, including substation reconfigurations and meter program changes.

The revenue metering system at each location shall be tested for accuracy by the Interconnection Customer once every two years. The Interconnection Customer shall give reasonable notice to Penelec of the time when the testing is scheduled so that Penelec may have representatives present. Penelec shall have the right to audit the revenue Metering Equipment and/or related documents. The Interconnection Customer shall be given a reasonable period of time to comply with any requests associated with an audit.

### **Design Requirements**

The generation owner is responsible for specifying appropriate equipment and facilities such that the parallel generation is compatible with the Penelec Transmission System. The generation owner is also responsible for meeting any applicable federal, state, and local codes. It is also the Interconnection Customer's responsibility to obtain any needed right-of-way between the plant site and Penelec's facilities.

Penelec will complete detailed relay coordination studies to identify off-site relay setting changes required due to this generation interconnection during the Facilities Study on construction phase of this project. This may result in additional individual relay replacements being required. These relay replacements will be done at the cost of the Interconnection Customer.

### **Reactive Power**

Requirements to be provided during the System Impact Study or Facilities Study phase of the project studies.

### **Cost and Timing Estimates**

While the information in this transmittal is reasonable for the scope of work defined, it should, however, be noted that the cost figures and time estimates are conceptual in nature at this stage, as an engineering team has not been assigned to the project. Any change to the scope of work will require that the estimates be revisited. The costs are a best estimate, but the Interconnection Customer will be charged for actual costs. Any under-runs or over-runs will be reconciled at the conclusion of the project.

Cost Estimates provided in this report were derived from estimates received in association with other similar projects.

**Direct Connection Facilities**

The Interconnection Customer is responsible for constructing all of the facilities on its side of the Point of Interconnection.

The proposed Interconnection Facilities must be designed in accordance with the FirstEnergy “Requirements for Transmission Connected Facilities” document. Procedures for gaining access to these standards can be found at the link below.

<http://www.pjm.com/planning/design-engineering/to-tech-standards.aspx>

Below are conceptual estimates for the engineering/construction associated with direct connection requirements based upon similar projects that have been designed and/or constructed. The cost below is based on U3-012 being the only project to connect at this substation.

Item	Description	Conceptual Cost Estimate
1	New 115 kV 3-breaker ring bus termination point at a new interconnection substation.	\$3,263,000
2	New 115 kV loop into interconnection substation.	\$250,000
3	115 kV transmission line extending from the new interconnection substation structure to the generation plant substation.	N/A Interconnection Customer cost. Line built, owned and maintained by the Interconnection Customer.
4	Relay and control work at the Farmers Valley 115kV substation	\$250,000
5	Relay and control work at the Lewis Run 115kV substation	\$250,000
	Additional communications and control evaluations to occur during the System Impact Study may require the installation of fiber optic cable	

Conceptual Estimate: \$4,013,000  
 Estimated Lead Time: 2.0 years from signed CSA

Notes:

Detailed Engineering & Construction Estimates to be determined during subsequent phase(s) of this projects development.

The above estimates do not include 1) tax gross-up, 2) property costs and site development up to rough grade which is to be provided by the Interconnection Customer, 3) interconnection metering

and generation SCADA to be provided by the Interconnection Customer, 4) engineering and field activities for design review and commissioning of the Interconnection Customer's facilities, and 5) Real estate costs that may be required for right-of-way easements to extend the 115 kV line.

Potential network impacts were as follows:

**Network Impacts**

Potential network impacts were as follows:

**Generator Deliverability**

*(Single or N-1 contingencies for the Capacity Resource portion only of the interconnection)*

No problems were identified

**Multiple Facility Contingency**

*(Double Circuit Tower Line for the full energy output. Stuck breaker and bus fault contingencies will be performed for the System Impact Study)*

No problems were identified

**Contribution to Previously Identified Overloads**

*(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)*

No problems were identified

**Short Circuit**

PJM studied the 230kV and above voltage systems and found no new breakers to be overdutied, and no addition to the fault current associated with any previously identified overdutied breakers. Additional short circuit study will be conducted during the System Impact Study phase of this project.

**Steady-State Voltage Requirements**

(Results of the steady-state voltage studies should be inserted here)

To be determined during the System Impact Study phase of the study of this project.

**Stability and Reactive Power Requirement**

(Results of the dynamic studies should be inserted here)

To be determined during the System Impact Study or Facilities Study phase of the study of this project.

### **Delivery of Energy Portion of Interconnection Request**

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The Interconnection Customer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request Note: Only the most severely overloaded conditions are listed below. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission Interconnection Request, a subsequent analysis will be performed which shall study all overloaded conditions associated with the overloaded element(s) identified.

As a result of the aggregate energy resources in the area, the following violations were identified:


1. The Q72\_TAP-South TR 115 kV line loads (bus# 95660- 380) from 334% to 345.69% (DC power flow) of its emergency rating (119 MVA) for the single line contingency outage of line 522-296 (PN28). This project contributes approximately 13.91 MW to the thermal congestion.
2. The Mansfield-Q72\_Tap 115 kV line loads (bus# 379- 95660) from 202.32% to 214.01% (DC power flow) of its emergency rating (119 MVA) for the single line contingency outage of line 522-296 (PN28). This project contributes approximately 13.91 MW to the thermal congestion.
3. The Mansfield-Q72\_Tap 115 kV line loads (bus# 379- 95660) from 176.5% to 185.72% (DC power flow) of its normal rating (119 MVA) for non-contingency condition. This project contributes approximately 10.98 MW to the thermal congestion.
4. The Niles VA-Mansfield 115 kV line loads (bus# 378- 379) from 186.39% to 198.32% (DC power flow) of its emergency rating (119 MVA) for single line contingency outage of line 522-296 (PN28). This project contributes approximately 14.20 MW to the thermal congestion.
5. The Niles VA-Mansfield 115 kV line loads (bus# 378- 379) from 161.01% to 170.44% (DC power flow) of its normal rating (119 MVA) for non-contingency condition. This project contributes approximately 11.23 MW to the thermal congestion.
6. The N-036C – Sabinsville 115 kV line loads (bus# 93270-377) from 188.68% to 197.7% (DC power flow) of its normal rating (130 MVA) for non-contingency condition. This project contributes approximately 11.73 MW to the thermal congestion.
7. The Sabinsville - Niles VA 115 kV line loads (bus# 377-378) from 179.25% to 188.27% (DC power flow) of its normal rating (130 MVA) for non-contingency condition. This project contributes approximately 11.73 MW to the thermal congestion.
8. The Sabinsville – Niles VA 115 kV line loads (bus# 377-378) from 166.34% to 175.66% (DC power flow) of its emergency rating (159 MVA) for the single line contingency outage

- of line (PN28). This project contributes approximately 14.82 MW to the thermal congestion.
9. The Rockton – Shawvl 1 115 kV line loads (bus# 422-423) from 128.83% to 141.6% (DC power flow) of its emergency rating (146 MVA) for the single line contingency outage (PN9). This project contributes approximately 18.64 MW to the thermal congestion.
  10. The Lewis RN-Glade TP 230 kV line loads (bus# 412-290) from 112.19% to 138.29% (DC power flow) of its emergency rating (213 MVA) for the single line contingency outage (SOUTHTR\_Q72). This project contributes approximately 55.59 MW to the thermal congestion.
  11. The Lewis RN 115/230 kV transformer loads (bus# 374-412) from 110.9% to 135.6% (DC power flow) of its emergency rating (225 MVA) for the single line contingency outage (SOUTHTR\_Q72). This project contributes approximately 55.59 MW to the thermal congestion.
  12. The Homer CT-Shelocta 230 kV line loads (bus# 477-3505) from 140.45% to 141.56% (DC power flow) of its emergency rating (854 MVA) for the single line contingency outage (PN48A). This project contributes approximately 9.42 MW to the thermal congestion.
  13. The Forest 115/230 kV transformer loads (bus# 354-283) from 93.79% to 104.88% (DC power flow) of its emergency rating (192 MVA) for the single line contingency outage (PENELEC\_R92B). This project contributes approximately 21.29 MW to the thermal congestion.
  14. (PN/AP) The Forest – 01ELKO 230/230 kV line loads (bus# 283-20175) from 109.43% to 121.02% (DC power flow) of its emergency rating (505 MVA) for the single line contingency outage (PN9). This project contributes approximately 58.5 MW to the thermal congestion.
  15. The R-092C – ROCKTON 115/115 kV line loads (bus# 96914-422) from 102.42% to 112.55% (DC power flow) of its emergency rating (184 MVA) for the single line contingency outage (PN9). This project contributes approximately 18.6 MW to the thermal congestion.
  16. The Glade-Warren 230 kV line loads (bus# 296-522) from 99.26% to 108.75% (DC power flow) of its emergency rating (540 MVA) for the single line contingency outage (PN9). This project contributes approximately 51.25 MW to the thermal congestion.
  17. The Gold-N036C 115 kV line loads (bus# 376-93270) from 99.96% to 108.98% (DC power flow) of its normal rating (130 MVA) for non-contingency condition. This project contributes approximately 11.7 MW to the thermal congestion.
  18. (APS/PN) The 01Shingl-Lewistwn 230 kV line loads (bus# 20248-214) from 102.69% to 107.86% (DC power flow) of its emergency rating (505 MVA) for the single line

contingency outage (PN28). This project contributes approximately 26 MW to the thermal congestion.

19. The Forest – 01ELKO 230/230 kV line loads (bus# 283-20175) from 109.43% to 121.02% (DC power flow) of its emergency rating (505 MVA) for the single line contingency outage (PN28). This project contributes approximately 58.5 MW to the thermal congestion.
20. The 01SHINGL – LEWISTWN 230/230 kV line loads (bus# 20284-214) from 102.68% to 107.84% (DC power flow) of its emergency rating (505 MVA) for the single line contingency outage (PN28). This project contributes approximately 26 MW to the thermal congestion.
21. The U3-012 – Lewis Run 115 kV line loads from 121% to 159% (DC power flow) of its emergency rating (146 MVA) for the single line contingency outage (Mansfiel\_Q72). This project contributes approximately 56 MW to the thermal congestion.
22. The Farmers Valley – Ridgeway 115 kV line loads from 143% to 161% (DC power flow) of its emergency rating (146 MVA) for the single line contingency (SouthTr\_Q72). This project contributes approximately 27 MW to the thermal congestion.
23. The U3-012 – Lewis Run 115 kV line loads from 90% to 133% (DC power flow) of its normal rating (115 MVA) for non-contingency conditions. This project contributes approximately 50 MW to the thermal congestion.
24. The U3-012 – Farmers Valley 115 kV line loads from 92% to 119% (DC power flow) of its emergency rating (146 MVA) for the single line contingency outage (PN28). This project contributes approximately 40 MW to the thermal congestion.
25. The U3-012 – Farmers Valley 115 kV line loads from 86% to 116% (DC power flow) of its normal rating (115 MVA) for non-contingency conditions. This project contributes approximately 35 MW to the thermal congestion.
26. The Keystone 500/230 kV transformer #4 loads from 103% to 105% (DC power flow) of its emergency rating (530 MVA) for the single contingency outage (PJM 30). This project contributes approximately 9 MW to the thermal congestion.
27. The Keystone 500/230 kV transformer #3 loads from 103% to 105% (DC power flow) of its emergency rating (534 MVA) for the single contingency outage (PJM 31). This project contributes approximately 9 MW to the thermal congestion.

Figure 1

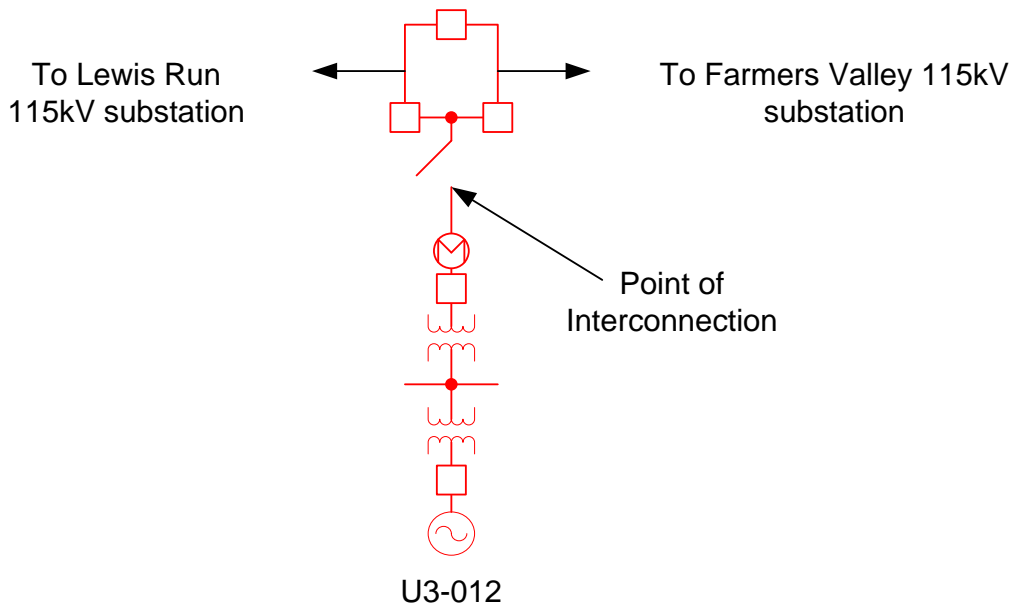

**Legend**

⊗	Generator
□	Breaker
⌚	Transformer
- / -	Disconnect Switch
⊙	Revenue Meter

All facilities depicted in black are existing facilities. All facilities depicted in red are facilities to be added as a result of this Interconnection Request.