



Generation Interconnection
Queue Project AE1-018
PEAK CREEK-MEMORIA DRIVE
Feasibility/System Impact Study Report
Capacity: 2.8 MW / Energy: 5 MW

June 2019

Preface

The intent of the feasibility study is to determine a plan, with ballpark cost and construction time estimates, to connect the subject generation to the PJM network at a location specified by the Interconnection Customer. The Interconnection Customer may request the interconnection of generation as a capacity resource or as an energy-only resource. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing: (1) Direct Connections, which are new facilities and/or facilities upgrades needed to connect the generator to the PJM network, and (2) Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system.

In some instances a generator interconnection may not be responsible for 100% of the identified network upgrade cost because other transmission network uses, e.g. another generation interconnection, may also contribute to the need for the same network reinforcement. Cost allocation rules for network upgrades can be found in PJM Manual 14A, Attachment B. The possibility of sharing the reinforcement costs with other projects may be identified in the feasibility study, but the actual allocation will be deferred until the impact study is performed.

The Interconnection Customer seeking to interconnect a wind generation facility shall maintain meteorological data facilities as well as provide that meteorological data which is required per Schedule H to the Interconnection Service Agreement and Section 8 of Manual 14D.

An Interconnection Customer with a proposed new Customer Facility that has a Maximum Facility Output equal to or greater than 100 MW shall install and maintain, at its expense, phasor measurement units (PMUs). See Section 8.5.3 of Appendix 2 to the Interconnection Service Agreement as well as section 4.3 of PJM Manual 14D for additional information.

An Interconnection Customer entering the New Services Queue on or after October 1, 2018 (except those regulated by the United States Nuclear Regulatory Commission) shall provide primary frequency response in accordance with Section 4.7.2 of Appendix 2 to the Interconnection Service Agreement. See PJM Manual 14D Section 7.1.1 for more information.

PJM utilizes manufacturer models to ensure the performance of turbines is properly captured during the simulations performed for stability verification and, where applicable, for compliance with low voltage ride through requirements. Turbine manufacturers provide such models to their customers. The list of manufacturer models PJM has already validated is contained in Attachment B of Manual 14G. Manufacturer models may be updated from time to time, for various reasons such as to reflect changes to the control systems or to more accurately represent the capabilities turbines and controls which are currently available in the field. Additionally, as new turbine models are developed, turbine manufacturers provide such new models which must be used in the conduct of these studies. PJM needs adequate time to evaluate the new models in order to reduce delays to the System Impact Study process timeline for the Interconnection Customer as well

as other Interconnection Customers in the study group. Therefore, PJM will require that any Interconnection Customer with a new manufacturer model must supply that model to PJM, along with a \$10,000 fully refundable deposit, no later than three (3) months prior to the starting date of the System Impact Study (See Section 4.3 for starting dates) for the Interconnection Request which shall specify the use of the new model. The Interconnection Customer will be required to submit a completed dynamic model study request form (Attachment B-1 of Manual 14G) in order to document the request for the study.

The Feasibility Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities. The project developer is responsible for the right of way, real estate, and construction permit issues. For properties currently owned by Transmission Owners, the costs may be included in the study.

General

Pulaski Community Solar LLC, the Interconnection Customer (IC), has proposed a Solar generating facility located in Pulaski, Virginia. The installed facilities will have a total capability of 5 MW with 2.8 MW of this output being recognized by PJM as Capacity. The proposed in-service date for this project is June 1, 2020. This study does not imply a TO commitment to this in-service date.

Queue Number	AE1-018
Project Name	PEAK CREEK-MEMORIA DRIVE
Interconnection Customer	Pulaski Community Solar LLC
State	Virginia
County	Pulaski
Transmission Owner	AEP
MFO	5.0
MWE	5.0
MWC	2.8
Fuel	Solar
Basecase Study Year	2022

Project Description

The Queue Project AE1-018 was evaluated as a 5 MW (Capacity 2.8 MW) injection at PEAK CREEK-MEMORIAL DRIVE substation in the AEP area. Project AE1-018 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AE1-018 was studied with a commercial probability of 100%. Potential network impacts were as follows:

Summer Peak Load Flow

Generation Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

None

Potential Congestion due to Local Energy Deliverability

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Note: Only the most severely overloaded conditions are listed below. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission Interconnection

Request, a subsequent analysis will be performed which shall study all overload conditions associated with the overloaded element(s) identified.

ID	FROM BUS#	FROM BUS	FROM BUS AREA	TO BUS#	TO BUS	TO BUS AREA	CONT NAME	Type	Rating MVA	PRE PROJECT LOADING %	POST PROJECT LOADING %	MW IMPACT
34550	934750	AD1-102 TAP	AEP	242609	05CLYTR2	AEP	AEP_P1-2_#311	operation	243	130.56	131.93	3.34
34551	934750	AD1-102 TAP	AEP	242609	05CLYTR2	AEP	Base Case	operation	219	125.93	126.95	2.23


Short Circuit

The following Breakers are overduty

None

Additional Interconnection Customer Responsibilities

The Interconnection Customer may be required to install and/or pay for metering as necessary to properly track real time output of the facility as well as installing metering which shall be used for billing purposes. See Section 8 of Appendix 2 to the Interconnection Service Agreement as well as Section 4 of PJM Manual 14D for additional information.

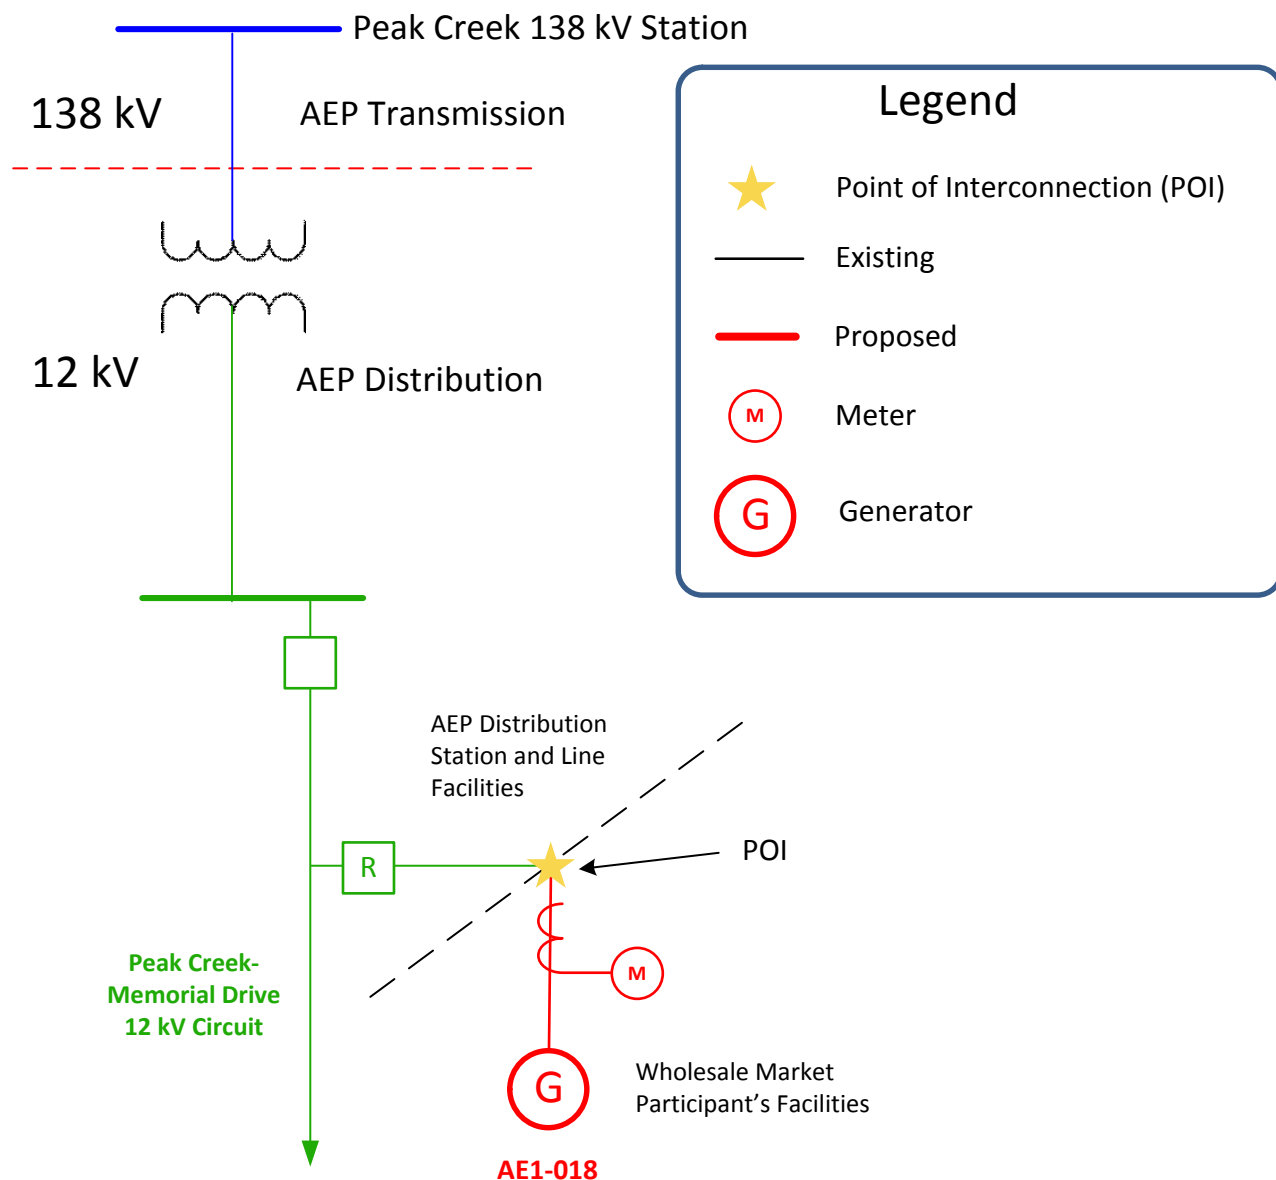

The point of interconnection is at AEP's distribution primary meter facility on the Wholesale Market Participant's premise.

Figure 1 – Single Line Diagram

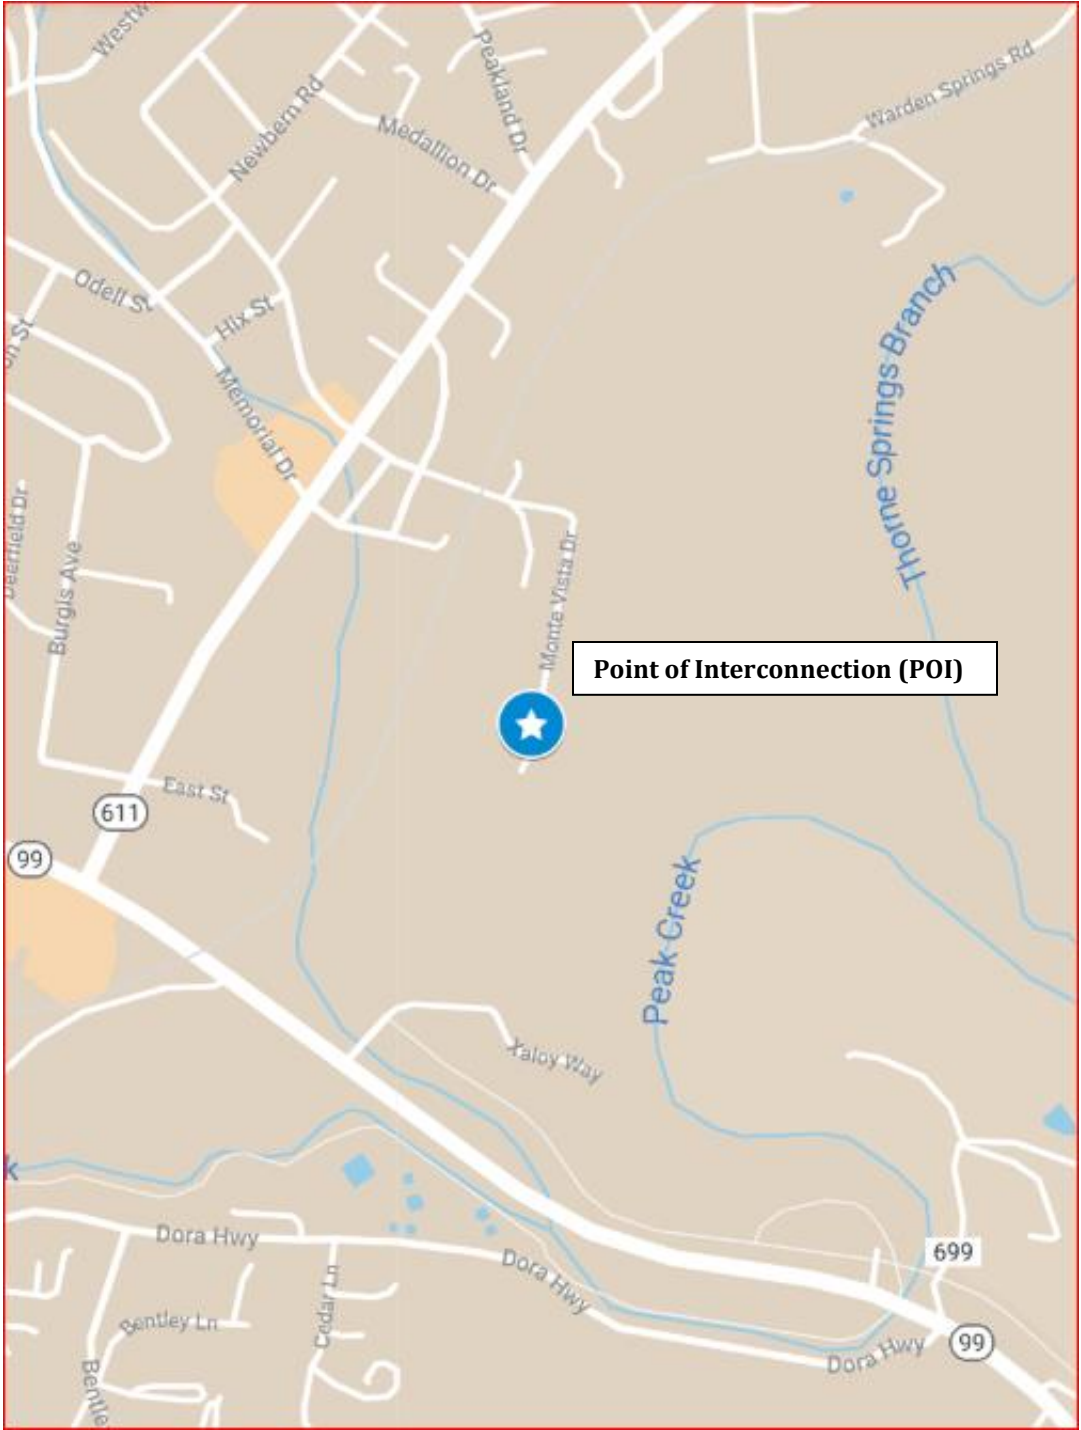


Figure 2 – Location