Generation Interconnection
Feasibility/System Impact Study Report

For

PJM Generation Interconnection Request Queue
Position AA1-014

Beverly (Washington Energy Facility) 345 kV

August 2015

Preface

The intent of the System Impact Study is to determine a plan, with approximate cost and construction time estimates, to connect the subject generation interconnection project to the PJM network at a location specified by the Interconnection Customer. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing: Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system. All facilities required for interconnection of a generation interconnection project must be designed to meet the technical specifications (on PJM web site) for the appropriate transmission owner.

In some instances an Interconnection Customer may not be responsible for 100% of the identified network upgrade cost because other transmission network uses, e.g. another generation interconnection or merchant transmission upgrade, may also contribute to the need for the same network reinforcement. The possibility of sharing the reinforcement costs with other projects may be identified in the Feasibility Study, but the actual allocation will be deferred until the System Impact Study is performed.

The System Impact Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities. The project developer is responsible for the right of way, real estate, and construction permit issues. For properties currently owned by Transmission Owners, the costs may be included in the study.

© PJM Interconnection 2015. All rights reserved.

General

Dynegy Marketing and Trade, LLC (Dynegy) proposes to increase the generation of its combined cycle plant at Beverly (Washington Energy 345 kV Facility) by 5 MW (Capacity) (see Figure 1). The combined cycle power plant is currently assigned CIRs of 620 MWs. Duke Energy stated that the increase is the result of summer capacity testing of the existing GE Combined cycle plant, not due to any equipment changes. Therefore the increase by 5 MW (Capacity) will bring the total Maximum Facility Output (MFO) of the combined cycle power plant to 625 MW. The location of the generating facility is Beverly, OH (see Figure 2).

The requested in service date is June 1, 2015.

The objective of this Feasibility study is to determine budgetary cost estimates and approximate construction timelines for identified transmission facilities required to connect the proposed generating facilities to the AEP transmission system. These reinforcements include the Attachment Facilities, Local Upgrades, and Network Upgrades required to maintain the reliability of the AEP transmission system. Stability analysis is not included as part of this study.

Attachment Facilities

Station Cost:

- No work is required.

Protection and Relaying Cost:

- No work is required.

Local and Network Impacts

The impact of the proposed generating facility on the AEP Transmission System was assessed for adherence with applicable reliability criteria. AEP planning criteria require that the transmission system meet performance parameters prescribed in the AEP FERC Form 715[1] and Connection Requirements for AEP Transmission System[2]. Therefore, these criterion were used to assess the impact of the proposed facility on the AEP System. PJM project # AA1-014 was studied as a 5 MW increase at Beverly (Washington Energy Facility) 345 kV Substation consistent with the interconnection application. PJM Queue # AA1-014 project was evaluated for compliance with reliability criteria for summer peak conditions in 2018.

1 https://www.aep.com/about/codeofconduct/oasis/transmissionstudies/GuideLines/2014%20AEP%20PJM%20FERC%20715_Final_Part%204.pdf

2 https://www.aep.com/about/codeofconduct/OASIS/TransmissionStudies/Requirements/AEP_Interconnection_Requirements_rev1.pdf

© PJM Interconnection 2015. All rights reserved.

Network Impacts

The Queue Project AA1-014 was studied as a 5.0 MW (Capacity 5.0 MW) injection at the Beverly 345 kV substation in the AEP area. Project AA1-014 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AA1-014 was studied with a commercial probability of 100%. Potential network impacts were as follows:

Summer Peak Analysis - 2018

Generator Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

None

Steady-State Voltage Requirements

(Results of the steady-state voltage studies should be inserted here)

None

Delivery of Energy Portion of Interconnection Request

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Only the most severely overloaded conditions are listed. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission

© PJM Interconnection 2015. All rights reserved.

Interconnection Request, a subsequent analysis will be performed, which will study all overload conditions associated with the overloaded element(s) identified.

Not Applicable

Light Load Analysis - 2018

Not required

System Reinforcements

New System Reinforcements
(Upgrades required to mitigate reliability criteria violations, i.e. Network Impacts, initially caused by the addition of this project generation)

None

Contribution to Previously Identified System Reinforcements
(Overloads initially caused by prior Queue positions with additional contribution to overloading by this project. This project may have a % allocation cost responsibility which will be calculated and reported for the Impact Study)
(Summary form of Cost allocation for transmission lines and transformers will be inserted here if any)

None

Short Circuit
(Summary form of Cost allocation for breakers will be inserted here if any)

None

Stability and Reactive Power Requirement
(Results of the dynamic studies should be inserted here)

Not required

© PJM Interconnection 2015. All rights reserved.

Conclusion

Based upon the results of this Feasibility Study, the increase of 5 MW of generation at Beverly (Washington Energy Facility) 345 kV Substation will not require additional Network upgrades.

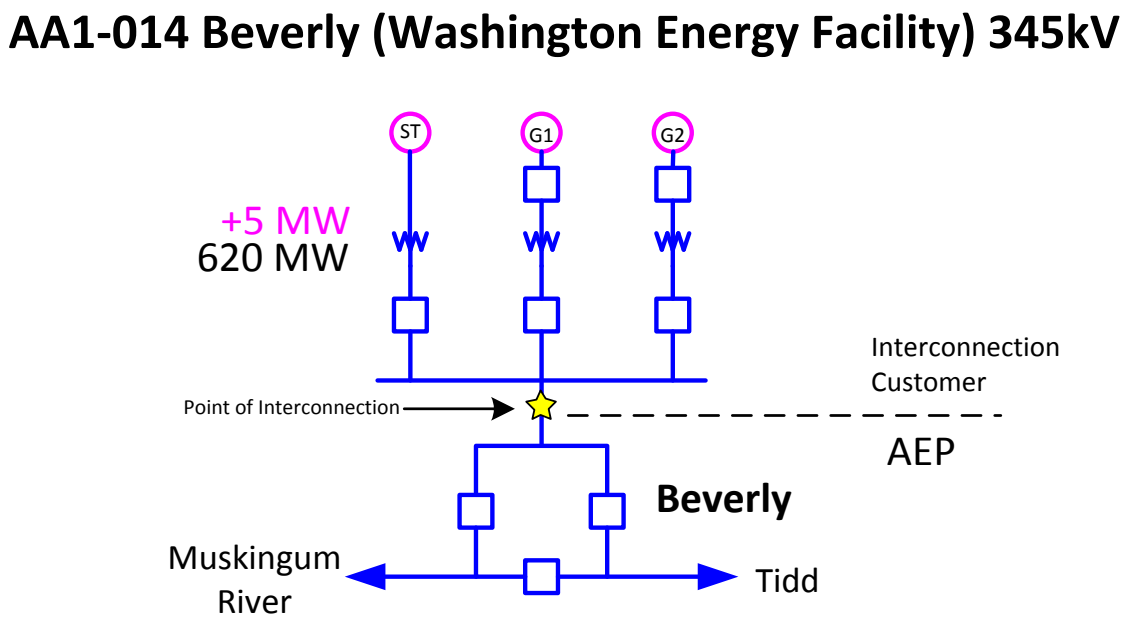

Figure 1 – Single Line Diagram

© PJM Interconnection 2015. All rights reserved.

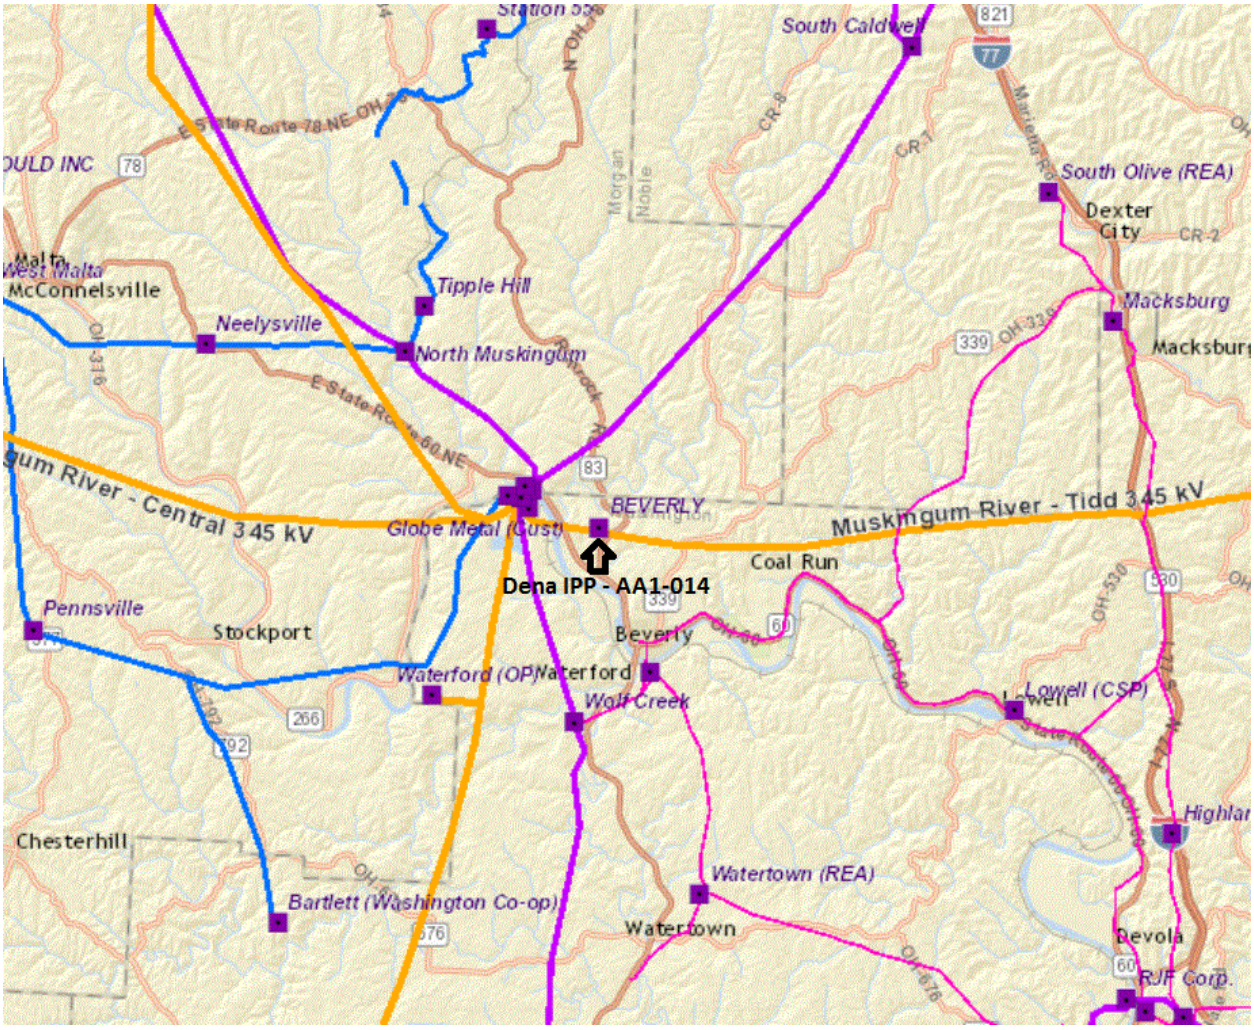

Figure 2: AA1-014 Point of Interconnection

© PJM Interconnection 2015. All rights reserved.

Generation Interconnection
Feasibility/System Impact Study Report

For

PJM Generation Interconnection Request Queue
Position AA1-014

Beverly (Washington Energy Facility) 345 kV

August 2015

Preface

The intent of the System Impact Study is to determine a plan, with approximate cost and construction time estimates, to connect the subject generation interconnection project to the PJM network at a location specified by the Interconnection Customer. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing: Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system. All facilities required for interconnection of a generation interconnection project must be designed to meet the technical specifications (on PJM web site) for the appropriate transmission owner.

In some instances an Interconnection Customer may not be responsible for 100% of the identified network upgrade cost because other transmission network uses, e.g. another generation interconnection or merchant transmission upgrade, may also contribute to the need for the same network reinforcement. The possibility of sharing the reinforcement costs with other projects may be identified in the Feasibility Study, but the actual allocation will be deferred until the System Impact Study is performed.

The System Impact Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities. The project developer is responsible for the right of way, real estate, and construction permit issues. For properties currently owned by Transmission Owners, the costs may be included in the study.

© PJM Interconnection 2015. All rights reserved.

General

Dynegy Marketing and Trade, LLC (Dynegy) proposes to increase the generation of its combined cycle plant at Beverly (Washington Energy 345 kV Facility) by 5 MW (Capacity) (see Figure 1). The combined cycle power plant is currently assigned CIRs of 620 MWs. Duke Energy stated that the increase is the result of summer capacity testing of the existing GE Combined cycle plant, not due to any equipment changes. Therefore the increase by 5 MW (Capacity) will bring the total Maximum Facility Output (MFO) of the combined cycle power plant to 625 MW. The location of the generating facility is Beverly, OH (see Figure 2).

The requested in service date is June 1, 2015.

The objective of this Feasibility study is to determine budgetary cost estimates and approximate construction timelines for identified transmission facilities required to connect the proposed generating facilities to the AEP transmission system. These reinforcements include the Attachment Facilities, Local Upgrades, and Network Upgrades required to maintain the reliability of the AEP transmission system. Stability analysis is not included as part of this study.

Attachment Facilities

Station Cost:

- No work is required.

Protection and Relaying Cost:

- No work is required.

Local and Network Impacts

The impact of the proposed generating facility on the AEP Transmission System was assessed for adherence with applicable reliability criteria. AEP planning criteria require that the transmission system meet performance parameters prescribed in the AEP FERC Form 715[1] and Connection Requirements for AEP Transmission System[2]. Therefore, these criterion were used to assess the impact of the proposed facility on the AEP System. PJM project # AA1-014 was studied as a 5 MW increase at Beverly (Washington Energy Facility) 345 kV Substation consistent with the interconnection application. PJM Queue # AA1-014 project was evaluated for compliance with reliability criteria for summer peak conditions in 2018.

1 https://www.aep.com/about/codeofconduct/oasis/transmissionstudies/GuideLines/2014%20AEP%20PJM%20FERC%20715_Final_Part%204.pdf

2 https://www.aep.com/about/codeofconduct/OASIS/TransmissionStudies/Requirements/AEP_Interconnection_Requirements_rev1.pdf

© PJM Interconnection 2015. All rights reserved.

Network Impacts

The Queue Project AA1-014 was studied as a 5.0 MW (Capacity 5.0 MW) injection at the Beverly 345 kV substation in the AEP area. Project AA1-014 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AA1-014 was studied with a commercial probability of 100%. Potential network impacts were as follows:

Summer Peak Analysis - 2018

Generator Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

None

Steady-State Voltage Requirements

(Results of the steady-state voltage studies should be inserted here)

None

Delivery of Energy Portion of Interconnection Request

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Only the most severely overloaded conditions are listed. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission

© PJM Interconnection 2015. All rights reserved.

Interconnection Request, a subsequent analysis will be performed, which will study all overload conditions associated with the overloaded element(s) identified.

Not Applicable

Light Load Analysis - 2018

Not required

System Reinforcements

New System Reinforcements
(Upgrades required to mitigate reliability criteria violations, i.e. Network Impacts, initially caused by the addition of this project generation)

None

Contribution to Previously Identified System Reinforcements
(Overloads initially caused by prior Queue positions with additional contribution to overloading by this project. This project may have a % allocation cost responsibility which will be calculated and reported for the Impact Study)
(Summary form of Cost allocation for transmission lines and transformers will be inserted here if any)

None

Short Circuit
(Summary form of Cost allocation for breakers will be inserted here if any)

None

Stability and Reactive Power Requirement
(Results of the dynamic studies should be inserted here)

Not required

© PJM Interconnection 2015. All rights reserved.

Conclusion

Based upon the results of this Feasibility Study, the increase of 5 MW of generation at Beverly (Washington Energy Facility) 345 kV Substation will not require additional Network upgrades.

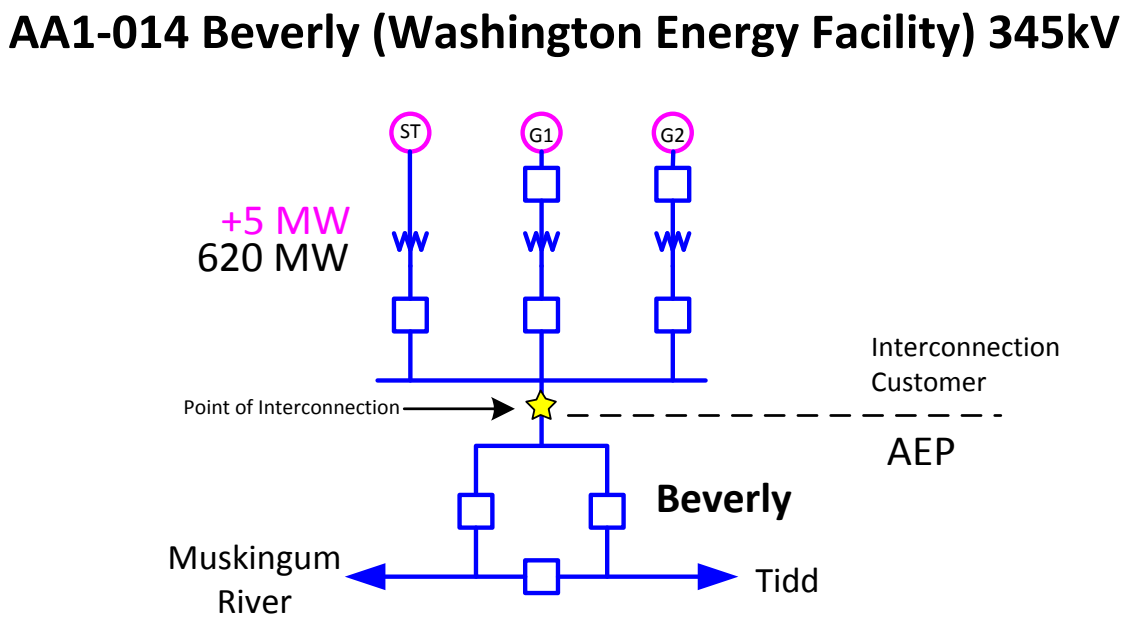

Figure 1 – Single Line Diagram

© PJM Interconnection 2015. All rights reserved.

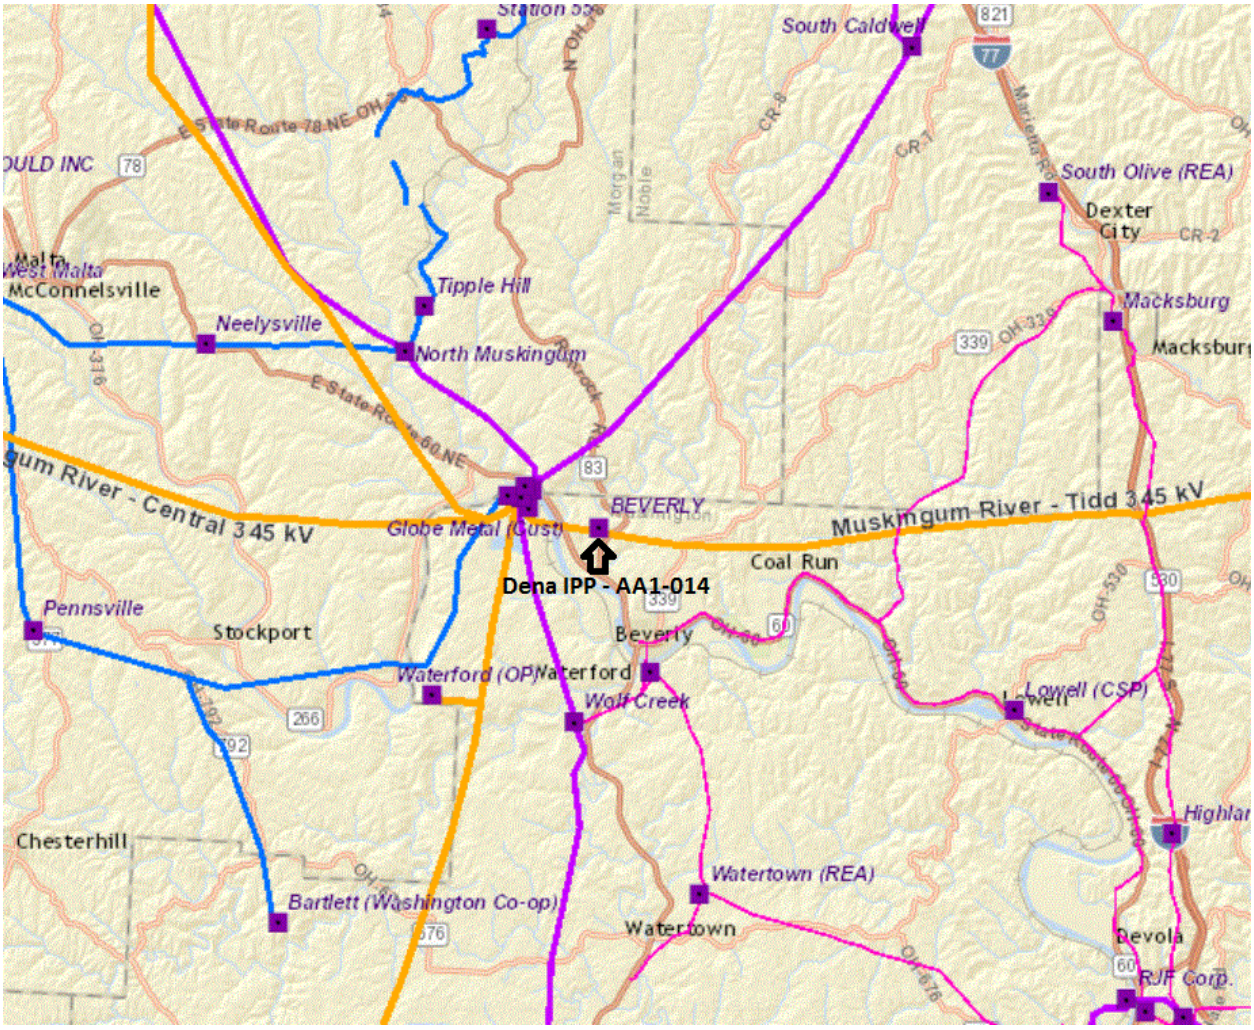

Figure 2: AA1-014 Point of Interconnection

© PJM Interconnection 2015. All rights reserved.

Generation Interconnection
Feasibility/System Impact Study Report

For

PJM Generation Interconnection Request Queue
Position AA1-014

Beverly (Washington Energy Facility) 345 kV

February 2015

Preface

The intent of the System Impact Study is to determine a plan, with approximate cost and construction time estimates, to connect the subject generation interconnection project to the PJM network at a location specified by the Interconnection Customer. As a requirement for interconnection, the Interconnection Customer may be responsible for the cost of constructing: Network Upgrades, which are facility additions, or upgrades to existing facilities, that are needed to maintain the reliability of the PJM system. All facilities required for interconnection of a generation interconnection project must be designed to meet the technical specifications (on PJM web site) for the appropriate transmission owner.

In some instances an Interconnection Customer may not be responsible for 100% of the identified network upgrade cost because other transmission network uses, e.g. another generation interconnection or merchant transmission upgrade, may also contribute to the need for the same network reinforcement. The possibility of sharing the reinforcement costs with other projects may be identified in the Feasibility Study, but the actual allocation will be deferred until the System Impact Study is performed.

The System Impact Study estimates do not include the feasibility, cost, or time required to obtain property rights and permits for construction of the required facilities. The project developer is responsible for the right of way, real estate, and construction permit issues. For properties currently owned by Transmission Owners, the costs may be included in the study.

© PJM Interconnection 2015. All rights reserved.

General

Duke Energy Transmission Holding Company, LLC (Duke) proposes to increase the generation of its combined cycle plant at Beverly (Washington Energy 345 kV Facility) by 5 MW (Capacity) (see Figure 1). The combined cycle power plant is currently assigned CIRs of 620 MWs. Duke Energy stated that the increase is the result of summer capacity testing of the existing GE Combined cycle plant, not due to any equipment changes. Therefore the increase by 5 MW (Capacity) will bring the total Maximum Facility Output (MFO) of the combined cycle power plant to 625 MW. The location of the generating facility is Beverly, OH (see Figure 2).

The requested in service date is June 1, 2015.

The objective of this Feasibility study is to determine budgetary cost estimates and approximate construction timelines for identified transmission facilities required to connect the proposed generating facilities to the AEP transmission system. These reinforcements include the Attachment Facilities, Local Upgrades, and Network Upgrades required to maintain the reliability of the AEP transmission system. Stability analysis is not included as part of this study.

Attachment Facilities

Station Cost:

- No work is required.

Protection and Relaying Cost:

- No work is required.

Local and Network Impacts

The impact of the proposed generating facility on the AEP Transmission System was assessed for adherence with applicable reliability criteria. AEP planning criteria require that the transmission system meet performance parameters prescribed in the AEP FERC Form 715[1] and Connection Requirements for AEP Transmission System[2]. Therefore, these criterion were used to assess the impact of the proposed facility on the AEP System. PJM project # AA1-014 was studied as a 5 MW increase at Beverly (Washington Energy Facility) 345 kV Substation consistent with the interconnection application. PJM Queue # AA1-014 project was evaluated for compliance with reliability criteria for summer peak conditions in 2018.

1 https://www.aep.com/about/codeofconduct/oasis/transmissionstudies/GuideLines/2014%20AEP%20PJM%20FERC%20715_Final_Part%204.pdf

2 https://www.aep.com/about/codeofconduct/OASIS/TransmissionStudies/Requirements/AEP_Interconnection_Requirements_rev1.pdf

© PJM Interconnection 2015. All rights reserved.

Network Impacts

The Queue Project AA1-014 was studied as a 5.0 MW (Capacity 5.0 MW) injection at the Beverly 345 kV substation in the AEP area. Project AA1-014 was evaluated for compliance with applicable reliability planning criteria (PJM, NERC, NERC Regional Reliability Councils, and Transmission Owners). Project AA1-014 was studied with a commercial probability of 100%. Potential network impacts were as follows:

Summer Peak Analysis - 2018

Generator Deliverability

(Single or N-1 contingencies for the Capacity portion only of the interconnection)

None

Multiple Facility Contingency

(Double Circuit Tower Line, Fault with a Stuck Breaker, and Bus Fault contingencies for the full energy output)

None

Contribution to Previously Identified Overloads

(This project contributes to the following contingency overloads, i.e. "Network Impacts", identified for earlier generation or transmission interconnection projects in the PJM Queue)

None

Steady-State Voltage Requirements

(Results of the steady-state voltage studies should be inserted here)

None

Delivery of Energy Portion of Interconnection Request

PJM also studied the delivery of the energy portion of this interconnection request. Any problems identified below are likely to result in operational restrictions to the project under study. The developer can proceed with network upgrades to eliminate the operational restriction at their discretion by submitting a Merchant Transmission Interconnection request.

Only the most severely overloaded conditions are listed. There is no guarantee of full delivery of energy for this project by fixing only the conditions listed in this section. With a Transmission

© PJM Interconnection 2015. All rights reserved.

Interconnection Request, a subsequent analysis will be performed, which will study all overload conditions associated with the overloaded element(s) identified.

Not Applicable

Light Load Analysis - 2018

Not required

System Reinforcements

New System Reinforcements
(Upgrades required to mitigate reliability criteria violations, i.e. Network Impacts, initially caused by the addition of this project generation)

None

Contribution to Previously Identified System Reinforcements
(Overloads initially caused by prior Queue positions with additional contribution to overloading by this project. This project may have a % allocation cost responsibility which will be calculated and reported for the Impact Study)
(Summary form of Cost allocation for transmission lines and transformers will be inserted here if any)

None

Short Circuit
(Summary form of Cost allocation for breakers will be inserted here if any)

None

Stability and Reactive Power Requirement
(Results of the dynamic studies should be inserted here)

Not required

© PJM Interconnection 2015. All rights reserved.

Conclusion

Based upon the results of this Feasibility Study, the increase of 5 MW of generation at Beverly (Washington Energy Facility) 345 kV Substation will not require additional Network upgrades.

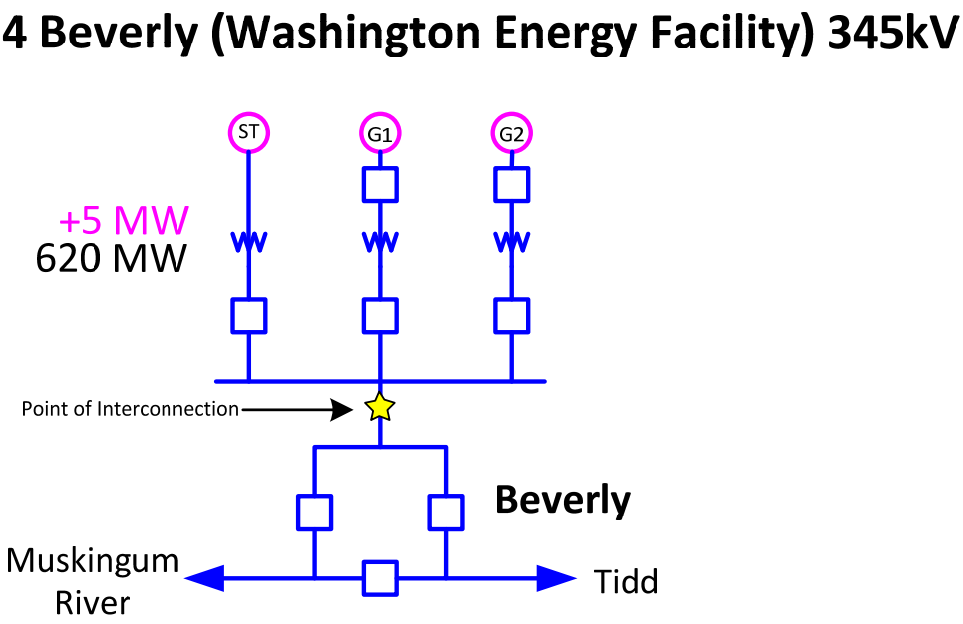

Figure 1 – Single Line Diagram

© PJM Interconnection 2015. All rights reserved.

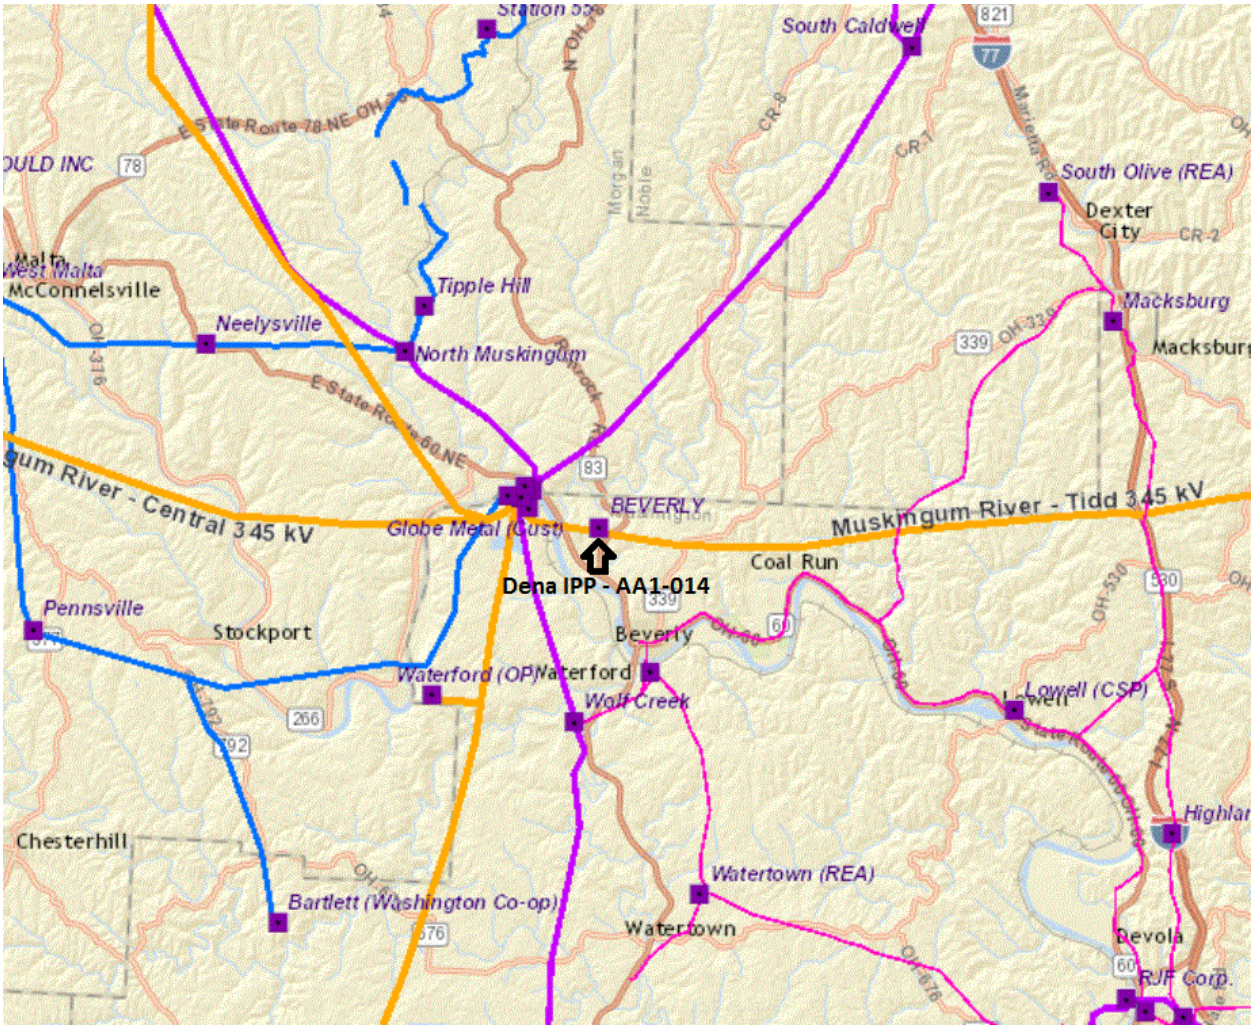

Figure 2: AA1-014 Point of Interconnection

© PJM Interconnection 2015. All rights reserved.